



Dorota Szmajda-Kuberczyk
tłumacz przysięgły języka angielskiego
Rybie, ul. Kasztanowa 33, 05-090 Raszyn
tel. 501 123 253



POŚWIADCZONE TŁUMACZENIE Z JĘZYKA ANGIELSKIEGO

[Dokument źródłowy, przedstawiony w formie elektronicznej, składa się z 35 numerowanych arkuszy. Na życzenie Klienta przetłumaczono strony jak niżej. Tekst w nawiasach kwadratowych pochodzi od tłumacza.] -----

[arkusz 8]: -----

[nagłówek]: logo · **DUŃSKI INSTYTUT TECHNOLOGICZNY** [ang. Danish Technological Institute] · strona 8 z 35 · 300-KLAB024-004-1 -----

[stopka (na każdym arkuszu)]: logo ilac-MRA · logo DANAK · Test Reg. nr. 300 -----


Wyniki badań SCOP w niskiej temperaturze – dla średniej sezonu grzewczego (A) – EN 14825:2022

Model (jednostka zewnętrzna)	PASRW040-BP-PS-D
Pompa ciepła powietrze-woda monoblok	T
Niskotemperaturowa pompa ciepła	N
Wyposażona w dodatkowy ogrzewacz	N
Wielofunkcyjny ogrzewacz z pompą ciepła	N
Obliczenie SCOP wykonane jako odwracalne	T

Znamionowa moc cieplna ¹⁾	P_{RATED}	9,286 [kW]
Sezonowa efektywność energetyczna pomieszczeń	η_s	193,8 [%]
	SCOP	4,92 [-]

Zmierzona wydajność grzewcza przy częściowym obciążeniu w temperaturze zewnętrznej T_j	Klimat umiarkowany	$T_j = 15^\circ\text{C}$	Pdh	- [kW]
		$T_j = -7^\circ\text{C}$		8,17 [kW]
	Zastosowanie w niskiej temperaturze	$T_j = 2^\circ\text{C}$	Pdh	5,03 [kW]
		$T_j = 7^\circ\text{C}$	Pdh	3,85 [kW]
		$T_j = 12^\circ\text{C}$	Pdh	4,27 [kW]
		$T_j =$ temperatura dwuwartościowa	Pdh	8,17 [kW]
		$T_j =$ granica działania	Pdh	9,44 [kW]

Zmierzony współczynnik wydajności w temperaturze zewnętrznej T_j	Klimat umiarkowany	$T_j = 15^\circ\text{C}$	COPd	- [-]
		$T_j = -7^\circ\text{C}$	COPd	2,95 [-]
	Zastosowanie w niskiej temperaturze	$T_j = 2^\circ\text{C}$	COPd	4,78 [-]
		$T_j = 7^\circ\text{C}$	COPd	6,65 [-]
		$T_j = 12^\circ\text{C}$	COPd	8,04 [-]
		$T_j =$ temperatura dwuwartościowa	COPd	2,95 [-]
		$T_j =$ granica działania	COPd	2,63 [-]



Temperatura dwuwartościowa	Tbivalent	-7 [°C]
Graniczna temperatura robocza	TOL	-10 [°C]
Współczynnik strat	Cdh	0,98[-]

Pobór mocy w trybach innych niż aktywny	Tryb wyłączenia	P _{OFF}	0,010 [kW]
	Tryb wyłączonego termostatu	P _{TO}	0,010 [kW]
	Tryb gotowości	P _{SB}	0,010 [kW]
	Tryb włączonej grzałki karteru	P _{CK}	0,010 [kW]
Ogrzewacz dodatkowy ¹⁾	Znamionowa moc cieplna	P _{SUP}	0,03 [kW]
	Rodzaj energii zasilania		elektryczna

Inne pozycje	Regulacja wydajności	zmienna	
	Regulacja przepływu wody	stała	
	Natężenie przepływu wody	-	
	Roczne zużycie energii	Q _{HE}	3899 [kWh]

W przypadku ogrzewaczy pomieszczeń z pompą ciepła i wielofunkcyjnych ogrzewaczy z pompą ciepła znamionowa moc cieplna (Prated) jest równa obciążeniu obliczeniowemu dla trybu ogrzewania (Pdesignh), a znamionowa moc grzewcza ogrzewacza dodatkowego (Psup), jest równa dodatkowej wydajności grzewczej (sup(Tj)).

Do obliczenia SCOP użyto wartości P_{CK} - P_{SB}. Zob. „SCOP – dokładne obliczenie”.

[arkusz 9]: -----


[nagłówek]: logo · DUŃSKI INSTYTUT TECHNOLOGICZNY [ang. Danish Technological Institute] · strona 9 z 35 · 300-KLAB024-004-1 -----

Wyniki badań SCOP w średniej temperaturze – dla średniej sezonu grzewczego (A) – EN 14825:2022 -----

Model (jednostka zewnętrzna)	PASRW040-BP-PS-D
Pompa ciepła powietrze-woda monoblok	T
Niskotemperaturowa pompa ciepła	N
Wyposażona w dodatkową grzałkę	N
Kombinowana grzałka z pompą ciepła	N
Obliczenie SCOP wykonane jako odwrotne	T

Znamionowa moc cieplna ¹⁾	P _{RATED}	9,235 [kW]
Sezonowa efektywność energetyczna pomieszczeń przy częściowym obciążeniu w temperaturze zewnętrznej T _j	η _s	143,8 [%]
	SCOP	3,67 [-]

Zmierzona wydajność grzewcza przy częściowym obciążeniu w temperaturze zewnętrznej T _j	Klimat umiarkowany - Zastosowanie w niskiej temperaturze	T _i = 15°C	P _{dh}	- [kW]
		T _i = -7°C		8,00 [kW]
		T _i = 2°C	P _{dh}	4,90 [kW]
		T _i = 7°C	P _{dh}	4,47 [kW]
		T _i = 12°C	P _{dh}	5,20 [kW]
		T _j = temperatura dwuwartościowa	P _{dh}	8,00 [kW]
		T _i = granica działania	P _{dh}	8,70 [kW]



Zmierzony współczynnik wydajności temperaturze zewnętrznej T_j	Klimat umiarkowany - Zastosowanie w niskiej temperaturze	$T_j = 15^\circ\text{C}$	COPd	- [-]
		$T_j = -7^\circ\text{C}$	COPd	2,21 [-]
		$T_j = 2^\circ\text{C}$	COPd	3,64 [-]
		$T_j = 7^\circ\text{C}$	COPd	4,66 [-]
		$T_j = 12^\circ\text{C}$	COPd	6,38 [-]
		$T_j =$ temperatura dwuwartościowa	COPd	2,21 [-]
		$T_j =$ granica działania	COPd	1,94 [-]

Temperatura dwuwartościowa	Tbivalent	-7 [°C]
Graniczna temperatura robocza	TOL	-10 [°C]
Współczynnik strat	Cdh	0,99[-]

Pobór mocy w trybach innych niż aktywny	Tryb wyłączenia	P_{OFF}	0,010 [kW]
	Tryb wyłączonego termostatu	P_{TO}	0,010 [kW]
	Tryb gotowości	P_{SB}	0,010 [kW]
	Tryb włączonej grzałki karteru	P_{CK}	0,010 [kW]
Ogrzewacz dodatkowy ¹⁾	Znamionowa moc cieplna	P_{SUP}	0,54 [kW]
	Rodzaj energii zasilania		elektryczna

Inne pozycje	Regulacja wydajności	zmienna	
	Regulacja przepływu wody	stała	
	Natężenie przepływu wody	-	
	Roczne zużycie energii	Q_{HE}	5200 [kWh]
W przypadku ogrzewaczy pomieszczeń z pompą ciepła i wielofunkcyjnych ogrzewaczy z pompą ciepła znamionowa moc cieplna (Prated) jest równa obciążeniu obliczeniowemu dla trybu ogrzewania (Pdesignh), a znamionowa moc grzewcza ogrzewacza dodatkowego (Psup), jest równa dodatkowej wydajności grzewczej (sup(Tj)).			
Do obliczenia SCOP użyto wartości $P_{CK} - P_{SB}$. Zob. „SCOP – dokładne obliczenie”.			

[arkusz 11]: -----

[nagłówek]: logo · DUŃSKI INSTYTUT TECHNOLOGICZNY [ang. Danish Technological Institute] · strona 11 z 35 · 300-KLAB024-004-1 -----

Wyniki pomiaru mocy akustycznej – EN 12102-1 -----

Nr	Warunki badania	Poziom mocy akustycznej LW(A) [dB re 1pW]	Niepewność σ_{tot} [dB]
1 ^E	A7/W55	53,4	1,6
2 ^S	A7/W55	58,1	1,8

E) Oznaczenie ErP -----

S) Oznaczenie ErP -----

Poziom mocy akustycznej odniesionej do A jest oznaczony dla mierzonego zakresu częstotliwości od 100 Hz do 10 kHz. W celu obliczenia niepewności zob. Załącznik 1. -----

Pomiary mocy akustycznej wykonuje Kamalathan Arumugam (KAMA) we współpracy z Patrickiem Gilbertem (PGL), Duński Instytut Technologiczny. ---

[arkusz 35]: -----

[nagłówek]: logo · DUŃSKI INSTYTUT TECHNOLOGICZNY [ang. Danish Technological Institute] · strona 9 z 35 · 300-KLAB024-004-1 -----

Załącznik 2 – Nazwa marki -----

Upoważnienie -----

[ang. Authorization Letter] -----

Niniejsza Deklaracja zgodności zostaje wydana na wyłączną odpowiedzialność: -----

Nazwa producenta: Guangdong PHNIX ECO-Energy Solution LTD -----

Adres producenta: No. 3 Tianyuan Road, Dagang Town, Nansha District Guangzhou Guangdong, 511470 Chiny -----

Oświadczamy, iż poniższy produkty, pompy ciepła, który wyprodukowaliśmy dla firmy COOPER AND HUNTER OVERSEAS LP, są identyczne jak nasze poniższe modele: -----

Model Cooper&Hunter	CH-HP15UIMPZM
Model PHNIX	PASRW040S-BP-PS-D

Nazwa [firma] Cooper&Hunter: COOPER AND HUNTER OVERSEAS LP ---

Nazwa marki Cooper&Hunter: Cooper&Hunter -----

Adres Cooper&Hunter: SUITE 201, 45B WEST WILMOT STREET, RICHMOND HILL, ON L4B2P3 KANADA -----

Uwaga: Niniejsza deklaracja traci ważność w przypadku wprowadzenia zmian technologicznych lub funkcjonalnych bez zgody producenta. -----

Data: 24 maja 2024 r. -----

Podmiot upoważniony: Guangdong PHNIX ECO-Energy Solution LTD -----

[-], nieczytelny podpis -----


[Odcisk pieczęci o treści]: W imieniu Guangdong PHNIX ECO-Energy Solution LTD · [-], nieczytelny podpis · Podpis osoby upoważnionej -----

[koniec tłumaczenia]

Ja, Dorota Szmajda-Kuberczyk, tłumacz przysięgły języka angielskiego wpisana na listę tłumaczy przysięgłych Ministra Sprawiedliwości pod numerem TP/2161/05, stwierdzam zgodność powyższego tłumaczenia z dokumentem w języku angielskim (dokument elektroniczny pdf, którego wydruk, opatrzony pieczęcią i podpisem tłumacza, załączono do niniejszego).

Rybie, 26.07.2024 r.

Nr Repertorium: 507/24



Dorota Gide



Test results

Test results of SCOP test at low temperature - heating season average (A) – EN 14825:2022

Model (Outdoor)	PASRW040-BP-PS-D		
Air-to-water heat pump mono bloc	Y		
Low-temperature heat pump	N		
Equipped with supplementary heater	N		
Heat pump combination heater	N		
SCOP calculation done as reversible	Y		

Rated heat output ¹⁾	P_{rated}	9.286 [kW]
Seasonal space heating energy efficiency	η_s	193.8 [%]
	SCOP	4.92 [-]

Measured capacity for heating for part load at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	P_{dh}	- [kW]
	-	$T_j = -7\text{ °C}$	P_{dh}	8.17 [kW]
	Low temperature application	$T_j = 2\text{ °C}$	P_{dh}	5.03 [kW]
		$T_j = 7\text{ °C}$	P_{dh}	3.85 [kW]
		$T_j = 12\text{ °C}$	P_{dh}	4.27 [kW]
		$T_j = \text{bivalent temperature}$	P_{dh}	8.17 [kW]
		$T_j = \text{operation limit}$	P_{dh}	9.44 [kW]

Measured coefficient of performance at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	COP_d	- [-]
	-	$T_j = -7\text{ °C}$	COP_d	2.95 [-]
	Low temperature application	$T_j = 2\text{ °C}$	COP_d	4.78 [-]
		$T_j = 7\text{ °C}$	COP_d	6.65 [-]
		$T_j = 12\text{ °C}$	COP_d	8.04 [-]
		$T_j = \text{bivalent temperature}$	COP_d	2.95 [-]
		$T_j = \text{operation limit}$	COP_d	2.63 [-]

Bivalent temperature	$T_{bivalent}$	-7 [°C]
Operation limit temperatures	TOL	-10 [°C]
Degradation coefficient	WTOL	- [°C]
	C_{dh}	0.98 [-]

Power consumption in modes other than active mode	Off mode	P_{OFF}	0.010 [kW]
	Thermostat-off mode	P_{TO}	0.010 [kW]
	Standby mode	P_{SB}	0.010 [kW]
	Crankcase heater mode	P_{CK}	0.010 [kW]
Supplementary heater ¹⁾	Rated heat output	P_{SUP}	0.03 [kW]
	Type of energy input		Electrical

Other items	Capacity control		Variable
	Water flow control		Fixed
	Water flow rate		-
	Annual energy consumption	Q_{HE}	3899 [kWh]

¹⁾For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated} , is equal to the design load for heating, $P_{designh}$, and the rated heat output of a supplementary heater, P_{sup} , is equal to the supplementary capacity for heating, $sup(T_j)$.

²⁾For SCOP calculation the value $P_{CK} - P_{SB}$ is used. See section "SCOP - detailed calculation"





Test results of SCOP test at medium temperature - heating season average (A) – EN 14825:2022

Model (Outdoor)	PASRW040-BP-PS-D
Air-to-water heat pump mono bloc	Y
Low-temperature heat pump	N
Equipped with supplementary heater	N
Heat pump combination heater	N
SCOP calculation done as reversible	Y

Rated heat output ¹⁾	P_{rated}	9.235 [kW]
Seasonal space heating energy efficiency	η_s	143.8 [%]
	SCOP	3.67 [-]

Measured capacity for heating for part load at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	P_{dh}	- [kW]
	-	$T_j = -7\text{ °C}$	P_{dh}	8.00 [kW]
	Low temperature application	$T_j = 2\text{ °C}$	P_{dh}	4.90 [kW]
		$T_j = 7\text{ °C}$	P_{dh}	4.47 [kW]
		$T_j = 12\text{ °C}$	P_{dh}	5.20 [kW]
		$T_j = \text{bivalent temperature}$	P_{dh}	8.00 [kW]
		$T_j = \text{operation limit}$	P_{dh}	8.70 [kW]

Measured coefficient of performance at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	COPd	- [-]
	-	$T_j = -7\text{ °C}$	COPd	2.21 [-]
	Low temperature application	$T_j = 2\text{ °C}$	COPd	3.64 [-]
		$T_j = 7\text{ °C}$	COPd	4.66 [-]
		$T_j = 12\text{ °C}$	COPd	6.38 [-]
		$T_j = \text{bivalent temperature}$	COPd	2.21 [-]
		$T_j = \text{operation limit}$	COPd	1.94 [-]

Bivalent temperature	$T_{bivalent}$	-7 [°C]
Operation limit	TOL	-10 [°C]
temperatures	WTOL	- [°C]
Degradation coefficient	C_{dh}	0.99 [-]

Power consumption in modes other than active mode	Off mode	P_{OFF}	0.010 [kW]
	Thermostat-off mode	P_{TO}	0.010 [kW]
	Standby mode	P_{SB}	0.010 [kW]
	Crankcase heater mode	P_{CK}	0.010 [kW]
Supplementary heater ¹⁾	Rated heat output	P_{SUP}	0.54 [kW]
	Type of energy input		Electrical

Other items	Capacity control		Variable
	Water flow control		Fixed
	Water flow rate		-
	Annual energy consumption	Q_{HE}	5200 [kWh]

¹⁾ For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated} , is equal to the design load for heating, $P_{designh}$, and the rated heat output of a supplementary heater, P_{sup} , is equal to the supplementary capacity for heating, $sup(T_j)$.

²⁾ For SCOP calculation the value $P_{CK} - P_{SB}$ is used. See section "SCOP - detailed calculation"






Test results for sound power measurements – EN 12102-1

N [#]	Test conditions	Sound power level LW(A) [dB re 1pW]	Uncertainty σ_{tot} [dB]
1 ^E	A7/W55	53.4	1.6
2 ^S	A7/W55	58.1	1.8

E) ErP labelling
S) ErP labelling

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz. For the calculation of uncertainty, see Appendix 1.

The sound power measurements are carried out by Kamalathasan Arumugam (KAMA) and co-read by Patrick Glibert (PGL), Danish Technological Institute.





Appendix 2 Brand name

Authorization Letter

This declaration of conformity is issued under the sole responsibility of

Manufacturer's Name: Guangdong PHNIX ECO-Energy Solution LTD

Manufacturer's Address: No. 3 Tianyuan Road, Dagang Town, Nansha District
Guangzhou Guangdong, 511470 China

We declare that the following Heat pump product we produced for COOPER
AND HUNTER OVERSEAS LP are identical to our following models

Cooper&Hunter model	CH-HP15UIMPZM
PHNIX model	PASRW040S-BP-PS-D

Cooper&Hunter company name: COOPER AND HUNTER OVERSEAS LP

Cooper&Hunter brand /-mark: Cooper&Hunter

Cooper&Hunter address: SUITE 201, 45B WEST WILMOT STREET,
RICHMOND HILL, ON L4B2P3 CANADA

Note: This declaration becomes invalid if technical or operational modifications
are introduced without the manufacturer's consent.

Date: 24 May 2024

Authorised party: Guangdong PHNIX ECO-Energy Solution LTD

For and on behalf of
GUANGDONG PHNIX ECO-ENERGY SOLUTION LTD.
广东芬尼克节能设备有限公司

Ivan Chan

Authorized Signature(s)



TEST REPORT

Report no.:
300-KLAB-24-004-1



**DANISH
TECHNOLOGICAL
INSTITUTE**

Teknologiparken
Kongsvang Allé 29
DK-8000 Aarhus C
+45 72 20 20 00
Info@teknologisk.dk
www.teknologisk.dk

Page 1 of 35
Init: PRES/KAMA/AAS
File no.: 265639
Enclosures: 2

Customer: Company: Guangdong PHNIX ECO-Energy Solution LTD
Address: No. 3 Tianyuan Road, Dagang Town, Nansha District
City: Guangzhou Guangdong, 511470 China
Tel.: +86 020-39067523

Component: Brand: PHNIX
Type: Air-to-water heat pump (mono bloc)
Model: Unit: PASRW040S-BP-PS-D
Series no.: Unit: B102302220041
Batch No: Unit: 0000046688
Prod. year: Unit: 22nd February 2023

Dates: Component tested: February-April 2024

Brand name: Brand: Cooper&Hunter
Type: Air-to-water heat pump (mono bloc)
Model: CH-HP15UIMPZM

Procedure: See objective (page 2) for list of standards.

Remarks: The unit was delivered by the customer. The installation and test settings were done according to the manufacturer's instructions. All tests are done with enabled defrost mode. The report for the tested unit is named 300-KLAB-24-004 issued 2024.06.03 - Also see appendix 2.

Terms: This test was conducted under accreditation in accordance with international requirements (ISO/IEC 17025:2017) and in accordance with the General Terms and Conditions of Danish Technological Institute. The test results solely apply to the tested item. This test report may be quoted in extract only if Danish Technological Institute has granted its written consent.

The customer may not mention or refer to Danish Technological Institute or Danish Technological Institute's employees for advertising or marketing purposes unless Danish Technological Institute has granted its written consent in each case.

Division/Centre: Danish Technological Institute
Energy and Climate
Heat Pump Laboratory, Aarhus

Date: 2024.07.09

Signature:
Preben Eskerod
B. TecMan & MarEng

Co-reader:
Kamalathasan Arumugam
B.Sc. Engineer



Test Reg. nr. 300



Objective

The objective of this report is to document the following:

The Seasonal Coefficient of Performance (SCOP) at low and medium temperature application for average climate according to EN 14825:2022. In order to calculate the SCOP, tests were carried out at the part load conditions stated in the tables on page 4 and 5.

COP test standard rating conditions A7/W35 and A7/W55 according to EN 14511:2022.

Operating requirements according to EN 14511-4:2022:

- 4.2.1 Starting and operating tests
- 4.5 Shutting of the heat transfer medium flows
- 4.6 Complete power supply failure.

Sound power measurements according to EN 12102-1:2022.





Contents:

Test conditions	4
SCOP test conditions for low temperature – EN 14825:2022.....	4
SCOP test conditions for medium temperature – EN 14825:2022	5
Test conditions for standard rating condition - EN14511:2022	6
Test conditions for operating requirements – EN 14511-4	6
Test conditions for shutting off the heat transfer medium – EN 14511-4	6
Test conditions for complete power supply failure – EN 14511-4	7
Test conditions for sound power measurements – EN 12102-1	7
Test results.....	8
Test results of SCOP test at low temperature - heating season average (A) – EN 14825:2022	8
Test results of SCOP test at medium temperature - heating season average (A) – EN 14825:2022.....	9
Test results of standard rating test – EN 14511:2022	10
Test results for starting and operating test - EN 14511-4	10
Test results for shutting off the heat transfer medium – EN 14511-4	10
Test results for complete power supply failure – EN 14511-4.....	10
Test results for sound power measurements – EN 12102-1	11
Photo	12
SCOP - detailed calculation	13
Detailed SCOP calculation of low temperature and average climate conditions – EN 14825:2022	13
Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825:2022 .	15
Detailed test results	17
Detailed SCOP test results - low temperature application and average climate – EN 14825:2022	17
Detailed SCOP test results - medium temperature application and average climate – EN 14825:2022.	22
Test results of standard rating condition - EN14511:2022	27
Detailed test results of sound power measurement – Test N#1	29
Detailed test results of sound power measurement – Test N#2	30
Appendix 1 Acoustic test chamber	31
Appendix 2 Brand name.....	35



Test conditions

SCOP test conditions for low temperature – EN 14825:2022

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for low temperature application for the reference heating season;

“A” = average, “W” = warmer, and “C” = colder.

Condition	Part Load Ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Inlet dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	A	W	C	Outdoor air	Exhaust air	All climates	A	W	C
A	$(-7 - 16) / (T_{\text{designh}} - 16)$	88	n/a	61	-7(-8)	20(12)	^a / 35	^a / 34	n/a	^a / 30
B	$(+2 - 16) / (T_{\text{designh}} - 16)$	54	100	37	2(1)	20(12)	^a / 35	^a / 30	^a / 35	^a / 27
C	$(+7 - 16) / (T_{\text{designh}} - 16)$	35	64	24	7(6)	20(12)	^a / 35	^a / 27	^a / 31	^a / 25
D	$(+12 - 16) / (T_{\text{designh}} - 16)$	15	29	11	12(11)	20(12)	^a / 35	^a / 24	^a / 26	^a / 24
E	$(TOL - 16) / (T_{\text{designh}} - 16)$				TOL	20(12)	^a / 35	^a / b	^a / b	^a / b
F	$(T_{\text{bivalent}} - 16) / (T_{\text{designh}} - 16)$				T _{bivalent}	20(12)	^a / 35	^a / c	^a / c	^a / c
G	$(-15 - 16) / (T_{\text{designh}} - 16)$	n/a	n/a	82	-15	20(12)	^a / 35	n/a	n/a	^a / 32

^a With the water flow rate as determined at the standard rating conditions given in EN 14511-2 at 30/35 conditions for units with a fixed water flow rate, and with a fixed delta T of 5 K for units with a variable flow rate. If the resulting flow rate is below the minimum flow rate then this minimum flow rate is used with the outlet temperature.

^b Variable outlet shall be calculated by interpolation from T_{designh} and the temperature which is closest to the TOL.

^c Variable outlet shall be calculated by interpolation between the upper and lower temperatures which are closest to the bivalent temperature.

^d If the variable outlet temperature is below the minimum of the operation range of the unit, this minimum should be considered.

Additional information

Climate	T _{designh} [°C]	T _{bivalent} [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Fixed





SCOP test conditions for medium temperature – EN 14825:2022

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for medium temperature application for the reference heating season;

“A” = average, “W” = warmer, and “C” = colder.

Condition	Part Load Ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Inlet dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	A	W	C	Outdoor air	Exhaust air	All climates	A	W	C
A	$(-7 - 16) / (T_{\text{designh}} - 16)$	88	n/a	61	-7(-8)	20(12)	^a / 55	^a / 52	n/a	^a / 44
B	$(+2 - 16) / (T_{\text{designh}} - 16)$	54	100	37	2(1)	20(12)	^a / 55	^a / 42	^a / 55	^a / 37
C	$(+7 - 16) / (T_{\text{designh}} - 16)$	35	64	24	7(6)	20(12)	^a / 55	^a / 36	^a / 46	^a / 32
D	$(+12 - 16) / (T_{\text{designh}} - 16)$	15	29	11	12(11)	20(12)	^a / 55	^a / 30	^a / 34	^a / 28
E	$(\text{TOL} - 16) / (T_{\text{designh}} - 16)$				TOL	20(12)	^a / 55	^a / ^b	^a / ^b	^a / ^b
F	$(T_{\text{bivalent}} - 16) / (T_{\text{designh}} - 16)$				T_{bivalent}	20(12)	^a / 55	^a / ^c	^a / ^c	^a / ^c
G	$(-15 - 16) / (T_{\text{designh}} - 16)$	n/a	n/a	82	-15	20(12)	^a / 55	n/a	n/a	^a / 49

^a With the water flow rate as determined at the standard rating conditions given in EN 14511-2 at 47/55 conditions for units with a fixed water flow rate, and with a fixed delta T of 8 K for units with a variable flow rate. If the resulting flow rate is below the minimum flow rate then this minimum flow rate is used with the outlet temperature.

^b Variable outlet shall be calculated by interpolation T_{designh} and the temperature which is closest to the TOL.

^c Variable outlet shall be calculated by interpolation between the upper and lower temperatures which are closest to the bivalent temperature.

^d If the variable outlet temperature is below the minimum of the operation range of the unit, this minimum should be considered.

Additional information

Climate	T_{designh} [°C]	T_{bivalent} [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Fixed



Test conditions for standard rating condition - EN14511:2022

N#	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1	7	6	30	35
2	7	6	47	55

Test conditions for operating requirements – EN 14511-4

N#	Heat source		Heat sink	Water flow rate at indoor heat exchanger	Test
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)		
1	-25	-	9	850 L/h	Starting
2	-25	-	60	850 L/h	Operating

Test conditions for shutting off the heat transfer medium – EN 14511-4

N#	Heat source		Heat sink		Heat exchanger
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)	
1	7	6	30	35	Indoor
2	7	6	30	35	Outdoor



Test conditions for complete power supply failure – EN 14511-4

N#	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1	7	6	30	35

Test conditions for sound power measurements – EN 12102-1

N#	Test condition		Heat pump setting			
	Outdoor heat exchanger (dry bulb/wet bulb) (°C)	Indoor heat exchanger (inlet/outlet) (°C)	Compressor speed (Hz)	Fan speed outdoor (rpm)	Heating capacity (kW)	Power input (kW)
1 ^E	7/6	47/55	28	400	4.52	1.55
2 ^S	7/6	47/55	60	400	9.60	3.16

E) ErP labelling

S) Standard rating condition



Test results

Test results of SCOP test at low temperature - heating season average (A) – EN 14825:2022

Model (Outdoor)	PASRW040-BP-PS-D
Air-to-water heat pump mono bloc	Y
Low-temperature heat pump	N
Equipped with supplementary heater	N
Heat pump combination heater	N
SCOP calculation done as reversible	Y

Rated heat output¹⁾	P_{rated}	9.286 [kW]
Seasonal space heating energy efficiency	η_{s}	193.8 [%]
	SCOP	4.92 [-]

Measured capacity for heating for part load at outdoor temperature T_j	Average Climate - Low temperature application	$T_j = -15\text{ °C}$	P_{dh}	- [kW]
		$T_j = -7\text{ °C}$	P_{dh}	8.17 [kW]
		$T_j = 2\text{ °C}$	P_{dh}	5.03 [kW]
		$T_j = 7\text{ °C}$	P_{dh}	3.85 [kW]
		$T_j = 12\text{ °C}$	P_{dh}	4.27 [kW]
		$T_j = \text{bivalent temperature}$	P_{dh}	8.17 [kW]
		$T_j = \text{operation limit}$	P_{dh}	9.44 [kW]

Measured coefficient of performance at outdoor temperature T_j	Average Climate - Low temperature application	$T_j = -15\text{ °C}$	COP _d	- [-]
		$T_j = -7\text{ °C}$	COP _d	2.95 [-]
		$T_j = 2\text{ °C}$	COP _d	4.78 [-]
		$T_j = 7\text{ °C}$	COP _d	6.65 [-]
		$T_j = 12\text{ °C}$	COP _d	8.04 [-]
		$T_j = \text{bivalent temperature}$	COP _d	2.95 [-]
		$T_j = \text{operation limit}$	COP _d	2.63 [-]

Bivalent temperature	T _{bivalent}	-7 [°C]
Operation limit temperatures	TOL	-10 [°C]
Degradation coefficient	C _{dh}	0.98 [-]

Power consumption in modes other than active mode	Off mode	P_{OFF}	0.010 [kW]
	Thermostat-off mode	P_{TO}	0.010 [kW]
	Standby mode	P_{SB}	0.010 [kW]
	Crankcase heater mode	P_{CK}	0.010 [kW]
Supplementary heater¹⁾	Rated heat output	P_{SUP}	0.03 [kW]
	Type of energy input		Electrical

Other items	Capacity control		Variable
	Water flow control		Fixed
	Water flow rate		-
	Annual energy consumption	Q_{HE}	3899 [kWh]

¹⁾For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated} , is equal to the design load for heating, $P_{design,h}$, and the rated heat output of a supplementary heater, P_{sup} , is equal to the supplementary capacity for heating, $sup(T_j)$.

²⁾For SCOP calculation the value $P_{CK} - P_{SB}$ is used. See section "SCOP - detailed calculation"



Test results of SCOP test at medium temperature - heating season average (A) – EN 14825:2022

Model (Outdoor)	PASRW040-BP-PS-D
Air-to-water heat pump mono bloc	Y
Low-temperature heat pump	N
Equipped with supplementary heater	N
Heat pump combination heater	N
SCOP calculation done as reversible	Y

Rated heat output¹⁾	P_{rated}	9.235 [kW]
Seasonal space heating energy efficiency	η_s	143.8 [%]
	SCOP	3.67 [-]

Measured capacity for heating for part load at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	P_{dh}	- [kW]
	-	$T_j = -7\text{ °C}$	P_{dh}	8.00 [kW]
	Low temperature application	$T_j = 2\text{ °C}$	P_{dh}	4.90 [kW]
		$T_j = 7\text{ °C}$	P_{dh}	4.47 [kW]
		$T_j = 12\text{ °C}$	P_{dh}	5.20 [kW]
		$T_j = \text{bivalent temperature}$	P_{dh}	8.00 [kW]
		$T_j = \text{operation limit}$	P_{dh}	8.70 [kW]

Measured coefficient of performance at outdoor temperature T_j	Average Climate	$T_j = -15\text{ °C}$	COPd	- [-]
	-	$T_j = -7\text{ °C}$	COPd	2.21 [-]
	Low temperature application	$T_j = 2\text{ °C}$	COPd	3.64 [-]
		$T_j = 7\text{ °C}$	COPd	4.66 [-]
		$T_j = 12\text{ °C}$	COPd	6.38 [-]
		$T_j = \text{bivalent temperature}$	COPd	2.21 [-]
		$T_j = \text{operation limit}$	COPd	1.94 [-]

Bivalent temperature	$T_{bivalent}$	-7 [°C]
Operation limit temperatures	TOL	-10 [°C]
Degradation coefficient	WTOL	- [°C]
	C_{dh}	0.99 [-]

Power consumption in modes other than active mode	Off mode	P_{OFF}	0.010 [kW]
	Thermostat-off mode	P_{TO}	0.010 [kW]
	Standby mode	P_{SB}	0.010 [kW]
	Crankcase heater mode	P_{CK}	0.010 [kW]
Supplementary heater¹⁾	Rated heat output	P_{SUP}	0.54 [kW]
	Type of energy input		Electrical

Other items	Capacity control		Variable
	Water flow control		Fixed
	Water flow rate		-
	Annual energy consumption	Q_{HE}	5200 [kWh]

¹⁾For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated} , is equal to the design load for heating, $P_{designh}$, and the rated heat output of a supplementary heater, P_{sup} , is equal to the supplementary capacity for heating, $sup(T_j)$.

²⁾ For SCOP calculation the value PCK - PSB is used. See section "SCOP - detailed calculation"



Test results of standard rating test – EN 14511:2022

N#	Test conditions	Heating capacity [kW]	COP
1	A7/W35	8.383	3.960
2	A7/W55	9.604	3.042

Test results for starting and operating test - EN 14511-4

N#	Test conditions air/water inlet [°C]	Test validation
Starting	A-25/W9	Passed
Operating	A-25/W60	Passed

Test results for shutting off the heat transfer medium – EN 14511-4

N#	Heat exchanger	Test validation
1	Indoor	Passed
2	Outdoor	Passed

Test results for complete power supply failure – EN 14511-4

N#	Test validation
1	Passed



Test results for sound power measurements – EN 12102-1

N [#]	Test conditions	Sound power level LW(A) [dB re 1pW]	Uncertainty σ_{tot} [dB]
1 ^E	A7/W55	53.4	1.6
2 ^S	A7/W55	58.1	1.8

E) ErP labelling
S) ErP labelling

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz. For the calculation of uncertainty, see Appendix 1.

The sound power measurements are carried out by Kamalathasan Arumugam (KAMA) and co-read by Patrick Glibert (PGL), Danish Technological Institute.



Photo

Rating plate

INTELLIGENT INVERTER HEAT PUMP	
MODEL	PASRW040S-BP-PS-D
RATED VOLTAGE/FREQUENCY	380-415V/3N~/50Hz
MOISTURE RESISTANCE	IPX4
ELECTRICAL SHOCKPROOF	I
HEATING CAPACITY(A)	5.40~14.95 kW
HEATING POWER INPUT(A)	1.05~3.85 kW
COOLING CAPACITY(B)	3.60~10.50 kW
COOLING POWER INPUT(B)	1.12~4.47 kW
HOT WATER CAPACITY(C)	6.50~18.50 kW
HOT WATER POWER INPUT(C)	1.27~4.65 kW
*RATED POWER INPUT	5.30 kW
*RATED CURRENT INPUT	10.5 A
WATER HEAD	5.5 m
WATER FLOW	1.7 m ³ /h
WATER PIPE OUTLET/INLET	1 Inch
REFRIGERANT/ PROPER CHARGE	R290/0.85 kg
CO ₂ EQUIVALENT	0.0026 T
NOISE	39~52 dB(A)
NET WEIGHT	160 kg
OPERATION PRESSURE(LOW SIDE)	0.8 MPa
OPERATION PRESSURE(HIGH SIDE)	3.0 MPa
MAXIMUM ALLOWABLE PRESSURE	3.0 MPa
FACTORY NUMBER(ON THE BAR CODE)	
MANUFACTURED DATE(ON THE BAR CODE)	
A: AMBIENT TEMP.(DB/WB): 7°C/6°C, WATER TEMP.(IN/OUT):30°C/35°C	
B: AMBIENT TEMP.(DB/WB): 35°C/24°C, WATER TEMP.(IN/OUT):12°C/7°C	
C: AMBIENT TEMP.(DB/WB): 20°C/15°C, WATER TANK TEMPERATURE FROM 15°C TO 55°C	
*According to IEC/EN 60335-1	
Model:	PASRW040S-BP-PS-D
Product Code:	13110142
Batch No.:	0000046688
Serial No.:	B102302220041

Unit





SCOP - detailed calculation

Detailed SCOP calculation of low temperature and average climate conditions – EN 14825:2022

Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{\frac{P_{designh} \times H_{he}}{SCOP_{on}} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} =

Heating load of the building at design temperature, kW

H_{he} =

Number of equivalent heating hours, 2066 h

H_{TO} , H_{SB} , H_{CK} , H_{OFF} =

Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

P_{TO} , P_{SB} , P_{CK} , P_{OFF} =

Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COPbin [-]
A	-7	88	8.21	8.17	2.95	1.00	1.00	2.95
B	2	54	5.00	5.03	4.78	0.99	1.00	4.78
C	7	35	3.21	3.85	6.65	0.98	0.84	6.63
D	12	15	1.43	4.27	8.04	0.98	0.33	7.75
E	-10	100	9.29	9.44	2.63	1.00	1.00	2.63
F - BIV	-7	88	8.21	8.17	2.95	1.00	1.00	2.95

Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.01	0.01	0
Thermostat off	178	0.01	0.01	1.78
Standby	0	0.01	0.01	0
Crankcase heater	178	0.01	0	0



Calculation Bin for SCOPon

	Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	Annual backup heater energy input [kWh]	COPbin [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
E	21	-10	1	9.29	9.29	0.00	0.00	2.63	9.29	3.53	9.29	3.53
	22	-9	25	8.93	8.91	0.02	0.38	2.74	223.22	81.82	222.84	81.44
	23	-8	23	8.57	8.54	0.03	0.70	2.84	197.15	69.76	196.45	69.06
A / F - BIV	24	-7	24	8.21	8.17	0.00	0.00	2.95	197.15	66.76	197.15	66.76
	25	-6	27	7.86	7.81	0.00	0.00	3.09	212.15	68.68	212.15	68.68
	26	-5	68	7.50	7.45	0.00	0.00	3.22	510.02	158.17	510.02	158.17
	27	-4	91	7.14	7.09	0.00	0.00	3.36	650.02	193.46	650.02	193.46
	28	-3	89	6.79	6.73	0.00	0.00	3.50	603.95	172.77	603.95	172.77
	29	-2	165	6.43	6.37	0.00	0.00	3.63	1060.75	292.12	1060.75	292.12
	30	-1	173	6.07	6.01	0.00	0.00	3.77	1050.39	278.85	1050.39	278.85
	31	0	240	5.71	5.65	0.00	0.00	3.90	1371.47	351.44	1371.47	351.44
	32	1	280	5.36	5.29	0.00	0.00	4.04	1500.05	371.48	1500.05	371.48
	B	33	2	320	5.00	4.93	0.00	0.00	4.17	1600.05	383.37	1600.05
34		3	357	4.64	4.59	0.00	0.00	4.66	1657.55	355.36	1657.55	355.36
35		4	356	4.29	4.24	0.00	0.00	5.16	1525.76	295.97	1525.76	295.97
36		5	303	3.93	3.90	0.00	0.00	5.65	1190.39	210.84	1190.39	210.84
37		6	330	3.57	3.56	0.00	0.00	6.14	1178.61	192.06	1178.61	192.06
C	38	7	326	3.21	3.21	0.00	0.00	6.63	1047.89	158.11	1047.89	158.11
	39	8	348	2.86	2.86	0.00	0.00	6.85	994.32	145.10	994.32	145.10
	40	9	335	2.50	2.50	0.00	0.00	7.08	837.53	118.33	837.53	118.33
	41	10	315	2.14	2.14	0.00	0.00	7.30	675.02	92.42	675.02	92.42
	42	11	215	1.79	1.79	0.00	0.00	7.53	383.94	51.00	383.94	51.00
D	43	12	169	1.43	1.43	0.00	0.00	7.75	241.44	31.14	241.44	31.14
	44	13	151	1.07	1.07	0.00	0.00	7.98	161.79	20.28	161.79	20.28
	45	14	105	0.71	0.71	0.00	0.00	8.20	75.00	9.14	75.00	9.14
	46	15	74	0.36	0.36	0.00	0.00	8.43	26.43	3.14	26.43	3.14

SUM	19181.30	4175.08	19180.23	4174.00
SCOPon		4.59	SCOPnet	4.60



Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825:2022

Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{\frac{P_{designh} \times H_{he}}{SCOP_{on}} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} = Heating load of the building at design temperature, kW
 H_{he} = Number of equivalent heating hours, 2066 h
 $H_{TO}, H_{SB}, H_{CK}, H_{OFF}$ = Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

$P_{TO}, P_{SB}, P_{CK}, P_{OFF}$ = Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COP _{bin} [-]
A	-7	88	8.17	8.00	2.21	1.00	1.00	2.21
B	2	54	4.97	4.90	3.64	0.99	1.00	3.64
C	7	35	3.20	4.47	4.66	0.99	0.72	4.64
D	12	15	1.42	5.20	6.38	0.99	0.27	6.17
E	-10	100	9.24	8.70	1.94	1.00	1.00	1.94
F - BIV	-7	88	8.17	8.00	2.21	1.00	1.00	2.21

Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.01	0.01	0
Thermostat off	178	0.01	0.01	1.78
Standby	0	0.01	0.01	0
Crankcase heater	178	0.01	0	0



Calculation Bin for SCOPon

	Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	Annual backup heater energy input [kWh]	COPbin [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
E	21	-10	1	9.24	8.70	0.54	0.54	1.94	9.24	5.02	8.70	4.49
	22	-9	25	8.88	8.47	0.41	10.35	2.03	222.00	114.63	211.65	104.29
	23	-8	23	8.52	8.23	0.29	6.68	2.12	196.07	96.02	189.38	89.33
A / F - BIV	24	-7	24	8.17	8.00	0.00	0.00	2.21	196.07	88.70	196.07	88.70
	25	-6	27	7.81	7.66	0.00	0.00	2.37	210.98	89.05	210.98	89.05
	26	-5	68	7.46	7.31	0.00	0.00	2.53	507.21	200.62	507.21	200.62
	27	-4	91	7.10	6.97	0.00	0.00	2.69	646.45	240.58	646.45	240.58
	28	-3	89	6.75	6.62	0.00	0.00	2.85	600.63	211.05	600.63	211.05
	29	-2	165	6.39	6.28	0.00	0.00	3.00	1054.92	351.08	1054.92	351.08
	30	-1	173	6.04	5.93	0.00	0.00	3.16	1044.62	330.19	1044.62	330.19
	31	0	240	5.68	5.59	0.00	0.00	3.32	1363.94	410.51	1363.94	410.51
	32	1	280	5.33	5.24	0.00	0.00	3.48	1491.81	428.51	1491.81	428.51
	B	33	2	320	4.97	4.90	0.00	0.00	3.64	1591.26	437.13	1591.26
34		3	357	4.62	4.56	0.00	0.00	3.84	1648.45	429.20	1648.45	429.20
35		4	356	4.26	4.22	0.00	0.00	4.04	1517.38	375.47	1517.38	375.47
36		5	303	3.91	3.88	0.00	0.00	4.24	1183.86	279.09	1183.86	279.09
37		6	330	3.55	3.54	0.00	0.00	4.44	1172.13	263.85	1172.13	263.85
C	38	7	326	3.20	3.20	0.00	0.00	4.64	1042.13	224.46	1042.13	224.46
	39	8	348	2.84	2.84	0.00	0.00	4.95	988.86	199.80	988.86	199.80
	40	9	335	2.49	2.49	0.00	0.00	5.26	832.93	158.49	832.93	158.49
	41	10	315	2.13	2.13	0.00	0.00	5.56	671.31	120.71	671.31	120.71
	42	11	215	1.78	1.78	0.00	0.00	5.87	381.83	65.07	381.83	65.07
D	43	12	169	1.42	1.42	0.00	0.00	6.17	240.11	38.89	240.11	38.89
	44	13	151	1.07	1.07	0.00	0.00	6.48	160.90	24.83	160.90	24.83
	45	14	105	0.71	0.71	0.00	0.00	6.79	74.59	10.99	74.59	10.99
	46	15	74	0.36	0.36	0.00	0.00	7.09	26.28	3.71	26.28	3.71
SUM									19075.96	5197.67	19058.39	5180.10
SCOPon									3.67		SCOPnet	3.68



Detailed test results

Detailed S0COP test results - low temperature application and average climate – EN 14825:2022

Detailed result for 'EN14825:2022' Average Low (A and F) A -7 /W34		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Low	
Condition name:	A and F	
Condition temperature:	°C	-7
Part load:	%	88%
Chosen Tivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.29
Heating demand:	kW	8.21
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Transient	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	8.169
COP	-	2.953
Power consumption	kW	2.766
Measured		
Heating capacity	kW	8.216
COP	-	2.912
Power consumption	kW	2.822
During heating		
Air_inlet temperature dry bulb	°C	-7.14
Air temperature wet bulb	°C	-8.19
Water_inlet temperature	°C	29.01
water_outlet temperature	°C	34.19
Water_outlet temperature (Time averaged)	°C	34.19
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	49167
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	47
Calculated Power correction	W	67
Water Flow	m ³ /s	0.000406



Detailed result for 'EN14825:2022' Average Low (B) A 2 /W30		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Low	
Condition name:	B	
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	4.97
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Transient	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	4.930
COP	-	4.174
Power consumption	kW	1.181
Measured		
Heating capacity	kW	4.976
COP	-	3.998
Power consumption	kW	1.245
During heating		
Air_inlet temperature dry bulb	°C	2.04
Air temperature wet bulb	°C	0.97
Water_inlet temperature	°C	27.00
water_outlet temperature	°C	30.13
Water_outlet temperature (Time averaged)	°C	30.13
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	48622
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	46
Calculated Power correction	W	66
Water Flow	m ³ /s	0.000406



Detailed result for 'EN14825:2022' Average Low (C) A 7 /W27		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Low	
Condition name:	C	
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	3.20
CR:	-	0.8
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	3.849
COP	-	6.650
Power consumption	kW	0.579
Measured		
Heating capacity	kW	3.895
COP	-	6.060
Power consumption	kW	0.643
During heating		
Air_inlet temperature dry bulb	°C	7.02
Air temperature wet bulb	°C	5.90
Water_inlet temperature	°C	25.13
water_outlet temperature	°C	27.43
Water_outlet temperature (Time averaged)	°C	27.04
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	47827
Calculated Hydraulic power	W	19
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	46
Calculated Power correction	W	65
Water Flow	m ³ /s	0.000406



Detailed result for 'EN14825:2022' Average Low (D) A 12 /W24		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Low	
Condition name:	D	
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.29
Heating demand:	kW	1.43
CR:	-	0.3
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	4.272
COP	-	8.045
Power consumption	kW	0.531
Measured		
Heating capacity	kW	4.318
COP	-	7.243
Power consumption	kW	0.596
During heating		
Air_inlet temperature dry bulb	°C	12.02
Air temperature wet bulb	°C	10.70
Water_inlet temperature	°C	23.20
water_outlet temperature	°C	25.76
Water_outlet temperature (Time averaged)	°C	24.06
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	47278
Calculated Hydraulic power	W	19
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	46
Calculated Power correction	W	65
Water Flow	m ³ /s	0.000406



Detailed result for 'EN14825:2022' Average Low (E) A -10 /W35		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Low	
Condition name:	E	
Condition temperature:	°C	-10
Part load:	%	100%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.29
Heating demand:	kW	9.29
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Transient	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	9.441
COP	-	2.628
Power consumption	kW	3.593
Measured		
Heating capacity	kW	9.485
COP	-	2.599
Power consumption	kW	3.649
During heating		
Air_inlet temperature dry bulb	°C	-10.00
Air temperature wet bulb	°C	-10.94
Water_inlet temperature	°C	29.00
water_outlet temperature	°C	34.93
Water_outlet temperature (Time averaged)	°C	34.93
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	44161
Calculated Hydraulic power	W	18
Calculated global efficiency	η	0.29
Calculated Capacity correction	W	44
Calculated Power correction	W	62
Water Flow	m ³ /s	0.000406



Detailed SCOP test results - medium temperature application and average climate – EN 14825:2022

Detailed result for 'EN14825:2022' Average Medium (A) A -7 /W52		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Medium	
Condition name:	A	
Condition temperature:	°C	-7
Part load:	%	88%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	8.17
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Transient	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	8.002
COP	-	2.210
Power consumption	kW	3.620
Measured		
Heating capacity	kW	8.049
COP	-	2.185
Power consumption	kW	3.683
During heating		
Air_inlet temperature dry bulb	°C	-7.10
Air temperature wet bulb	°C	-8.22
Water_inlet temperature	°C	44.80
water_outlet temperature	°C	51.86
Water_outlet temperature (Time averaged)	°C	51.86
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	67843
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	47
Calculated Power correction	W	66
Water Flow	m ³ /s	0.000292





Detailed result for 'EN14825:2022' Average Medium (B) A 2 /W42		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Medium	
Condition name:	B	
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	4.97
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	4.898
COP	-	3.640
Power consumption	kW	1.346
Measured		
Heating capacity	kW	4.945
COP	-	3.502
Power consumption	kW	1.412
During heating		
Air_inlet temperature dry bulb	°C	2.03
Air temperature wet bulb	°C	0.89
Water_inlet temperature	°C	37.90
water_outlet temperature	°C	41.99
Water_outlet temperature (Time averaged)	°C	41.99
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	68062
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	47
Calculated Power correction	W	66
Water Flow	m ³ /s	0.000292



Detailed result for 'EN14825:2022' Average Medium (C) A 7 /W36		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:		Average
Temperature application:		Medium
Condition name:		C
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	3.20
CR:	-	0.7
Minimum flow reached:	-	No
Measurement type:		Steady State
Integrated liquid pump:		Yes
Integrated liquid pump able to generate a positive ext. static pressure difference:		Yes
Included corrections (Final result)		
Heating capacity	kW	4.465
COP	-	4.662
Power consumption	kW	0.958
Measured		
Heating capacity	kW	4.512
COP	-	4.405
Power consumption	kW	1.024
During heating		
Air_inlet temperature dry bulb	°C	7.00
Air temperature wet bulb	°C	6.01
Water_inlet temperature	°C	33.44
water_outlet temperature	°C	37.16
Water_outlet temperature (Time averaged)	°C	36.10
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	67851
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	47
Calculated Power correction	W	66
Water Flow	m ³ /s	0.000292



Detailed result for 'EN14825:2022' Average Medium (D) A 12 /W30		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Medium	
Condition name:	D	
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	1.42
CR:	-	0.3
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	5.196
COP	-	6.375
Power consumption	kW	0.815
Measured		
Heating capacity	kW	5.243
COP	-	5.983
Power consumption	kW	0.876
During heating		
Air_inlet temperature dry bulb	°C	12.00
Air temperature wet bulb	°C	11.02
Water_inlet temperature	°C	28.71
water_outlet temperature	°C	33.03
Water_outlet temperature (Time averaged)	°C	29.89
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	67432
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	46
Calculated Power correction	W	66
Water Flow	m ³ /s	0.000292



Detailed result for 'EN14825:2022' Average Medium (E) A -10 /W55		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:	Average	
Temperature application:	Medium	
Condition name:	E	
Condition temperature:	°C	-10
Part load:	%	100%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	9.24
Heating demand:	kW	9.24
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated liquid pump:	Yes	
Integrated liquid pump able to generate a positive ext. static pressure difference:	Yes	
Included corrections (Final result)		
Heating capacity	kW	8.698
COP	-	1.939
Power consumption	kW	4.486
Measured		
Heating capacity	kW	8.750
COP	-	1.918
Power consumption	kW	4.562
During heating		
Air_inlet temperature dry bulb	°C	-9.99
Air temperature wet bulb	°C	-11.19
Water_inlet temperature	°C	47.49
water_outlet temperature	°C	54.76
Water_outlet temperature (Time averaged)	°C	54.76
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	82617
Calculated Hydraulic power	W	24
Calculated global efficiency	η	0.32
Calculated Capacity correction	W	52
Calculated Power correction	W	76
Water Flow	m ³ /s	0.000292



Test results of standard rating condition - EN14511:2022




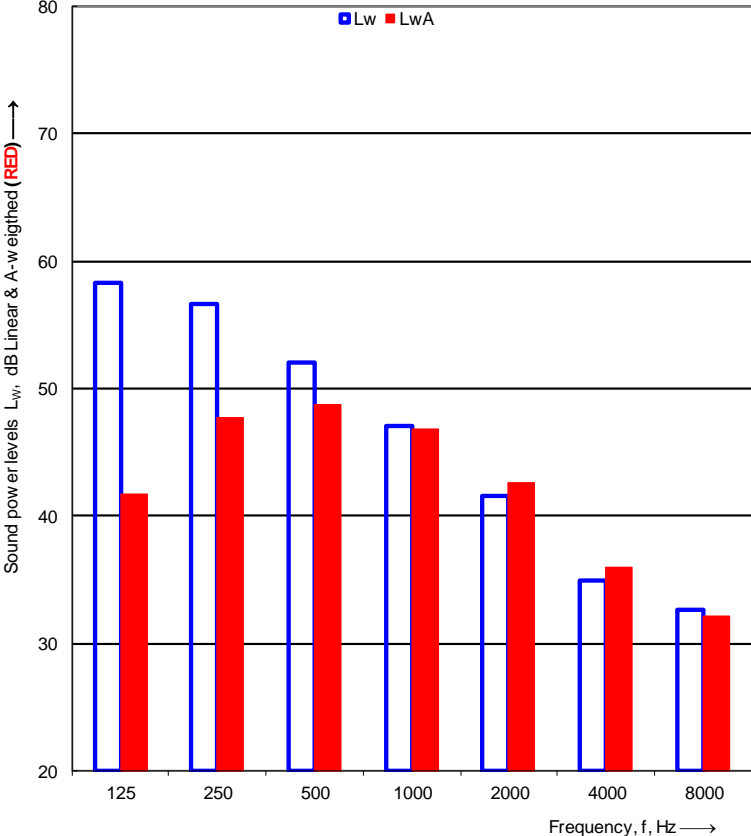
Detailed result for 'EN14511:2022' A7/W35		
Tested according to:		EN14511:2022
Minimum flow reached:		No
Measurement type:		Steady State
Integrated liquid pump:		Yes
Integrated liquid pump able to generate a positive ext. static pressure difference:		Yes
Included corrections (Final result)		
Heating capacity	kW	8.383
COP	-	3.960
Power consumption	kW	2.117
Measured		
Heating capacity	kW	8.428
COP	-	3.863
Power consumption	kW	2.182
During heating		
Air_inlet temperature dry bulb	°C	7.01
Air temperature wet bulb	°C	6.01
Water_inlet temperature	°C	30.00
water_outlet temperature	°C	34.99
Water_outlet temperature (Time averaged)		
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	47046
Calculated Hydraulic power	W	19
Calculated global efficiency	η	0.29
Calculated Capacity correction	W	46
Calculated Power correction	W	65
Water Flow	m ³ /s	0.000407



Detailed result for 'EN14511:2022' A7/W55		
Tested according to:		EN14511:2022
Minimum flow reached:		No
Measurement type:		Steady State
Integrated liquid pump:		Yes
Integrated liquid pump able to generate a positive ext. static pressure difference:		Yes
Included corrections (Final result)		
Heating capacity	kW	9.604
COP	-	3.042
Power consumption	kW	3.158
Measured		
Heating capacity	kW	9.651
COP	-	2.993
Power consumption	kW	3.224
During heating		
Air_inlet temperature dry bulb	°C	6.99
Air temperature wet bulb	°C	5.85
Water_inlet temperature	°C	47.01
water_outlet temperature	°C	55.04
Water_outlet temperature (Time averaged)		
Circulation pump		
Measured external static pressure difference, liquid pump	Pa	68176
Calculated Hydraulic power	W	20
Calculated global efficiency	η	0.30
Calculated Capacity correction	W	47
Calculated Power correction	W	67
Water Flow	m ³ /s	0.000292



Detailed test results of sound power measurement – Test N#1

		<h3>Sound power levels according to ISO 3743-1:2010</h3>																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client: GUANGDONG PHINIX ECO-ENERGY SOLUTION LTD.		Date of test: 27-02-2024																																																																			
Object: Type: Mono air to water heat pump, Model: PASRW040S-BP-PS-D																																																																					
Mounting conditions: The outdoor unit is mounted on the supporting metal support frame using four pieces of spring mounts vibration isolators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop tray on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																					
Operating conditions: A7/W55, Compressor speed: 28[Hz], Fan speed: 400[rpm], Heating capacity: 4.52 [kW], Power input: 1.55 [kW], Water flow rate: 1050 [l/h] and dP_water: 681 [mbar]																																																																					
Static pressure: 1019 hPa		<u>Reference box:</u>																																																																			
Air temperature: 7.0 °C		L1: 1.3 m																																																																			
Relative air humidity: 84.0 %		L2: 0.5 m																																																																			
Test room volume: 102.8 m ³		Room: Room 2																																																																			
Area, S, of test room: 138.9 m ²		L3: 0.9 m																																																																			
		Volume: 0.6 m ³																																																																			
<table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>Frequency f [Hz]</th> <th>L_w 1/3 octave [dB]</th> <th>1/1 oct [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>56.2</td><td></td></tr> <tr><td>125</td><td>51.0</td><td>58.3²</td></tr> <tr><td>160</td><td>51.4</td><td></td></tr> <tr><td>200</td><td>53.1</td><td></td></tr> <tr><td>250</td><td>52.5</td><td>56.6</td></tr> <tr><td>315</td><td>49.0</td><td></td></tr> <tr><td>400</td><td>48.0</td><td></td></tr> <tr><td>500</td><td>47.4</td><td>52.0</td></tr> <tr><td>630</td><td>46.2</td><td></td></tr> <tr><td>800</td><td>44.0</td><td></td></tr> <tr><td>1000</td><td>41.6</td><td>47.1</td></tr> <tr><td>1250</td><td>40.5</td><td></td></tr> <tr><td>1600</td><td>38.9</td><td></td></tr> <tr><td>2000</td><td>36.4</td><td>41.5</td></tr> <tr><td>2500</td><td>33.1</td><td></td></tr> <tr><td>3150</td><td>30.9</td><td></td></tr> <tr><td>4000</td><td>30.5</td><td>34.9</td></tr> <tr><td>5000</td><td>28.8</td><td></td></tr> <tr><td>6300</td><td>31.1</td><td></td></tr> <tr><td>8000</td><td>24.6</td><td>32.6²</td></tr> <tr><td>10000</td><td>23.6</td><td></td></tr> </tbody> </table>	Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	56.2		125	51.0	58.3 ²	160	51.4		200	53.1		250	52.5	56.6	315	49.0		400	48.0		500	47.4	52.0	630	46.2		800	44.0		1000	41.6	47.1	1250	40.5		1600	38.9		2000	36.4	41.5	2500	33.1		3150	30.9		4000	30.5	34.9	5000	28.8		6300	31.1		8000	24.6	32.6 ²	10000	23.6				
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																			
100	56.2																																																																				
125	51.0	58.3 ²																																																																			
160	51.4																																																																				
200	53.1																																																																				
250	52.5	56.6																																																																			
315	49.0																																																																				
400	48.0																																																																				
500	47.4	52.0																																																																			
630	46.2																																																																				
800	44.0																																																																				
1000	41.6	47.1																																																																			
1250	40.5																																																																				
1600	38.9																																																																				
2000	36.4	41.5																																																																			
2500	33.1																																																																				
3150	30.9																																																																				
4000	30.5	34.9																																																																			
5000	28.8																																																																				
6300	31.1																																																																				
8000	24.6	32.6 ²																																																																			
10000	23.6																																																																				
² Correction																																																																					
Sound power level L_w(A): 53.4 dB [re 1pW] Uncertainty σ_{tot}: 1.6 dB																																																																					
Name of test institute: DTI		Date: 27-02-2024																																																																			
No. of test report: 300-KLAB-24-004																																																																					
Measurements are in full conformity with ISO 3743-1																																																																					





Detailed test results of sound power measurement – Test N#2

		Sound power levels according to ISO 3743-1:2010	
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms			
Client:	GUANDONG PHINIX-ENERGY SOLUTION LTD.		Date of test: 27-02-2024
Object:	Type: Mono air to water heat pump, Model: PASRW040S-BP-PS-D		
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using four pieces of spring mounts vibration isolators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop tray on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.		
Operating conditions:	A7/W55, Compressor speed: 60[Hz], Fan speed: 400[rpm], Heating capacity: 9.60 [kW], Power input: 3.16 [kW], Water flow rate: 1050 [l/h] and dP _{water} : 681 [mbar]		
Static pressure:	1019 hPa	<u>Reference box:</u>	
Air temperature:	7.0 °C	L1:	1.3 m
Relative air humidity:	84.0 %	L2:	0.5 m
Test room volume:	102.8 m ³	L3:	0.9 m
Area, S, of test room:	138.9 m ²	Room:	Room 2
		Volume:	0.6 m ³

Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]
100	59.0	
125	63.3	64.8
160	50.0	
200	52.9	
250	61.9	62.8
315	51.7	
400	48.5	
500	48.6	53.3
630	48.6	
800	45.8	
1000	45.1	49.4
1250	42.0	
1600	43.3	
2000	46.6	48.7
2500	38.5	
3150	40.7	
4000	38.4	43.5
5000	35.9	
6300	35.8	
8000	32.3	38.2
10000	30.5	

Sound power level L_w(A):	58.1 dB [re 1pW]	Uncertainty σ_{tot}: 1.8 dB
--	-------------------------	--

Name of test institute:	DTI	Date:	27-02-2024
No. of test report:	300-KLAB-24-004		
Measurements are in full conformity with ISO 3743-1			





Appendix 1 Acoustic test chamber

Unit specification

Type of unit: Mono air-to-water heat pump
Manufacturer: Phnix
Size of the heat pump: 0.5 x 1.3 x 0.9m (W x L x H)
Year of production: 22.02.2023


Operating conditions and environment

The operating conditions of the unit under test fulfill the requirements for Class A.

The acoustic test chamber is a hard wall reverberant room (103 m³) and equipped with relevant sound diffusing reflector panels. The acoustic test chamber fulfills the requirements of ISO3743-1 accuracy grade 2 (engineering grade).

The measurements of the average sound pressure levels in 1/3-octave frequency bands are carried out using three microphones in the test chamber. During the measurements, the microphones are traversed up and down for one meter in the arc of a quarter circle.

The picture below shows the installation of the unit during test, position of microphones, sound diffusing reflector panels, and the reference sound source.

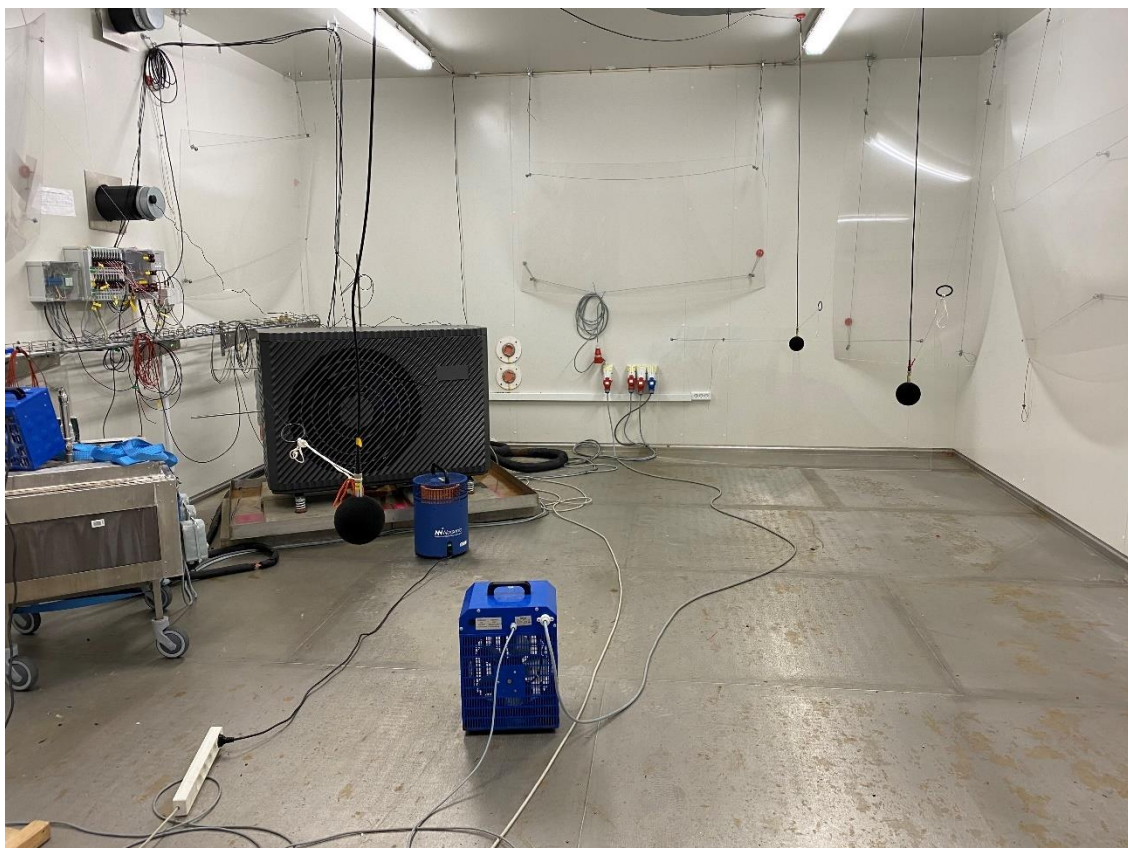



Measurement instruments

Id nr.	Manufacturer	Description	Calibration company
100864	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 1	Norsonic A/S, Norway
100865	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 1	Norsonic A/S, Norway
100866	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 1	Norsonic A/S, Norway
100867*	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 2	Norsonic A/S, Norway
100868*	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 2	Norsonic A/S, Norway
100869*	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Room 2	Norsonic A/S, Norway
100870	GRAS	Gras 40AE_26CA, 1/2" free field microphone, Roof monitor	Norsonic A/S, Norway
100873*	Brüel & Kjær	Acoustical calibrator, Brüel & Kjær 4231	Element Metech, Denmark
100859	Norsonic	Reference sound source, Norsonic Nor278 Room 1	RISE, Sweden
100872*	Norsonic	Reference sound source, Norsonic Nor278 Room 2	RISE, Sweden
100620*	Norsonic	Multi-channel measurement system Nor850	Norsonic A/S, Norway

*Instruments are used for the actual measurements for the calculation of the test results.

The other instruments are used for control measurements.
All microphones are equipped with windshields.



Test Procedure

The measurements of the emitted sound power level from the heat pump are carried out according to the following standards:

- DS/EN 14511:2022
- EN 12102-1:2022
- ISO/EN 3743-1:2010

The basic acoustic measurement standard DS/EN 3743-1 is a comparison method using a calibrated reference sound source. Two series of sound pressure measurements are made under exactly the same acoustic conditions, e.g., the same microphone positions, temperature and air humidity. The calibrated sound power levels are known for the reference sound source at each frequency band, and they are used in the estimation of the acoustical correction factor for the calculation of the sound power emitted from the unit under test. The background noise levels are measured and used for relevant corrections.

The final total A-weighted sound power level is based on measurements and calculations in 1/3-octave levels, which then are summed into 1/1-octave levels. The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz.

The actual microphone positions and correction values are saved in data files linked to the complete project documentation according to the DANAK-accreditation.

The complete measurement system is documented and regularly calibrated according to DANAK.

The detailed description of the measurement method is given in Danish in the quality database system "QA Web" at Danish Technological Institute, which is accessible by DANAK.

Measurement uncertainty

The uncertainty of sound power level in decibel is determined in accordance with ISO 3743-1, equation 22 $\sigma_{tot} = \sqrt{\sigma_{RO}^2 + \sigma_{omc}^2}$ where:

- σ_{RO} is the standard deviation of the reproducibility of the method.
- σ_{omc} is the standard deviation describing the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test.

σ_{RO} expresses the uncertainty in test results delivered by the different accredited test laboratories due to different instrumentation and implementation of measurement procedure as well as different radiation characteristics of the noise source during test.

σ_{omc} expresses the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test. The mounting and installation conditions in two DTI acoustical test chambers are well defined in the test procedure. Possible instability of the operating conditions is monitored and assessed prior to each noise test.





The test uncertainty σ_{omc} is calculated according to ISO3743-1 Annex C formula C.1 and is typically below 1.0dB. However, the uncertainty is rounded up to the nearest 0.5 or 1.0dB increment in the report. As pr. Table C.1 (accuracy grade 2), the uncertainty σ_{RO} is set to 1.5.

The expanded uncertainty U is calculated according to ISO 3743-1 equation 23:
 $U = k \sigma_{tot}$ where $k = 2$ for 95% confidence.

EXAMPLE: $\sigma_{tot}: \sqrt{1.5^2 + 0.5^2} = 1.6 \text{ dB}$ and $U(95\%) = 3.2 \text{ dB}$

Note: The expanded uncertainty does not include the standard deviation of production which is used in ISO4871 for the purpose of making noise declaration for batches of machines.



Appendix 2 Brand name

Authorization Letter

This declaration of conformity is issued under the sole responsibility of

Manufacturer's Name: Guangdong PHNIX ECO-Energy Solution LTD

Manufacturer's Address: No. 3 Tianyuan Road, Dagang Town, Nansha District
Guangzhou Guangdong, 511470 China

We declare that the following Heat pump product we produced for COOPER
AND HUNTER OVERSEAS LP are identical to our following models

Cooper&Hunter model	CH-HP15UIMPZM
PHNIX model	PASRW040S-BP-PS-D

Cooper&Hunter company name: COOPER AND HUNTER OVERSEAS LP

Cooper&Hunter brand /-mark: Cooper&Hunter

Cooper&Hunter address: SUITE 201, 45B WEST WILMOT STREET,
RICHMOND HILL, ON L4B2P3 CANADA

Note: This declaration becomes invalid if technical or operational modifications
are introduced without the manufacturer's consent.

Date: 24 May 2024

Authorised party: Guangdong PHNIX ECO-Energy Solution LTD

For and on behalf of
GUANGDONG PHNIX ECO-ENERGY SOLUTION LTD.
广东芬尼克兹节能设备有限公司

Evan Chan

.....
Authorized Signature(s)



OŚWIADCZENIE

Producent Cooper&Hunter oświadcza, iż pompy ciepła

- 1) CH-HP15UIMPZM
Oznaczenie/typ/identyfikator modelu
- 2) CH-HP09UIMPZK
Oznaczenie/typ/identyfikator modelu
- 3) _____
Oznaczenie/typ/identyfikator modelu
- 4) _____
Oznaczenie/typ/identyfikator modelu
- 5) _____
Oznaczenie/typ/identyfikator modelu

Należą do jednego podtypu w danym typoszeregu i spełniają łącznie następujące warunki:

- identyczna konstrukcja obiegu chłodniczego, ten sam czynnik chłodniczy/roboczy;
- ten sam producent, typ i liczba sprężarek;
- ten sam typ elementu rozprężnego;
- ten sam typ skraplacza;
- ten sam typ parownika;
- ten sam typ procesu odszraniania;
- ten sam sterownik i zasada sterowania wydajnością;
- ten sam producent, typ i liczba wentylatorów parownika (w przypadku powietrznych pomp ciepła) i zasada sterowania wydajnością (stała, zmienna lub stopniowana regulacja prędkości obrotowej);
- urządzenia z i bez zaworu czterodrogowego nie mogą być zaliczone do tego samego typoszeregu.

Warszawa, 26.07.2014.
Miejscowość, data

ERKUL Sp. z o.o.
ul. Beryłowa 7
82-310 Gronowo Górne
NIP 578-315-53-29
KRS 0000980726

Podpis osoby upoważnionej

Marcin Szatkowski