

TEST REPORT

Report no.:
300-KLAB-20-001



**DANISH
TECHNOLOGICAL
INSTITUTE**

Teknologiparken
Kongsvang Allé 29
DK-8000 Aarhus C
+45 72 20 20 00
Info@teknologisk.dk
www.teknologisk.dk

Page 1 of 15
Init: KAMA/BBJN/PRES
File no.: 906648
Enclosures: 0

Customer: Company: Panasonic Marketing Europe GmbH
Address: Hagenauer Strasse 43
City: 65203 Wiesbaden
Tel.: +49 1724 141441

Component: Brand: Panasonic
Type: Air to water heat pump
Model: Outdoor: WH-UD07JE5 Indoor: WH-ADC0309J3E5
Series no.: Outdoor: 5621401261 Indoor: 5704001319
Production year: 2019/2019

Dates: Component tested: January 2020

Procedure: See objective (page 2) for list of standards

Remarks: The unit was delivered by the customer. The installation and test settings were done according to the manufacturer's instructions.

Terms: The test has been performed according to the conditions laid down by DANAK (The Danish Accreditation), cf. www.danak.dk, and the general terms and conditions of Danish Technological Institute. The results from DTI's work in this report, i.e. analyses, assessments and instructions may only be used or reported in their entirety. The customer may not mention or refer to DTI or DTI's employees for advertising or marketing purposes unless DTI has granted its written consent in each case.

Division/Centre: Danish Technological Institute
Energy and Climate
Heat Pump Laboratory, Aarhus

Date: 2020.02.03

Signature:
Kamalathasan Arumugam
B.Sc. Engineer

Co-reader:
Birger Bech Jensen
Senior specialist



 **DANAK**
Test Reg. nr. 300



Objective

The objective of this report is to document the acoustical performance of the outdoor unit with different heat pump settings and setups.

The tests were carried out in following order (test 1-8):

Sound power measurement without any modification of the outdoor unit

1. With free mode at A7/W55
2. With free mode and quiet mode 3 at A7/W55

Sound power measurement with a soundproof kit mounted in the outdoor unit (in order to mount the soundproof kit, the enclosure materials of the compressor from the factory must be removed)

3. With free mode at A7/W55
4. With free mode and quiet mode 3 at A7/W55

Sound power measurement after removing the soundproof kit from the outdoor unit and the enclosure materials of the compressor from the factory being restored

5. With free mode at A7/W55
6. With free mode and quiet mode 3 at A7/W55

Sound power measurement with a noise reduction box mounted around the outdoor unit

7. With free mode at A7/W55
8. With free mode and quiet mode 3 at A7/W55

The sound power level of the outdoor unit according to EN 12102:2017 for average climate at the highest temperature application. The measurement of the sound power level is performed using the Class A method. ISO 3743-1 is the basic method of carrying out sound power measurements. The method is briefly described in appendix 1. For a more detailed description, please view the accreditation papers DANAK-300 (in Danish only).





Test order and conditions of sound power test according to EN12102

N°	Test condition		Heat pump setting			
	Outdoor heat exchanger (dry/wet bulb) (°C)	Indoor heat exchanger (inlet/outlet) (°C)	Compressor speed (Hz)	Fan speed Outdoor (rpm)	Heating capacity (kW)	Power input (kW)
1	7/6	47/55	55 - 56	610 - 620	7.0	2.6
2	7/6	47/55	38 - 39	430 - 440	4.7	1.7
3	7/6	47/55	55 - 56	610 - 620	7.0	2.6
4	7/6	47/55	38 - 39	430 - 440	4.7	1.7
5	7/6	47/55	55 - 56	610 - 620	7.0	2.6
6	7/6	47/55	38 - 39	430 - 440	4.7	1.7
7	7/6	47/55	55 - 56	610 - 620	6.95	2.6
8	7/6	47/55	38 - 39	430 - 440	4.7	1.7





Test results of sound power test according to EN12102

N°	Sound power level LW(A) [dB re 1pW]	Uncertainty (dB) (weighted value)
1	62.7	0.5
2	61.6	1.0
3	61.5	0.5
4	59.0	1.0
5	62.2	0.5
6	59.6	0.5
7	56.6	0.5
8	54.0	0.5

The uncertainty value is a weighted value using the level and frequency dependant influence for each 1/1-octave level on the final A-weighted sound power level.

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz.






Outdoor unit rating plate



Outdoor unit

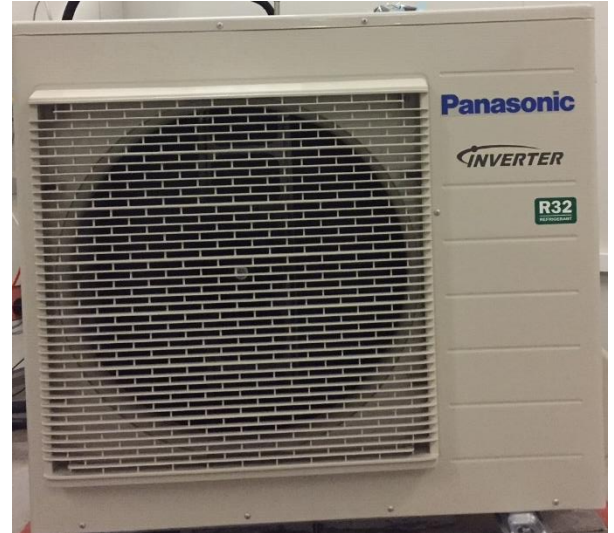



Indoor unit rating plate

Panasonic

AIR-TO-WATER HYDROMODULE + TANK

Model No. WH-ADC0309J3E5

OUTDOOR UNIT WH-UD03JE5
WH-UD05JE5
WH-UD07JE5
WH-UD09JE5

POWER SUPPLY 1 (HEAT PUMP)
RATED VOLTAGE 230V~
RATED FREQUENCY 50Hz

POWER SUPPLY 2 (BACKUP HEATER)
RATED VOLTAGE 230V~
RATED FREQUENCY 50Hz
MAXIMUM POWER 3.00kW
MAXIMUM CURRENT 13.00A

MAX. WORKING PRESSURE MPa (Bar)
- SPACE HEAT/COOL 0.3 (3.0)
- TANK CIRCUIT 0.8 (8.0)

TANK UNIT CAPACITY (NETT) 185L

Panasonic AVC Networks Czech, s.r.o.
U Panasoniku 1, 320 84 Plzeň, Czech Republic
Assembled in the Czech Republic

Authorized representative in EU
Panasonic Testing Centre
Panasonic Marketing Europe GmbH
Winsberggring 15, 22525 Hamburg, Germany

SERIAL NO. **5704001319**

IP21 ACXF09-04700

PRODUCTION DATE 2019.05

CE

R32

IP21




ACXF09-04700

Indoor unit








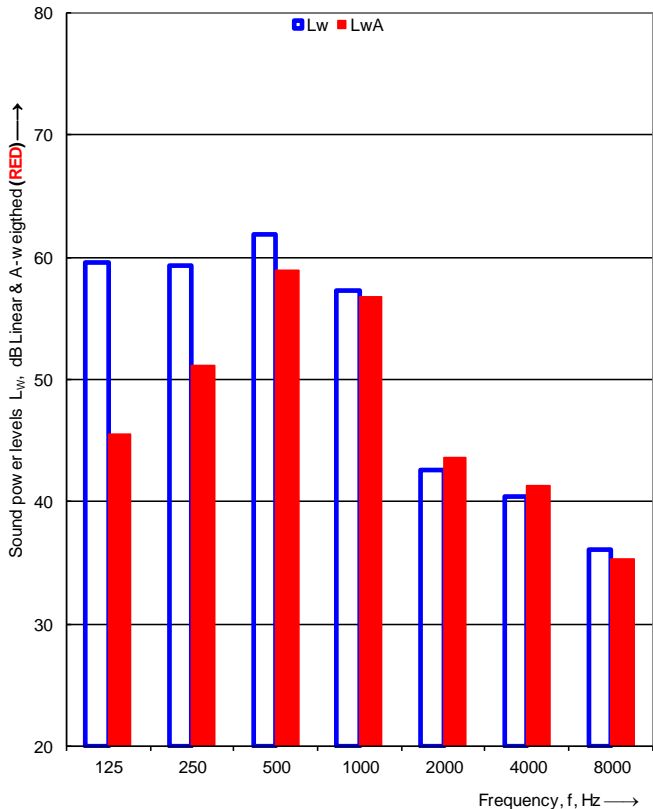
Detailed test results of sound power measurement N° 1

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:	Panasonic Europe GmbH		Date of test: 22-01-2020																																																																				
Object:	Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																						
Mounting conditions:	The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test without any modification of the outdoor unit.																																																																						
Operating conditions:	A7/W55, Compressor speed: 55 - 56 [Hz], Heating capacity: 7.0 [kW], Power_input: 2.6 [kW], Water flow rate: 770 [l/h], Fan_speed : 610 - 620 [rpm], dp_water : 260 [mbar]																																																																						
Static pressure:	1029 kPa			<u>Reference box:</u>																																																																			
Air temperature:	7.0 °C			L1:	0.9 m																																																																		
Relative air humidity:	85.0 %			L2:	0.3 m																																																																		
Test room volume:	102.8 m³	Room:	Room 1	L3:	0.8 m																																																																		
Area, S, of test room:	138.9 m²			Volume:	0.2 m³																																																																		
<table border="1"> <thead> <tr> <th>Frequency f [Hz]</th> <th>L_w 1/3 octave [dB]</th> <th>1/1 oct [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>63.9</td><td></td></tr> <tr><td>125</td><td>62.5</td><td>66.6</td></tr> <tr><td>160</td><td>55.4</td><td></td></tr> <tr><td>200</td><td>56.1</td><td></td></tr> <tr><td>250</td><td>55.5</td><td>60.5</td></tr> <tr><td>315</td><td>55.6</td><td></td></tr> <tr><td>400</td><td>57.6</td><td></td></tr> <tr><td>500</td><td>57.9</td><td>62.7</td></tr> <tr><td>630</td><td>58.3</td><td></td></tr> <tr><td>800</td><td>52.4</td><td></td></tr> <tr><td>1000</td><td>52.3</td><td>56.8</td></tr> <tr><td>1250</td><td>51.3</td><td></td></tr> <tr><td>1600</td><td>47.8</td><td></td></tr> <tr><td>2000</td><td>44.7</td><td>50.3</td></tr> <tr><td>2500</td><td>42.4</td><td></td></tr> <tr><td>3150</td><td>41.6</td><td></td></tr> <tr><td>4000</td><td>42.2</td><td>46.9</td></tr> <tr><td>5000</td><td>42.5</td><td></td></tr> <tr><td>6300</td><td>38.8</td><td></td></tr> <tr><td>8000</td><td>35.7</td><td>41.3</td></tr> <tr><td>10000</td><td>33.4</td><td></td></tr> </tbody> </table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	63.9		125	62.5	66.6	160	55.4		200	56.1		250	55.5	60.5	315	55.6		400	57.6		500	57.9	62.7	630	58.3		800	52.4		1000	52.3	56.8	1250	51.3		1600	47.8		2000	44.7	50.3	2500	42.4		3150	41.6		4000	42.2	46.9	5000	42.5		6300	38.8		8000	35.7	41.3	10000	33.4					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	63.9																																																																						
125	62.5	66.6																																																																					
160	55.4																																																																						
200	56.1																																																																						
250	55.5	60.5																																																																					
315	55.6																																																																						
400	57.6																																																																						
500	57.9	62.7																																																																					
630	58.3																																																																						
800	52.4																																																																						
1000	52.3	56.8																																																																					
1250	51.3																																																																						
1600	47.8																																																																						
2000	44.7	50.3																																																																					
2500	42.4																																																																						
3150	41.6																																																																						
4000	42.2	46.9																																																																					
5000	42.5																																																																						
6300	38.8																																																																						
8000	35.7	41.3																																																																					
10000	33.4																																																																						
¹ Too high																																																																							
Sound power level L_w(A): 62.7 dB [re 1pW]																																																																							
Name of test institute:	DTI																																																																						
No. of test report:	300-KLAB-20-001																																																																						
Date:	22-01-2020																																																																						






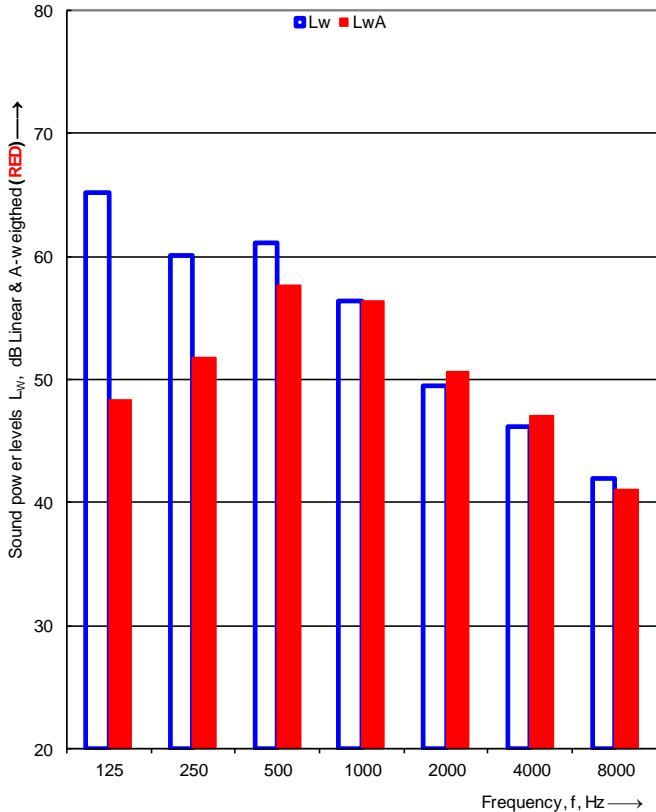


Detailed test results of sound power measurement N° 2

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:		Panasonic Europe GmbH		Date of test: 22-01-2020																																																																			
Object:		Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																					
Mounting conditions:		The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test without any modification of the outdoor unit.																																																																					
Operating conditions:		A7/W55, Quiet mode 3, Compressor speed: 38 - 39 [Hz], Heating capacity: 4.7 [kW], Power_input: 1.7 [kW], Water flow rate: 510 [l/h], Fan_speed : 430 - 440 [rpm], dp_water : 314 [mbar]																																																																					
Static pressure: 1029 kPa		Room: Room 1		Reference box:																																																																			
Air temperature: 7.0 °C				L1: 0.9 m																																																																			
Relative air humidity: 85.0 %				L2: 0.3 m																																																																			
Test room volume: 102.8 m³				L3: 0.8 m																																																																			
Area, S, of test room: 138.9 m²				Volume: 0.2 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>50.7</td><td></td></tr><tr><td>125</td><td>50.2</td><td>59.6</td></tr><tr><td>160</td><td>58.4</td><td></td></tr><tr><td>200</td><td>50.2</td><td></td></tr><tr><td>250</td><td>57.0</td><td>59.3</td></tr><tr><td>315</td><td>53.8</td><td></td></tr><tr><td>400</td><td>58.0</td><td></td></tr><tr><td>500</td><td>51.9</td><td>61.9</td></tr><tr><td>630</td><td>58.8</td><td></td></tr><tr><td>800</td><td>56.3</td><td></td></tr><tr><td>1000</td><td>47.2</td><td>57.2</td></tr><tr><td>1250</td><td>47.1</td><td></td></tr><tr><td>1600</td><td>39.4</td><td></td></tr><tr><td>2000</td><td>38.1</td><td>42.5</td></tr><tr><td>2500</td><td>34.4</td><td></td></tr><tr><td>3150</td><td>34.3</td><td></td></tr><tr><td>4000</td><td>36.2</td><td>40.4</td></tr><tr><td>5000</td><td>36.2</td><td></td></tr><tr><td>6300</td><td>33.2</td><td></td></tr><tr><td>8000</td><td>31.3</td><td>36.0</td></tr><tr><td>10000</td><td>27.5</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	50.7		125	50.2	59.6	160	58.4		200	50.2		250	57.0	59.3	315	53.8		400	58.0		500	51.9	61.9	630	58.8		800	56.3		1000	47.2	57.2	1250	47.1		1600	39.4		2000	38.1	42.5	2500	34.4		3150	34.3		4000	36.2	40.4	5000	36.2		6300	33.2		8000	31.3	36.0	10000	27.5					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	50.7																																																																						
125	50.2	59.6																																																																					
160	58.4																																																																						
200	50.2																																																																						
250	57.0	59.3																																																																					
315	53.8																																																																						
400	58.0																																																																						
500	51.9	61.9																																																																					
630	58.8																																																																						
800	56.3																																																																						
1000	47.2	57.2																																																																					
1250	47.1																																																																						
1600	39.4																																																																						
2000	38.1	42.5																																																																					
2500	34.4																																																																						
3150	34.3																																																																						
4000	36.2	40.4																																																																					
5000	36.2																																																																						
6300	33.2																																																																						
8000	31.3	36.0																																																																					
10000	27.5																																																																						
1 Too high																																																																							
Sound power level L_w(A): 61.6 dB [re 1pW]																																																																							
Name of test institute:		DTI																																																																					
No. of test report:		300-KLAB-20-001																																																																					
Date:		22-01-2020																																																																					




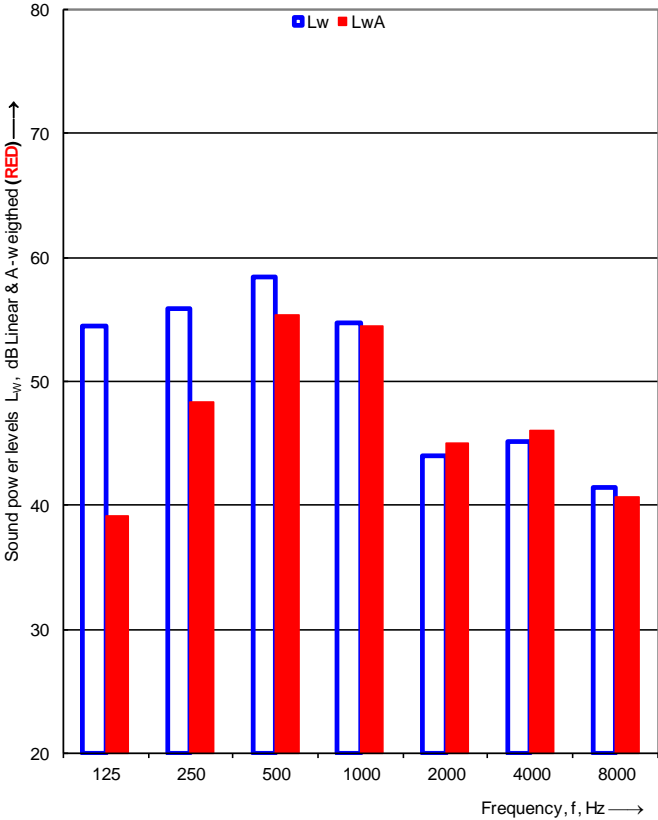


Detailed test results of sound power measurement N° 3

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:		Panasonic Europe GmbH		Date of test: 24-01-2020																																																																			
Object:		Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																					
Mounting conditions:		The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test with a soundproof kit mounted in the outdoor unit.																																																																					
Operating conditions:		A7/W55, Compressor speed: 55 - 56 [Hz], Heating capacity: 6.9 [kW], Power_input: 2.6 [kW], Water flow rate: 760 [l/h], Fan_speed: 610 - 620 [rpm], dp_water: 260 [mbar]																																																																					
Static pressure:		1029 kPa		<u>Reference box:</u>																																																																			
Air temperature:		7.0 °C		L1: 0.9 m																																																																			
Relative air humidity:		85.0 %		L2: 0.3 m																																																																			
Test room volume:		102.8 m³		Room: Room 1																																																																			
Area, S, of test room:		138.9 m²		L3: 0.8 m																																																																			
				Volume: 0.2 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>62.1</td><td></td></tr><tr><td>125</td><td>61.1</td><td>65.1</td></tr><tr><td>160</td><td>55.3</td><td></td></tr><tr><td>200</td><td>55.1</td><td></td></tr><tr><td>250</td><td>54.8</td><td>60.0</td></tr><tr><td>315</td><td>55.8</td><td></td></tr><tr><td>400</td><td>57.7</td><td></td></tr><tr><td>500</td><td>55.3</td><td>61.1</td></tr><tr><td>630</td><td>55.5</td><td></td></tr><tr><td>800</td><td>51.2</td><td></td></tr><tr><td>1000</td><td>51.9</td><td>56.3</td></tr><tr><td>1250</td><td>51.5</td><td></td></tr><tr><td>1600</td><td>46.6</td><td></td></tr><tr><td>2000</td><td>44.4</td><td>49.5</td></tr><tr><td>2500</td><td>42.0</td><td></td></tr><tr><td>3150</td><td>40.6</td><td></td></tr><tr><td>4000</td><td>41.2</td><td>46.1</td></tr><tr><td>5000</td><td>42.1</td><td></td></tr><tr><td>6300</td><td>39.0</td><td></td></tr><tr><td>8000</td><td>35.8</td><td>41.9</td></tr><tr><td>10000</td><td>35.8</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	62.1		125	61.1	65.1	160	55.3		200	55.1		250	54.8	60.0	315	55.8		400	57.7		500	55.3	61.1	630	55.5		800	51.2		1000	51.9	56.3	1250	51.5		1600	46.6		2000	44.4	49.5	2500	42.0		3150	40.6		4000	41.2	46.1	5000	42.1		6300	39.0		8000	35.8	41.9	10000	35.8					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	62.1																																																																						
125	61.1	65.1																																																																					
160	55.3																																																																						
200	55.1																																																																						
250	54.8	60.0																																																																					
315	55.8																																																																						
400	57.7																																																																						
500	55.3	61.1																																																																					
630	55.5																																																																						
800	51.2																																																																						
1000	51.9	56.3																																																																					
1250	51.5																																																																						
1600	46.6																																																																						
2000	44.4	49.5																																																																					
2500	42.0																																																																						
3150	40.6																																																																						
4000	41.2	46.1																																																																					
5000	42.1																																																																						
6300	39.0																																																																						
8000	35.8	41.9																																																																					
10000	35.8																																																																						
1 Too high																																																																							
Sound power level L_w(A): 61.5 dB [re 1pW]																																																																							
Name of test institute:		DTI																																																																					
No. of test report:		300-KLAB-20-001																																																																					
Date:		24-01-2020																																																																					






Detailed test results of sound power measurement N° 4

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:		Panasonic Europe GmbH		Date of test: 24-01-2020																																																																			
Object:		Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																					
Mounting conditions:		The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test with a soundproof kit mounted in the outdoor unit.																																																																					
Operating conditions:		A7/W55, Quiet mode 3, Compressor speed: 38 - 39 [Hz], Heating capacity: 4.6 [kW], Power_input: 1.7 [kW], Water flow rate: 510 [l/h], Fan_speed : 430 - 440 [rpm], dp_water : 314 [mbar]																																																																					
Static pressure:		1029 kPa		<u>Reference box:</u>																																																																			
Air temperature:		7.0 °C		L1: 0.9 m																																																																			
Relative air humidity:		85.0 %		L2: 0.3 m																																																																			
Test room volume:		102.8 m³		Room: Room 1																																																																			
Area, S, of test room:		138.9 m²		L3: 0.8 m																																																																			
				Volume: 0.2 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>49.8</td><td></td></tr><tr><td>125</td><td>47.7</td><td>54.4</td></tr><tr><td>160</td><td>50.9</td><td></td></tr><tr><td>200</td><td>48.3</td><td></td></tr><tr><td>250</td><td>49.8</td><td>55.9</td></tr><tr><td>315</td><td>53.5</td><td></td></tr><tr><td>400</td><td>54.5</td><td></td></tr><tr><td>500</td><td>50.4</td><td>58.4</td></tr><tr><td>630</td><td>54.8</td><td></td></tr><tr><td>800</td><td>52.6</td><td></td></tr><tr><td>1000</td><td>46.7</td><td>54.7</td></tr><tr><td>1250</td><td>48.4</td><td></td></tr><tr><td>1600</td><td>41.8</td><td></td></tr><tr><td>2000</td><td>38.5</td><td>43.9</td></tr><tr><td>2500</td><td>34.0</td><td></td></tr><tr><td>3150</td><td>36.0</td><td></td></tr><tr><td>4000</td><td>42.8</td><td>45.1</td></tr><tr><td>5000</td><td>39.8</td><td></td></tr><tr><td>6300</td><td>38.2</td><td></td></tr><tr><td>8000</td><td>35.9</td><td>41.5</td></tr><tr><td>10000</td><td>35.5</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	49.8		125	47.7	54.4	160	50.9		200	48.3		250	49.8	55.9	315	53.5		400	54.5		500	50.4	58.4	630	54.8		800	52.6		1000	46.7	54.7	1250	48.4		1600	41.8		2000	38.5	43.9	2500	34.0		3150	36.0		4000	42.8	45.1	5000	39.8		6300	38.2		8000	35.9	41.5	10000	35.5					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	49.8																																																																						
125	47.7	54.4																																																																					
160	50.9																																																																						
200	48.3																																																																						
250	49.8	55.9																																																																					
315	53.5																																																																						
400	54.5																																																																						
500	50.4	58.4																																																																					
630	54.8																																																																						
800	52.6																																																																						
1000	46.7	54.7																																																																					
1250	48.4																																																																						
1600	41.8																																																																						
2000	38.5	43.9																																																																					
2500	34.0																																																																						
3150	36.0																																																																						
4000	42.8	45.1																																																																					
5000	39.8																																																																						
6300	38.2																																																																						
8000	35.9	41.5																																																																					
10000	35.5																																																																						
1 Too high																																																																							
Sound power level L_w(A): 59.0 dB [re 1pW]																																																																							
Name of test institute:		DTI																																																																					
No. of test report:		300-KLAB-20-001																																																																					
Date:		24-01-2020																																																																					






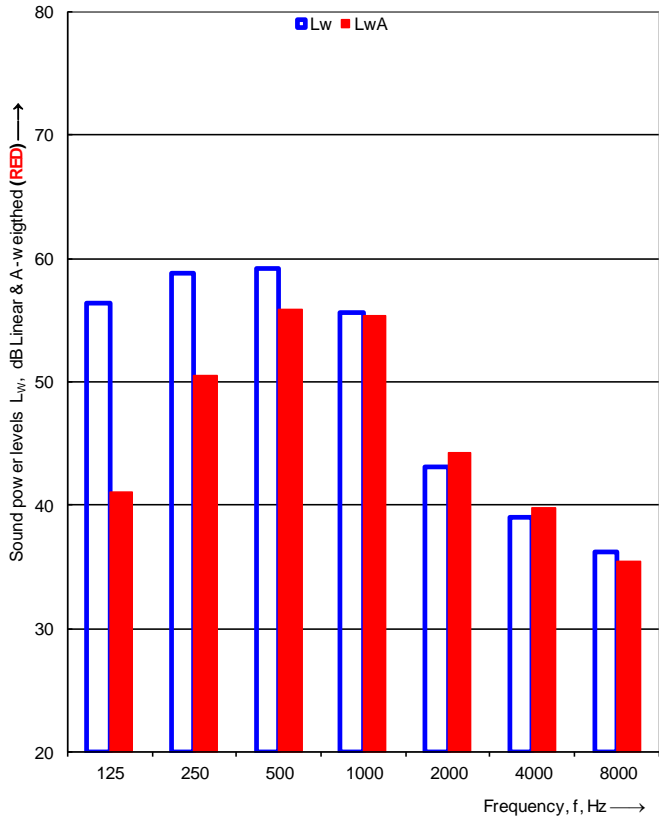


Detailed test results of sound power measurement N° 5

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:		Panasonic Europe GmbH		Date of test: 28-01-2020																																																																			
Object:		Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																					
Mounting conditions:		The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test after removing the soundproof kit from the outdoor unit and the enclosure materials of the compressor from the factory being restored.																																																																					
Operating conditions:		A7/W55, Compressor speed: 55 - 56 [Hz], Heating capacity: 7.0 [kW], Power_input: 2.6 [kW], Water flow rate: 770 [l/h], Fan_speed : 610 - 620 [rpm], dp_water : 260 [mbar]																																																																					
Static pressure:		1029 kPa		Reference box:																																																																			
Air temperature:		7.0 °C		L1: 0.9 m																																																																			
Relative air humidity:		85.0 %		L2: 0.3 m																																																																			
Test room volume:		102.8 m³		Room: Room 1																																																																			
Area, S, of test room:		138.9 m²		L3: 0.8 m																																																																			
				Volume: 0.2 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>65.2</td><td></td></tr><tr><td>125</td><td>64.2</td><td>68.0</td></tr><tr><td>160</td><td>54.9</td><td></td></tr><tr><td>200</td><td>58.0</td><td></td></tr><tr><td>250</td><td>56.7</td><td>61.5</td></tr><tr><td>315</td><td>55.1</td><td></td></tr><tr><td>400</td><td>58.2</td><td></td></tr><tr><td>500</td><td>55.1</td><td>61.1</td></tr><tr><td>630</td><td>55.0</td><td></td></tr><tr><td>800</td><td>52.1</td><td></td></tr><tr><td>1000</td><td>51.3</td><td>57.1</td></tr><tr><td>1250</td><td>53.4</td><td></td></tr><tr><td>1600</td><td>47.4</td><td></td></tr><tr><td>2000</td><td>44.3</td><td>49.9</td></tr><tr><td>2500</td><td>41.9</td><td></td></tr><tr><td>3150</td><td>41.9</td><td></td></tr><tr><td>4000</td><td>43.8</td><td>48.8</td></tr><tr><td>5000</td><td>45.6</td><td></td></tr><tr><td>6300</td><td>42.4</td><td></td></tr><tr><td>8000</td><td>36.5</td><td>43.9</td></tr><tr><td>10000</td><td>34.6</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	65.2		125	64.2	68.0	160	54.9		200	58.0		250	56.7	61.5	315	55.1		400	58.2		500	55.1	61.1	630	55.0		800	52.1		1000	51.3	57.1	1250	53.4		1600	47.4		2000	44.3	49.9	2500	41.9		3150	41.9		4000	43.8	48.8	5000	45.6		6300	42.4		8000	36.5	43.9	10000	34.6					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	65.2																																																																						
125	64.2	68.0																																																																					
160	54.9																																																																						
200	58.0																																																																						
250	56.7	61.5																																																																					
315	55.1																																																																						
400	58.2																																																																						
500	55.1	61.1																																																																					
630	55.0																																																																						
800	52.1																																																																						
1000	51.3	57.1																																																																					
1250	53.4																																																																						
1600	47.4																																																																						
2000	44.3	49.9																																																																					
2500	41.9																																																																						
3150	41.9																																																																						
4000	43.8	48.8																																																																					
5000	45.6																																																																						
6300	42.4																																																																						
8000	36.5	43.9																																																																					
10000	34.6																																																																						
1 Too high																																																																							
Sound power level L_w(A): 62.2 dB [re 1pW]																																																																							
Name of test institute:		DTI																																																																					
No. of test report:		300-KLAB-20-001																																																																					
Date:		28-01-2020																																																																					




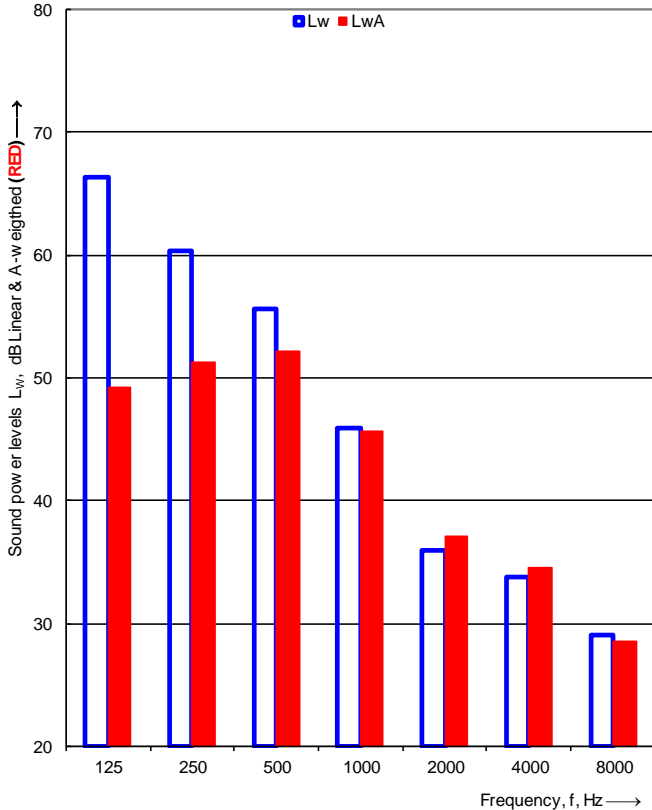


Detailed test results of sound power measurement N° 6

				Sound power levels according to ISO 3743-1:2010				TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																											
Client:		Panasonic Europe GmbH				Date of test: 28-01-2020																																																																					
Object:		Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																									
Mounting conditions:		The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration isolators. Test after removing the soundproof kit from the outdoor unit and the enclosure materials of the compressor from the factory being restored.																																																																									
Operating conditions:		A7/W55, Quiet mode 3, Compressor speed: 38 - 39 [Hz], Heating capacity: 4.7 [kW], Power_input: 1.7 [kW], Water flow rate: 510 [l/h], Fan_speed: 430 - 440 [rpm], dp_water: 314 [mbar]																																																																									
Static pressure:		1029 kPa				<u>Reference box:</u>																																																																					
Air temperature:		7.0 °C				L1: 0.9 m																																																																					
Relative air humidity:		85.0 %				L2: 0.3 m																																																																					
Test room volume:		102.8 m³				Room: Room 1		L3: 0.8 m																																																																			
Area, S, of test room:		138.9 m²				Volume: 0.2 m³																																																																					
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>52.0</td><td></td></tr><tr><td>125</td><td>49.3</td><td>56.3</td></tr><tr><td>160</td><td>52.7</td><td></td></tr><tr><td>200</td><td>50.9</td><td></td></tr><tr><td>250</td><td>56.3</td><td>58.7</td></tr><tr><td>315</td><td>53.0</td><td></td></tr><tr><td>400</td><td>56.2</td><td></td></tr><tr><td>500</td><td>50.8</td><td>59.2</td></tr><tr><td>630</td><td>54.7</td><td></td></tr><tr><td>800</td><td>53.8</td><td></td></tr><tr><td>1000</td><td>46.9</td><td>55.6</td></tr><tr><td>1250</td><td>48.9</td><td></td></tr><tr><td>1600</td><td>40.9</td><td></td></tr><tr><td>2000</td><td>38.1</td><td>43.1</td></tr><tr><td>2500</td><td>32.7</td><td></td></tr><tr><td>3150</td><td>31.8</td><td></td></tr><tr><td>4000</td><td>35.6</td><td>38.9</td></tr><tr><td>5000</td><td>34.3</td><td></td></tr><tr><td>6300</td><td>33.0</td><td></td></tr><tr><td>8000</td><td>32.1</td><td>36.2</td></tr><tr><td>10000</td><td>27.2</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	52.0		125	49.3	56.3	160	52.7		200	50.9		250	56.3	58.7	315	53.0		400	56.2		500	50.8	59.2	630	54.7		800	53.8		1000	46.9	55.6	1250	48.9		1600	40.9		2000	38.1	43.1	2500	32.7		3150	31.8		4000	35.6	38.9	5000	34.3		6300	33.0		8000	32.1	36.2	10000	27.2									
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																									
100	52.0																																																																										
125	49.3	56.3																																																																									
160	52.7																																																																										
200	50.9																																																																										
250	56.3	58.7																																																																									
315	53.0																																																																										
400	56.2																																																																										
500	50.8	59.2																																																																									
630	54.7																																																																										
800	53.8																																																																										
1000	46.9	55.6																																																																									
1250	48.9																																																																										
1600	40.9																																																																										
2000	38.1	43.1																																																																									
2500	32.7																																																																										
3150	31.8																																																																										
4000	35.6	38.9																																																																									
5000	34.3																																																																										
6300	33.0																																																																										
8000	32.1	36.2																																																																									
10000	27.2																																																																										
1 Too high																																																																											
Sound power level L_w(A): 59.6 dB [re 1pW]																																																																											
Name of test institute:		DTI																																																																									
No. of test report:		300-KLAB-20-001																																																																									
Date:		28-01-2020																																																																									



Detailed test results of sound power measurement N° 7

 		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:	Panasonic Europe GmbH		Date of test: 30-01-2020																																																																				
Object:	Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)																																																																						
Mounting conditions:	The outdoor unit is standing free on six 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. Test with a noise reduction box mounted around the outdoor unit.																																																																						
Operating conditions:	A7/W55, Compressor speed: 55 - 56 [Hz], Heating capacity: 6.95 [kW], Power input: 2.6 [kW], Water flow rate: 760 [l/h], Fan speed: 610 - 620 [rpm], dp water: 260 [mbar]																																																																						
Static pressure:	992 kPa		Reference box:																																																																				
Air temperature:	7.0 °C		L1: 0.9 m																																																																				
Relative air humidity:	85.0 %		L2: 0.3 m																																																																				
Test room volume:	102.8 m³	Room: Room 1	L3: 0.8 m																																																																				
Area, S, of test room:	138.9 m²		Volume: 0.2 m³																																																																				
<table border="1"> <thead> <tr> <th>Frequency f [Hz]</th> <th>L_w 1/3 octave [dB]</th> <th>1/1 oct [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>63.3</td><td></td></tr> <tr><td>125</td><td>62.7</td><td>66.3</td></tr> <tr><td>160</td><td>53.6</td><td></td></tr> <tr><td>200</td><td>57.0</td><td></td></tr> <tr><td>250</td><td>55.8</td><td>60.3</td></tr> <tr><td>315</td><td>52.7</td><td></td></tr> <tr><td>400</td><td>51.9</td><td></td></tr> <tr><td>500</td><td>50.7</td><td>55.6</td></tr> <tr><td>630</td><td>49.4</td><td></td></tr> <tr><td>800</td><td>43.0</td><td></td></tr> <tr><td>1000</td><td>39.1</td><td>45.8</td></tr> <tr><td>1250</td><td>40.1</td><td></td></tr> <tr><td>1600</td><td>33.8</td><td></td></tr> <tr><td>2000</td><td>30.1</td><td>35.9</td></tr> <tr><td>2500</td><td>27.1</td><td></td></tr> <tr><td>3150</td><td>26.8</td><td></td></tr> <tr><td>4000</td><td>29.5</td><td>33.7</td></tr> <tr><td>5000</td><td>29.9</td><td></td></tr> <tr><td>6300</td><td>27.1</td><td></td></tr> <tr><td>8000</td><td>22.6</td><td>29.1</td></tr> <tr><td>10000</td><td>20.5</td><td></td></tr> </tbody> </table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	63.3		125	62.7	66.3	160	53.6		200	57.0		250	55.8	60.3	315	52.7		400	51.9		500	50.7	55.6	630	49.4		800	43.0		1000	39.1	45.8	1250	40.1		1600	33.8		2000	30.1	35.9	2500	27.1		3150	26.8		4000	29.5	33.7	5000	29.9		6300	27.1		8000	22.6	29.1	10000	20.5					
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																					
100	63.3																																																																						
125	62.7	66.3																																																																					
160	53.6																																																																						
200	57.0																																																																						
250	55.8	60.3																																																																					
315	52.7																																																																						
400	51.9																																																																						
500	50.7	55.6																																																																					
630	49.4																																																																						
800	43.0																																																																						
1000	39.1	45.8																																																																					
1250	40.1																																																																						
1600	33.8																																																																						
2000	30.1	35.9																																																																					
2500	27.1																																																																						
3150	26.8																																																																						
4000	29.5	33.7																																																																					
5000	29.9																																																																						
6300	27.1																																																																						
8000	22.6	29.1																																																																					
10000	20.5																																																																						
¹ Too high																																																																							
Sound power level L_w(A): 56.6 dB [re 1pW]																																																																							
Name of test institute:	DTI																																																																						
No. of test report:	300-KLAB-20-001																																																																						
Date:	30-01-2020																																																																						

Detailed test results of sound power measurement N° 8



Sound power levels according to ISO 3743-1:2010



**TEKNOLOGISK
INSTITUT**

Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms

Client:	Panasonic Europe GmbH	Date of test:	30-01-2020
Object:	Type: Split Air to water heat pump Model: WH-UD07JE5 (OD) + WH-ADC0309J3E5 (ID)		
Mounting conditions:	The outdoor unit is standing free on six 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. Test with a noise reduction box mounted around the outdoor unit.		

Operating conditions: A7/W55, Quiet mode 3, Compressor speed: 38 - 39 [Hz], Heating capacity: 4.6 [kW], Power_input: 1.7 [kW], Water flow rate: 510 [l/h], Fan_speed: 430 - 440 [rpm], dp_water: 314 [mbar]

Static pressure:	992 kPa
------------------	---------

Air temperature: 7.0 °C

Relative air humidity: 85.0 %

Test room volume: 102.8 m³

Area, S, of test room: 138.9 m²

Room: Room 1


Reference box:

L1: 0.9 m

L2: 0.3 m

L3: 0.8 m

Volume: 0.2 m³

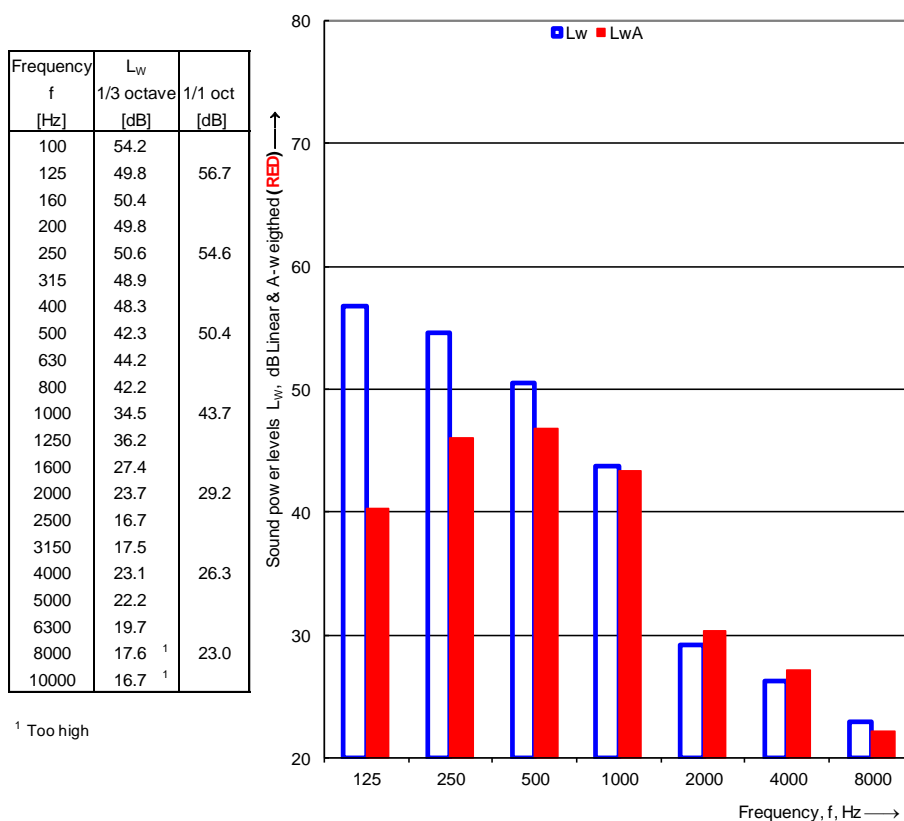

¹ Too high

Sound power level $L_w(A)$: 54.0 dB [re 1pW]

Name of test institute: DTI

No. of test report: 300-KLAB-20-001

Date: 30-01-2020





Appendix 1: Test Procedure

The measurements of the emitted sound power level from the heat pump are carried out according to the following:

- DS/EN 14511:2013
- EN 12102:2017
- DS/EN 3743/1

The basic acoustic measurement standard DS/EN 3743-1 is a comparison method using a calibrated reference sound source. Two series of sound pressure measurements are made under exactly the same acoustic conditions, e.g. the same microphone positions, temperature and air humidity. The calibrated sound power levels are known for the reference sound source at each frequency band, and they are used in the estimation of the acoustical correction factor for the calculation of the sound power emitted from the tested heat pump. The background noise levels are measured and used for relevant corrections.

The final total A-weighted sound power level is based on measurements and calculations in 1/3-octave levels, which then are summed into 1/1-octave levels. The uncertainty is estimated on the weighted standard deviations in 1/1-octave levels.

The actual microphone positions and correction values are saved in data files linked to the complete project documentation according to the DANAK-accreditation.

The complete measurement system is documented and regularly calibrated according to DANAK.

The detailed description of the measurement method is given in Danish in the quality database system "QA Web" at Danish Technological Institute, which is accessible by DANAK.

