

TEST REPORT

Report no.:
300-KLAB-23-039-3 rev 2.



DANISH
TECHNOLOGICAL
INSTITUTE

Teknologiparken
Kongsvang Allé 29
DK-8000 Aarhus C
+45 72 20 20 00
Info@teknologisk.dk
www.teknologisk.dk

Page 1 of 44
Init: PRES/RTHI
File no.: 226006
Enclosures: 2

Customer: Company: GD MIDEA HEATING & VENTILATING EQUIPMENT CO., LTD.
Address: Penglai Industry Road, Beijiao
City: Shunde, Foshan, Guangdong, 528311, China
Tel.: +86 13902810522

Unit tested: Brand: Midea
Type: Air to water heat pump (mono block)
Model: MHC-V16W/D2RN8-B
Series no.: 541K814480238190100003
Prod. year: Outdoor unit: N/A

Dates: Test period: December 2023 – January 2024

Brand name: Brand: NOXA
Type: Air to water heat pump (mono block)
Model: NXHPM-V16W/D2RN8-B

Procedures See objective (page 2) for list of standards.

Remarks: The unit was delivered by the customer. The installation and test settings were done according to the customers instructions. Between each test condition the customer changed various parameters like compressor speed, expansion valve, fan speed, pump speed, defrost time, heating time. The report for the tested unit is named 300-KLAB-23-039 issued 2024.03.21
Also see appendix 2.
This report replaces report 300-KLAB-23-042-3 rev 1. from 2024.05.07. due to table added on page 2.

Terms: This test was conducted under accreditation in accordance with international requirements (ISO/IEC 17025:2017) and in accordance with the General Terms and Conditions of Danish Technological Institute. The test results solely apply to the tested item. This test report may be quoted in extract only if Danish Technological Institute has granted its written consent.

The customer may not mention or refer to Danish Technological Institute or Danish Technological Institute's employees for advertising or marketing purposes unless Danish Technological Institute has granted its written consent in each case.

Division/Centre: Danish Technological Institute
Energy and Climate
Heat Pump Laboratory, Aarhus

Date: 2024.05.13

Signature:
Preben Eskerod
B.TecMan & MarEng

Co-reader:
Rasmus Thisgaard
B.TecMan & MarEng



DANAK
Test Reg. nr. 300



Heat pumps of identical design

According to GD MIDEA HEATING & VENTILATING EQUIPMENT CO. LTD. The heat pumps listed in the table below are considered identical with the tested unit. They have identical:

- a. heating capacity
- b. refrigerant cycle (incl. refrigerant mass)
- c. heat source and sink medium
- d. main components / operating principle and control strategy
- e. same outdoor casing

Midea	MHC-V16W/D2N8-B
Midea	MHC-V16W/D2N8-BE30
Midea	MHC-V16W/D2N8-BER60
Midea	MHC-V16W/D2N8-BER90
Midea	MHC-V16W/D2N8-B1
Midea	MHC-V16W/D2N8-B1E30
Midea	MHC-V16W/D2N8-B1ER60
Midea	MHC-V16W/D2N8-B1ER90
Midea	MHC-V16W/D2N8-B2
Midea	MHC-V16W/D2N8-B2E30
Midea	MHC-V16W/D2N8-B2ER60
Midea	MHC-V16W/D2N8-B2ER90
Midea	MHC-V16W/D2RN8-B
Midea	MHC-V16W/D2RN8-BE30
Midea	MHC-V16W/D2RN8-BER60
Midea	MHC-V16W/D2RN8-BER90
Midea	MHC-V16W/D2RN8-B1
Midea	MHC-V16W/D2RN8-B1E30
Midea	MHC-V16W/D2RN8-B1ER60
Midea	MHC-V16W/D2RN8-B1ER90
Midea	MHC-V16W/D2RN8-B2
Midea	MHC-V16W/D2RN8-B2E30
Midea	MHC-V16W/D2RN8-B2ER60
Midea	MHC-V16W/D2RN8-B2ER90





Objective

The objective of this report is to document the following:

The Seasonal Coefficient of Performance (SCOP) at low and medium temperature application for average climate according to EN 14825:2022.

In order to calculate the SCOP, tests were carried out at the part load conditions stated in the tables on page 5 and 6.

SCOP part load test in conditions SCOP_B and SCOP_C at low temperature application for warmer climate according to EN 14825:2022.

SCOP part load test conditions SCOP_A and SCOP_{F/G} at low temperature application for colder climate according to EN 14825:2022.

COP test standard rating conditions A7/W35 and A7/W55 according to EN 14511:2022.

Operating requirements according to EN 14511-4:2022

- 4.2.1 Starting and operating tests
- 4.5 Shutting off the heat transfer medium flows
- 4.6 Complete power supply failure

Sound power measurements according to EN 12102-1:2022.



Contents:

Test conditions	6
SCOP test conditions for low temperature – EN 14825	6
SCOP test conditions for medium temperature – EN 14825	7
COP test conditions - low temperature – EN 14511	8
COP test conditions - medium temperature – EN 14511	8
Test conditions for operating requirements – EN 14511-4	8
Test conditions for shutting off the heat transfer medium – EN 14511-4	9
Test conditions for complete power supply failure – EN 14511-4	9
Test conditions for sound power measurements – EN 12102-1	9
Test results.....	10
Test results of SCOP test at low temperature - heating season average – EN 14825.....	10
Test results of SCOP test at medium temperature - heating season average – EN 14825	11
Test results for warmer climate, low temperature according to EN14825.....	12
Test results for colder climate, low temperature according to EN14825	12
COP test results - low temperature – EN 14511	12
COP test results - medium temperature – EN 14511.....	12
Test results for starting and operating test - EN 14511-4	13
Test results for shutting off the heat transfer medium – EN 14511-4	13
Test results for complete power supply failure – EN 14511-4.....	13
Test results of sound power measurements – EN 12102-1	14
Photos	15
SCOP - detailed calculation	16
Detailed SCOP calculation of low temperature and average climate conditions – EN 14825.....	16
Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825	18



Detailed test results	20
Detailed SCOP part load test results - low temperature application - average climate – EN 14825.....	20
Detailed SCOP part load test results - medium temperature application - average climate – EN 14825	25
Detailed SCOP part load test results - low temperature application - warmer climate – EN 14825	30
Detailed SCOP part load test results - low temperature application - colder climate – EN 14825.....	32
Detailed COP test results - low temperature – EN 14511.....	34
Detailed COP test results - medium temperature – EN 14511	35
Detailed test results of sound power measurement – Test N#1	36
Detailed test results of sound power measurement – Test N#2	37
Detailed test results of sound power measurement – Test N#3	38
Detailed test results of sound power measurement – Test N#4	39
Appendix 1.....	40
Appendix 2.....	44



Test conditions

SCOP test conditions for low temperature – EN 14825

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for low temperature application for the reference heating season;
"A" = average, "W" = warmer, and "C" = colder.

	Part load ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	Average	Warmer	Colder	Outdoor air	Exhaust air	All climates	Average	Warmer	Colder
A	$(-7 - 16) / (T_{designh} - 16)$	88,46	n.a.	60,53	-7(-8)	20(12)	^a / 35	^a / 34	n.a.	^a / 30
B	$(+2 - 16) / (T_{designh} - 16)$	53,85	100,00	36,84	2(1)	20(12)	^a / 35	^a / 30	^a / 35	^a / 27
C	$(+7 - 16) / (T_{designh} - 16)$	34,62	64,29	23,68	7(6)	20(12)	^a / 35	^a / 27	^a / 31	^a / 25
D	$(+12 - 16) / (T_{designh} - 16)$	15,38	28,57	10,53	12(11)	20(12)	^a / 35	^a / 24	^a / 26	^a / 24
E	$(TOL^e - 16) / (T_{designh} - 16)$				TOL ^e	20(12)	^a / 35	^a / b	^a / b	^a / b
F	$(T_{biv} - 16) / (T_{designh} - 16)$				T _{biv}	20(12)	^a / 35	^a / c	^a / c	^a / c
G	$(-15 - 16) / (T_{designh} - 16)$	n.a.	n.a.	81,58	-15	20(12)	^a / 35	n.a.	n.a.	^a / 32

Additional information

Climate	T _{designh} [°C]	T _{bivalent} [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Variable
Colder	-22	-15	-22	Variable	Variable
Warmer	2	7	2	Variable	Variable





SCOP test conditions for medium temperature – EN 14825

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for medium temperature application for the reference heating season;
"A" = average, "W" = warmer, and "C" = colder.

	Part load ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	Average	Warmer	Colder	Outdoor air	Exhaust air	All climates	Average	Warmer	Colder
A	$(-7 - 16) / (T_{designh} - 16)$	88,46	n.a.	60,53	-7(-8)	20(12)	^a / 55	^a / 52	n.a.	^a / 44
B	$(+2 - 16) / (T_{designh} - 16)$	53,85	100	36,84	2(1)	20(12)	^a / 55	^a / 42	^a / 55	^a / 37
C	$(+7 - 16) / (T_{designh} - 16)$	34,62	64,29	23,68	7(6)	20(12)	^a / 55	^a / 36	^a / 46	^a / 32
D	$(+12 - 16) / (T_{designh} - 16)$	15,38	28,57	10,53	12(11)	20(12)	^a / 55	^a / 30	^a / 34	^a / 28
E	$(TOL^e - 16) / (T_{designh} - 16)$				TOL^e	20(12)	^a / 55	^a / b	^a / b	^a / b
F	$(T_{biv} - 16) / (T_{designh} - 16)$				T_{biv}	20(12)	^a / 55	^a / c	^a / c	^a / c
G	$(-15 - 16) / (T_{designh} - 16)$	n.a.	n.a.	81,58	-15	20(12)	^a / 55	n.a.	n.a.	^a / 49

Additional information

Climate	$T_{designh}$ [°C]	$T_{bivalent}$ [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Variable





COP test conditions - low temperature – EN 14511

N [#]	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1 ^S	7	6	30	35

S: Standard rating condition

COP test conditions - medium temperature – EN 14511

N [#]	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1 ^S	7	6	47	55

S: Standard rating condition

Test conditions for operating requirements – EN 14511-4

N [#]	Heat source		Heat sink	Water flow rate at indoor heat exchanger	Test
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)		
1	-25	-	12	800 L/h	Starting
2	-25	-	38	710 L/h	Operating





Test conditions for shutting off the heat transfer medium – EN 14511-4

N [#]	Heat source		Heat sink		Heat exchanger
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)	
1	7	6	47	55	Indoor
2	7	6	47	55	Outdoor

Test conditions for complete power supply failure – EN 14511-4

N [#]	Heat source		Heat sink		
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)	
1	7	6	47	55	

Test conditions for sound power measurements – EN 12102-1

N [#]	Test condition		Heat pump setting			
	Outdoor heat exchanger (dry bulb/wet bulb) (°C)	Indoor heat exchanger (inlet/outlet) (°C)	Compressor speed (Hz)	Fan speed outdoor (rpm)	Heating capacity (kW)	Power input (kW)
1 ^F	7/6	30/35	64	730	15.70	3.49
2 ^P	7/6	30/35	24	400	5.67	1.16
3 ^F	7/6	47/55	72	650	16.14	5.65
4 ^E	7/6	47/55	32	450	7.10	2.34

F) Full load, P) part load and E) ErP labelling





Test results

Test results of SCOP test at low temperature - heating season average - EN 14825

Model (Outdoor)	MHC-V16W/D2RN8-B		
Air-to-water heat pump mono bloc	Y		
Low-temperature heat pump	N		
Equipped with supplementary heater	Y		
Heat pump combination heater	N		
Reversible	Y		

Rated heat output¹⁾	P_{rated}	15.2 [kW]
Seasonal space heating energy efficiency	η_s	184.1 [%]
	SCOP	4.68 [-]

Measured capacity for heating for part load at outdoor temperature Tj	Average Climate - Low temperature application	Tj=-15 °C	Pdh	- [kW]
		Tj=-7 °C	Pdh	13.27 [kW]
		Tj=2 °C	Pdh	8.24 [kW]
		Tj=7 °C	Pdh	6.26 [kW]
		Tj=12 °C	Pdh	7.26 [kW]
		Tj=bivalent temperature	Pdh	13.27 [kW]
		Tj=operation limit	Pdh	12.62 [kW]

Measured coefficient of performance at outdoor temperature Tj	Average Climate - Low temperature application	Tj=-15 °C	COPd	- [-]
		Tj=-7 °C	COPd	2.64 [-]
		Tj=2 °C	COPd	4.59 [-]
		Tj=7 °C	COPd	6.62 [-]
		Tj=12 °C	COPd	8.13 [-]
		Tj=bivalent temperature	COPd	2.64 [-]
		Tj=operation limit	COPd	2.51 [-]

Bivalent temperature	Tbivalent	-7 [°C]
Operation limit	TOL	-10 [°C]
temperatures	WTOL	- [°C]
Degradation coefficient	Cdh	0.97 [-]

Power consumption in modes other than active mode	Off mode	P_{OFF}	0.021 [kW]
	Thermostat-off mode	P_{TO}	0.026 [kW]
	Standby mode	P_{SB}	0.021 [kW]
	Crankcase heater mode ²⁾	P_{CK}	0.021 [kW]
Supplementary heater¹⁾	Rated heat output	P_{SUP}	2.58 [kW]
	Type of energy input		Electrical

Other items	Capacity control	Variable
	Water flow control	Variable
	Water flow rate	-
	Annual energy consumption	Q_{HE} 6712 [kWh]

¹⁾For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated} , is equal to the design load for heating, $P_{designh}$, and the rated heat output of a supplementary heater, P_{sup} , is equal to the supplementary capacity for heating, $sup(T_j)$.

²⁾For SCOP calculation the value PCK - PSB is used. See page 15





Test results of SCOP test at medium temperature - heating season average – EN 14825

Model (Outdoor)	MHC-V16W/D2RN8-B		
Air-to-water heat pump mono bloc		P _{rated}	Y
Low-temperature heat pump			N
Equipped with supplementary heater			Y
Heat pump combination heater			N
Reversible			Y

Rated heat output¹⁾	P _{rated}	13 [kW]
Seasonal space heating energy efficiency	η _s SCOP	137.3 [%] 3.51 [-]

Measured capacity for heating for part load at outdoor temperature T_j	Average Climate - Medium temperature application	T _j =-15 °C	P _{dh}	- [kW]
		T _j =-7 °C	P _{dh}	11.68 [kW]
		T _j =2 °C	P _{dh}	7.29 [kW]
		T _j =7 °C	P _{dh}	6.03 [kW]
		T _j =12 °C	P _{dh}	6.89 [kW]
		T _j =bivalent temperature	P _{dh}	11.68 [kW]
		T _j =operation limit	P _{dh}	10.53 [kW]

Measured coefficient of performance at outdoor temperature T_j	Average Climate - Medium temperature application	T _j =-15 °C	COP _d	- [-]
		T _j =-7 °C	COP _d	2.02 [-]
		T _j =2 °C	COP _d	3.42 [-]
		T _j =7 °C	COP _d	4.93 [-]
		T _j =12 °C	COP _d	6.02 [-]
		T _j =bivalent temperature	COP _d	2.02 [-]
		T _j =operation limit	COP _d	1.82 [-]

Bivalent temperature	T _{bivalent}	-7 [°C]
Operation limit	T _{OL}	-10 [°C]
temperatures	WTOL	- [°C]
Degradation coefficient	C _{dh}	0.98 [-]

Power consumption in modes other than active mode	Off mode	P _{OFF}	0.021 [kW]
	Thermostat-off mode	P _{TO}	0.026 [kW]
	Standby mode	P _{SB}	0.021 [kW]
	Crankcase heater mode	P _{CK}	0.021 [kW]
Supplementary heater¹⁾	Rated heat output	P _{SUP}	2.47 [kW]
	Type of energy input		Electrical

Other items	Capacity control	Variable
	Water flow control	Variable
	Water flow rate	-
	Annual energy consumption	Q _{HE} 7655 [kWh]

¹⁾For heat pump space heaters and heat pump combination heaters, the rated heat output, P_{rated}, is equal to the design load for heating, P_{designh}, and the rated heat output of a supplementary heater, P_{sup}, is equal to the supplementary capacity for heating, sup(T_j).

²⁾For SCOP calculation the value PCK - PSB is used. See page 17





Test results for warmer climate, low temperature according to EN14825

N°	Test condition	Heating capacity [kW]	COP
1	B	13.106	3.508
2	Tbivalent F and C	8.750	5.514

Test results for colder climate, low temperature according to EN14825

N°	Test condition	Heating capacity [kW]	COP
1	A	8.383	3.315
2	Tbivalent F and G	11.301	2.497

COP test results - low temperature – EN 14511

N*	Test conditions	Heating capacity [kW]	COP
1	A7/W35	15.707	4.498

COP test results - medium temperature – EN 14511

N*	Test conditions	Heating capacity [kW]	COP
1	A7/W55	16.139	2.854





Test results for starting and operating test - EN 14511-4

N#	Test conditions air/water inlet [°C]	Test validation
Starting	A-25/W18	Passed
Operating	A-25/W38	Passed

Test results for shutting off the heat transfer medium – EN 14511-4

N#	Heat exchanger	Test validation
1	Indoor	Passed
2	Outdoor	Passed

Test results for complete power supply failure – EN 14511-4

N#	Test validation
1	Passed





Test results of sound power measurements – EN 12102-1

N [#]	Test conditions	Sound power level LW(A) [dB re 1pW]	Uncertainty σ_{tot} [dB]
1 ^F	A7/W35	66.5	1.6
2 ^P	A7/W35	51.5	1.6
3 ^F	A7/W55	65.2	1.6
4 ^E	A7/55	55.6	1.6

F) Full load, P) part load and E) ErP labelling

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz. For the calculation of uncertainty, see appendix 1.

The sound power measurements are carried out by Kamalathasan Arumugam (KAMA) and co-read by Patrick Glibert (PGL), Danish Technological Institute.



Photos

Rating plate



Outdoor unit





SCOP - detailed calculation

Detailed SCOP calculation of low temperature and average climate conditions – EN 14825

Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{SCOP_{on} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} =

Heating load of the building at design temperature, kW

H_{he} =

Number of equivalent heating hours, 2066 h

$H_{TO}, H_{SB}, H_{CK}, H_{OFF}$ =

Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

$P_{TO}, P_{SB}, P_{CK}, P_{OFF}$ =

Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COPbin [-]
A	-7	88	13.45	13.27	2.64	0.99	1.00	2.64
B	2	54	8.18	8.24	4.59	0.99	1.00	4.59
C	7	35	5.26	6.26	6.62	0.97	0.84	6.58
D	12	15	2.34	7.26	8.13	0.97	0.32	7.66
E	-10	100	15.20	12.62	2.51	0.99	1.00	2.51
F - BIV	-7	88	13.45	13.27	2.64	0.99	1.00	2.64

Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.02097	0.02097	0
Thermostat off	178	0.02612	0.02612	4.64936
Standby	0	0.02097	0.02097	0
Crankcase heater	178	0.02111	0.00014	0.02492





Calculation Bin for SCOPon

	Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	Annual backup heater energy input [kWh]	COPbin [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
E	21	-10	1	15.20	12.62	2.58	2.58	2.51	15.20	7.61	12.62	5.03
	22	-9	25	14.62	12.84	1.78	44.46	2.55	365.38	170.15	320.93	125.69
	23	-8	23	14.03	13.05	0.98	22.47	2.60	322.71	138.05	300.24	115.58
A / F - BIV	24	-7	24	13.45	13.27	0.00	0.00	2.64	322.71	122.15	322.71	122.15
	25	-6	27	12.86	12.71	0.00	0.00	2.86	347.26	121.49	347.26	121.49
	26	-5	68	12.28	12.14	0.00	0.00	3.07	834.83	271.52	834.83	271.52
	27	-4	91	11.69	11.58	0.00	0.00	3.29	1064.00	323.31	1064.00	323.31
	28	-3	89	11.11	11.01	0.00	0.00	3.51	988.58	281.86	988.58	281.86
	29	-2	165	10.52	10.45	0.00	0.00	3.72	1736.31	466.29	1736.31	466.29
	30	-1	173	9.94	9.88	0.00	0.00	3.94	1719.35	436.38	1719.35	436.38
	31	0	240	9.35	9.31	0.00	0.00	4.16	2244.92	540.12	2244.92	540.12
	32	1	280	8.77	8.75	0.00	0.00	4.37	2455.38	561.53	2455.38	561.53
B	33	2	320	8.18	8.18	0.00	0.00	4.59	2619.08	570.73	2619.08	570.73
	34	3	357	7.60	7.60	0.00	0.00	4.99	2713.20	544.02	2713.20	544.02
	35	4	356	7.02	7.02	0.00	0.00	5.39	2497.48	463.73	2497.48	463.73
	36	5	303	6.43	6.43	0.00	0.00	5.78	1948.52	336.88	1948.52	336.88
C	37	6	330	5.85	5.85	0.00	0.00	6.18	1929.23	312.06	1929.23	312.06
	38	7	326	5.26	5.26	0.00	0.00	6.58	1715.26	260.66	1715.26	260.66
	39	8	348	4.68	4.68	0.00	0.00	6.80	1627.57	239.46	1627.57	239.46
	40	9	335	4.09	4.09	0.00	0.00	7.01	1370.92	195.48	1370.92	195.48
D	41	10	315	3.51	3.51	0.00	0.00	7.23	1104.92	152.84	1104.92	152.84
	42	11	215	2.92	2.92	0.00	0.00	7.45	628.46	84.41	628.46	84.41
	43	12	169	2.34	2.34	0.00	0.00	7.66	395.20	51.58	395.20	51.58
	44	13	151	1.75	1.75	0.00	0.00	7.88	264.83	33.61	264.83	33.61
	45	14	105	1.17	1.17	0.00	0.00	8.09	122.77	15.17	122.77	15.17
	46	15	74	0.58	0.58	0.00	0.00	8.31	43.26	5.21	43.26	5.21

SUM 31397.35 6706.27 31327.85 6636.77

SCOPon 4.68 **SCOPnet** 4.72



Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825

Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{P_{designh} \times H_{he} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} =

Heating load of the building at design temperature, kW

H_{he} =

Number of equivalent heating hours, 2066 h

$H_{TO}, H_{SB}, H_{CK}, H_{OFF}$ =

Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

$P_{TO}, P_{SB}, P_{CK}, P_{OFF}$ =

Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COPbin [-]
A	-7	88	11.50	11.68	2.02	1.00	1.00	2.02
B	2	54	7.00	7.29	3.42	0.99	1.00	3.42
C	7	35	4.50	6.03	4.93	0.98	0.75	4.90
D	12	15	2.00	6.89	6.02	0.98	0.29	5.70
E	-10	100	13.00	10.53	1.82	1.00	1.00	1.82
F - BIV	-7	88	11.50	11.68	2.02	1.00	1.00	2.02

Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.02097	0.02097	0
Thermostat off	178	0.02612	0.02612	4.64936
Standby	0	0.02097	0.02097	0
Crankcase heater	178	0.02111	0.00014	0.02492





Calculation Bin for SCOP_{on}

Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	backup heater energy input [kWh]	COP _{bin} [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
E	21	-10	1	13.00	10.53	2.47	2.47	13.00	8.26	10.53	5.79
	22	-9	25	12.50	10.85	1.65	41.15	1.89	312.50	185.05	271.35
	23	-8	23	12.00	11.18	0.82	18.93	1.95	276.00	150.54	257.07
A / F - BIV	24	-7	24	11.50	11.50	0.00	0.00	2.02	276.00	136.57	276.00
	25	-6	27	11.00	11.00	0.00	0.00	2.18	297.00	136.46	297.00
	26	-5	68	10.50	10.50	0.00	0.00	2.33	714.00	306.19	714.00
	27	-4	91	10.00	10.00	0.00	0.00	2.49	910.00	365.85	910.00
	28	-3	89	9.50	9.50	0.00	0.00	2.64	845.50	319.93	845.50
	29	-2	165	9.00	9.00	0.00	0.00	2.80	1485.00	530.69	1485.00
	30	-1	173	8.50	8.50	0.00	0.00	2.95	1470.50	497.86	1470.50
	31	0	240	8.00	8.00	0.00	0.00	3.11	1920.00	617.54	1920.00
	32	1	280	7.50	7.50	0.00	0.00	3.26	2100.00	643.27	2100.00
B	33	2	320	7.00	7.00	0.00	0.00	3.42	2240.00	654.97	2240.00
	34	3	357	6.50	6.50	0.00	0.00	3.72	2320.50	624.49	2320.50
	35	4	356	6.00	6.00	0.00	0.00	4.01	2136.00	532.45	2136.00
	36	5	303	5.50	5.50	0.00	0.00	4.31	1666.50	386.89	1666.50
	37	6	330	5.00	5.00	0.00	0.00	4.60	1650.00	358.44	1650.00
C	38	7	326	4.50	4.50	0.00	0.00	4.90	1467.00	299.45	1467.00
	39	8	348	4.00	4.00	0.00	0.00	5.06	1392.00	275.13	1392.00
	40	9	335	3.50	3.50	0.00	0.00	5.22	1172.50	224.62	1172.50
	41	10	315	3.00	3.00	0.00	0.00	5.38	945.00	175.64	945.00
	42	11	215	2.50	2.50	0.00	0.00	5.54	537.50	97.01	537.50
D	43	12	169	2.00	2.00	0.00	0.00	5.70	338.00	59.29	338.00
	44	13	151	1.50	1.50	0.00	0.00	5.86	226.50	38.64	226.50
	45	14	105	1.00	1.00	0.00	0.00	6.02	105.00	17.44	105.00
	46	15	74	0.50	0.50	0.00	0.00	6.18	37.00	5.98	37.00

SUM	26853.00	7648.65	26790.45	7586.11
SCOP_{on}	3.51	SCOP_{net}	3.53	



Detailed test results

Detailed SCOP part load test results - low temperature application - average climate – EN 14825

Detailed result for 'EN14825:2022' Average Low (A and F) A -7/W34					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Average				
Temperature application:	Low				
Condition name:	A and F				
Condition temperature:	°C	-7			
Part load:	%	88%			
Chosen Tbivalent	°C	-7			
Tdesign	°C	-10			
Pdesign	kW	15.20			
Heating demand:	kW	13.45			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
Included corrections (Final result)					
Heating capacity	kW	13.271			
COP	-	2.642			
Power consumption	kW	5.023			
Measured					
Heating capacity	kW	13.299			
COP	-	2.630			
Power consumption	kW	5.057			
During heating					
Air temperature dry bulb	°C	-7.16			
Air temperature wet bulb	°C	-8.12			
Inlet temperature	°C	29.15			
Outlet temperature	°C	34.06			
Outlet temperature (Time averaged)	°C	34.06			
Circulation pump					
Measured: Static differential pressure, liquid pump	Pa	9410			
Calculated Hydraulic power	W	7			
Calculated global efficiency	η	0.19			
Calculated Capacity correction	W	27			
Calculated Power correction	W	34			
Water Flow	m³/s	0.000694			





Detailed result for 'EN14825:2022' Average Low (B) A 2 /W30			
Tested according to:	EN14511:2022 and EN14825:2022	Average	
Climate zone:		Low	
Temperature application:		B	
Condition name:			
Condition temperature:	°C	2	
Part load:	%	54%	
Chosen Tbivalent	°C	-7	
Tdesign	°C	-10	
Pdesign	kW	15.20	
Heating demand:	kW	8.18	
CR:	-	1.0	
Minimum flow reached:	-	No	
Measurement type:		Transient	
Integrated circulation pump:		Yes	
Included corrections (Final result)			
Heating capacity	kW	8.235	
COP	-	4.589	
Power consumption	kW	1.795	
Measured			
Heating capacity	kW	8.249	
COP	-	4.556	
Power consumption	kW	1.810	
During heating			
Air temperature dry bulb	°C	1.95	
Air temperature wet bulb	°C	0.92	
Inlet temperature	°C	24.97	
Outlet temperature	°C	30.08	
Outlet temperature (Time averaged)	°C	30.08	
Circulation pump			
Measured: Static differential pressure, liquid pump	Pa	5256	
Calculated Hydraulic power	W	2	
Calculated global efficiency	η	0.14	
Calculated Capacity correction	W	13	
Calculated Power correction	W	16	
Water Flow	m³/s	0.000417	





Detailed result for 'EN14825:2022' Average Low (C) A 7 /W27		
Tested according to:	EN14511:2022 and EN14825:2022	Average
Climate zone:		Low
Temperature application:		C
Condition name:		
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	15.20
Heating demand:	kW	5.26
CR:	-	0.8
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated circulation pump:	Yes	
Included corrections (Final result)		
Heating capacity	kW	6.264
COP	-	6.615
Power consumption	kW	0.947
Measured		
Heating capacity	kW	6.266
COP	-	6.601
Power consumption	kW	0.949
During heating		
Air temperature dry bulb	°C	7.04
Air temperature wet bulb	°C	6.02
Inlet temperature	°C	22.80
Outlet temperature	°C	27.77
Outlet temperature (Time averaged)	°C	26.98
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	874
Calculated Hydraulic power	W	0
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	2
Calculated Power correction	W	2
Water Flow	m³/s	0.000303





Detailed result for 'EN14825:2022' Average Low (D) A 12 /W24		
Tested according to:	EN14511:2022 and EN14825:2022	Average
Climate zone:		Low
Temperature application:		D
Condition name:		
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	15.20
Heating demand:	kW	2.34
CR:	-	0.3
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated circulation pump:	Yes	
Included corrections (Final result)		
Heating capacity	kW	7.265
COP	-	8.134
Power consumption	kW	0.893
Measured		
Heating capacity	kW	7.271
COP	-	8.081
Power consumption	kW	0.900
During heating		
Air temperature dry bulb	°C	12.00
Air temperature wet bulb	°C	10.92
Inlet temperature	°C	22.38
Outlet temperature	°C	27.40
Outlet temperature (Time averaged)	°C	23.99
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	2308
Calculated Hydraulic power	W	1
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	6
Calculated Power correction	W	7
Water Flow	m ³ /s	0.000348



Detailed result for 'EN14825:2022' Average Low (E) A -10 /W35

Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Average		
Temperature application:	Low		
Condition name:	E		
Condition temperature:	°C -10		
Part load:	% 100%		
Chosen Tbivalent	°C -7		
Tdesign	°C -10		
Pdesign	kW 15.20		
Heating demand:	kW 15.20		
CR:	- 1.0		
Minimum flow reached:	- No		
Measurement type:	Transient		
Integrated circulation pump:	Yes		
Included corrections (Final result)			
Heating capacity	kW 12.620		
COP	- 2.509		
Power consumption	kW 5.030		
Measured			
Heating capacity	kW 12.640		
COP	- 2.501		
Power consumption	kW 5.055		
During heating			
Air temperature dry bulb	°C -10.23		
Air temperature wet bulb	°C -11.37		
Inlet temperature	°C 29.94		
Outlet temperature	°C 35.02		
Outlet temperature (Time averaged)	°C 35.02		
Circulation pump			
Measured: Static differential pressure, liquid pump	Pa 6527		
Calculated Hydraulic power	W 4		
Calculated global efficiency	η 0.16		
Calculated Capacity correction	W 21		
Calculated Power correction	W 25		
Water Flow	m³/s 0.000619		





Detailed SCOP part load test results - medium temperature application - average climate – EN 14825

Detailed result for 'EN14825:2022' Average Medium (A and F) A -7 /W52					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Average				
Temperature application:	Medium				
Condition name:	A and F				
Condition temperature:	°C	-7			
Part load:	%	88%			
Chosen Tbivalent	°C	-7			
Tdesign	°C	-10			
Pdesign	kW	13.00			
Heating demand:	kW	11.50			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
Included corrections (Final result)					
Heating capacity	kW	11.680			
COP	-	2.012			
Power consumption	kW	5.805			
Measured					
Heating capacity	kW	11.694			
COP	-	2.009			
Power consumption	kW	5.821			
During heating					
Air temperature dry bulb	°C	-7.05			
Air temperature wet bulb	°C	-8.07			
Inlet temperature	°C	44.07			
Outlet temperature	°C	52.29			
Outlet temperature (Time averaged)	°C	52.29			
Circulation pump					
Measured: Static differential pressure, liquid pump	Pa	6527			
Calculated Hydraulic power	W	2			
Calculated global efficiency	η	0.14			
Calculated Capacity correction	W	14			
Calculated Power correction	W	17			
Water Flow	m³/s	0.000361			





Detailed result for 'EN14825:2022' Average Medium (B) A 2 /W42

	EN14511:2022	EN14825:2022
Tested according to:		
Climate zone:		Average
Temperature application:		Medium
Condition name:		B
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	7.00
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:		Transient
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	7.291
COP	-	3.420
Power consumption	kW	2.132
Measured		
Heating capacity	kW	7.296
COP	-	3.414
Power consumption	kW	2.137
During heating		
Air temperature dry bulb	°C	1.91
Air temperature wet bulb	°C	0.91
Inlet temperature	°C	34.04
Outlet temperature	°C	42.18
Outlet temperature (Time averaged)	°C	42.18
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	2485
Calculated Hydraulic power	W	1
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	4
Calculated Power correction	W	5
Water Flow	m³/s	0.000231





Detailed result for 'EN14825:2022' Average Medium (C) A 7/W36

Tested according to:	EN14511:2022	EN14825:2022
Climate zone:		Average
Temperature application:		Medium
Condition name:		C
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	4.50
CR:	-	0.7
Minimum flow reached:	-	No
Measurement type:		Steady State
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	6.028
COP	-	4.935
Power consumption	kW	1.222
Measured		
Heating capacity	kW	6.041
COP	-	4.884
Power consumption	kW	1.237
During heating		
Air temperature dry bulb	°C	6.99
Air temperature wet bulb	°C	6.03
Inlet temperature	°C	29.90
Outlet temperature	°C	37.90
Outlet temperature (Time averaged)	°C	35.87
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	11703
Calculated Hydraulic power	W	2
Calculated global efficiency	η	0.14
Calculated Capacity correction	W	13
Calculated Power correction	W	15
Water Flow	m³/s	0.000182





Detailed result for 'EN14825:2022' Average Medium (D) A 12 /W30

Tested according to:	EN14511:2022	EN14825:2022
Climate zone:		Average Medium
Temperature application:		
Condition name:		D
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	2.00
CR:	-	0.3
Minimum flow reached:	-	No
Measurement type:		Steady State
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	6.889
COP	-	6.019
Power consumption	kW	1.145
Measured		
Heating capacity	kW	6.893
COP	-	6.001
Power consumption	kW	1.149
During heating		
Air temperature dry bulb	°C	12.01
Air temperature wet bulb	°C	11.00
Inlet temperature	°C	27.71
Outlet temperature	°C	35.68
Outlet temperature (Time averaged)	°C	30.03
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	2265
Calculated Hydraulic power	W	0
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	4
Calculated Power correction	W	4
Water Flow	m³/s	0.000208



Detailed result for 'EN14825:2022' Average Medium (E) A -10 /W55

Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Average Medium		
Temperature application:	Medium		
Condition name:	E		
Condition temperature:	°C	-10	
Part load:	%	100%	
Chosen Tbivalent	°C	-7	
Tdesign	°C	-10	
Pdesign	kW	13.00	
Heating demand:	kW	13.00	
CR:	-	1.0	
Minimum flow reached:	-	No	
Measurement type:	Transient		
Integrated circulation pump:	Yes		
Included corrections (Final result)			
Heating capacity	kW	10.531	
COP	-	1.818	
Power consumption	kW	5.792	
Measured			
Heating capacity	kW	10.545	
COP	-	1.816	
Power consumption	kW	5.807	
During heating			
Air temperature dry bulb	°C	-10.00	
Air temperature wet bulb	°C	-11.08	
Inlet temperature	°C	47.07	
Outlet temperature	°C	55.07	
Outlet temperature (Time averaged)	°C	55.07	
Circulation pump			
Measured: Static differential pressure, liquid pump	Pa	6527	
Calculated Hydraulic power	W	2	
Calculated global efficiency	η	0.14	
Calculated Capacity correction	W	13	
Calculated Power correction	W	15	
Water Flow	m ³ /s	0.000329	





Detailed SCOP part load test results - low temperature application - warmer climate – EN 14825

Detailed result for 'EN14825:2022' Warmer Low (B) A 2 /W35		
Tested according to:	EN14511:2022 and EN14825:2022	
Climate zone:		Warmer
Temperature application:		Low
Condition name:		B
Condition temperature:	°C	2
Part load:	%	100%
Chosen Tbivalent	°C	2
Tdesign	°C	2
Pdesign	kW	13.10
Heating demand:	kW	13.10
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:		Transient
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	13.106
COP	-	3.508
Power consumption	kW	3.736
Measured		
Heating capacity	kW	13.134
COP	-	3.482
Power consumption	kW	3.772
During heating		
Air temperature dry bulb	°C	2.08
Air temperature wet bulb	°C	0.83
Inlet temperature	°C	30.07
Outlet temperature	°C	35.08
Outlet temperature (Time averaged)	°C	35.08
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	10206
Calculated Hydraulic power	W	7
Calculated global efficiency	η	0.20
Calculated Capacity correction	W	29
Calculated Power correction	W	36
Water Flow	m³/s	0.000709





Detailed result for 'EN14825:2022' Warmer Low (C) A 7 /W31			
Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Warmer		
Temperature application:	Low		
Condition name:	C		
Condition temperature:	°C 7		
Part load:	% 64%		
Chosen Tbivalent	°C 2		
Tdesign	°C 2		
Pdesign	kW 13.10		
Heating demand:	kW 8.42		
CR:	- 1.0		
Minimum flow reached:	- No		
Measurement type:	Steady State		
Integrated circulation pump:	No		
Included corrections (Final result)			
Heating capacity	kW 8.750		
COP	- 5.514		
Power consumption	kW 1.587		
Measured			
Heating capacity	kW 8.737		
COP	- 5.557		
Power consumption	kW 1.572		
During heating			
Air temperature dry bulb	°C 6.99		
Air temperature wet bulb	°C 6.01		
Inlet temperature	°C 26.03		
Outlet temperature	°C 31.04		
Outlet temperature (Time averaged)	°C 31.04		
Circulation pump			
Measured: Static differential pressure, liquid pump	Pa 4732		
Calculated Hydraulic power	W 2		
Calculated global efficiency	η 0.14		
Calculated Capacity correction	W -12		
Calculated Power correction	W -14		
Water Flow	m³/s 0.000419		



Detailed SCOP part load test results - low temperature application - colder climate – EN 14825

Detailed result for 'EN14825:2022' Colder Low (A) A -7 /W30					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Colder				
Temperature application:	Low				
Condition name:	A				
Condition temperature:	°C	-7			
Part load:	%	61%			
Chosen Tbivalent	°C	-15			
Tdesign	°C	-22			
Pdesign	kW	13.70			
Heating demand:	kW	8.29			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
Included corrections (Final result)					
Heating capacity	kW	8.383			
COP	-	3.315			
Power consumption	kW	2.529			
Measured					
Heating capacity	kW	8.386			
COP	-	3.312			
Power consumption	kW	2.532			
During heating					
Air temperature dry bulb	°C	-6.91			
Air temperature wet bulb	°C	-8.13			
Inlet temperature	°C	25.01			
Outlet temperature	°C	30.13			
Outlet temperature (Time averaged)	°C	30.13			
Circulation pump					
Measured: Static differential pressure, liquid pump	Pa	694			
Calculated Hydraulic power	W	0			
Calculated global efficiency	η	0.12			
Calculated Capacity correction	W	2			
Calculated Power correction	W	2			
Water Flow	m³/s	0.000411			





Detailed result for 'EN14825:2018' Colder Low (F and G) A -15/W32

Tested according to:	EN14825:2018	
Climate zone:	Colder	Low
Temperature application:	F and G	
Condition name:		
Condition temperature:	°C	-15
Part load:	%	82%
Chosen Tbivalent	°C	-15
Tdesign	°C	-22
Pdesign	kW	13.70
Heating demand:	kW	11.18
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated circulation pump:	Yes	
Included corrections (Final result)		
Heating capacity	kW	11.301
COP	-	2.497
Power consumption	kW	4.526
Measured		
Heating capacity	kW	11.328
COP	-	2.484
Power consumption	kW	4.560
During heating		
Air temperature dry bulb	°C	-15.10
Air temperature wet bulb	°C	-14.89
Inlet temperature	°C	27.01
Outlet temperature	°C	32.09
Outlet temperature (Time averaged)	°C	32.09
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	12070
Calculated Hydraulic power	W	6
Calculated global efficiency	n	0.19
Calculated Capacity correction	W	27
Calculated Power correction	W	34
Water Flow	m³/s	0.000536





Detailed COP test results - low temperature – EN 14511

Detailed result for 'EN14511:2022' A7/W35		
Tested according to:		EN14511:2022
Minimum flow reached:		No
Measurement type:		Steady State
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	15.707
COP	-	4.498
Power consumption	kW	3.492
Measured		
Heating capacity	kW	15.749
COP	-	4.438
Power consumption	kW	3.549
During heating		
Air temperature dry bulb	°C	6.98
Air temperature wet bulb	°C	5.85
Inlet temperature	°C	29.99
Outlet temperature	°C	34.96
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	20390
Calculated Hydraulic power	W	16
Calculated global efficiency	η	0.27
Calculated Capacity correction	W	41
Calculated Power correction	W	57
Water Flow	m³/s	0.000763




Detailed COP test results - medium temperature – EN 14511

Detailed result for 'EN14511:2022' A7/W55		
Tested according to:		EN14511:2022
Minimum flow reached:		No
Measurement type:		Steady State
Integrated circulation pump:		Yes
Included corrections (Final result)		
Heating capacity	kW	16.139
COP	-	2.854
Power consumption	kW	5.654
Measured		
Heating capacity	kW	16.152
COP	-	2.849
Power consumption	kW	5.669
During heating		
Air temperature dry bulb	°C	6.92
Air temperature wet bulb	°C	5.91
Inlet temperature	°C	47.01
Outlet temperature	°C	54.85
Circulation pump		
Measured: Static differential pressure, liquid pump	Pa	4062
Calculated Hydraulic power	W	2
Calculated global efficiency	η	0.14
Calculated Capacity correction	W	13
Calculated Power correction	W	15
Water Flow	m³/s	0.000500



Detailed test results of sound power measurement – Test N#1

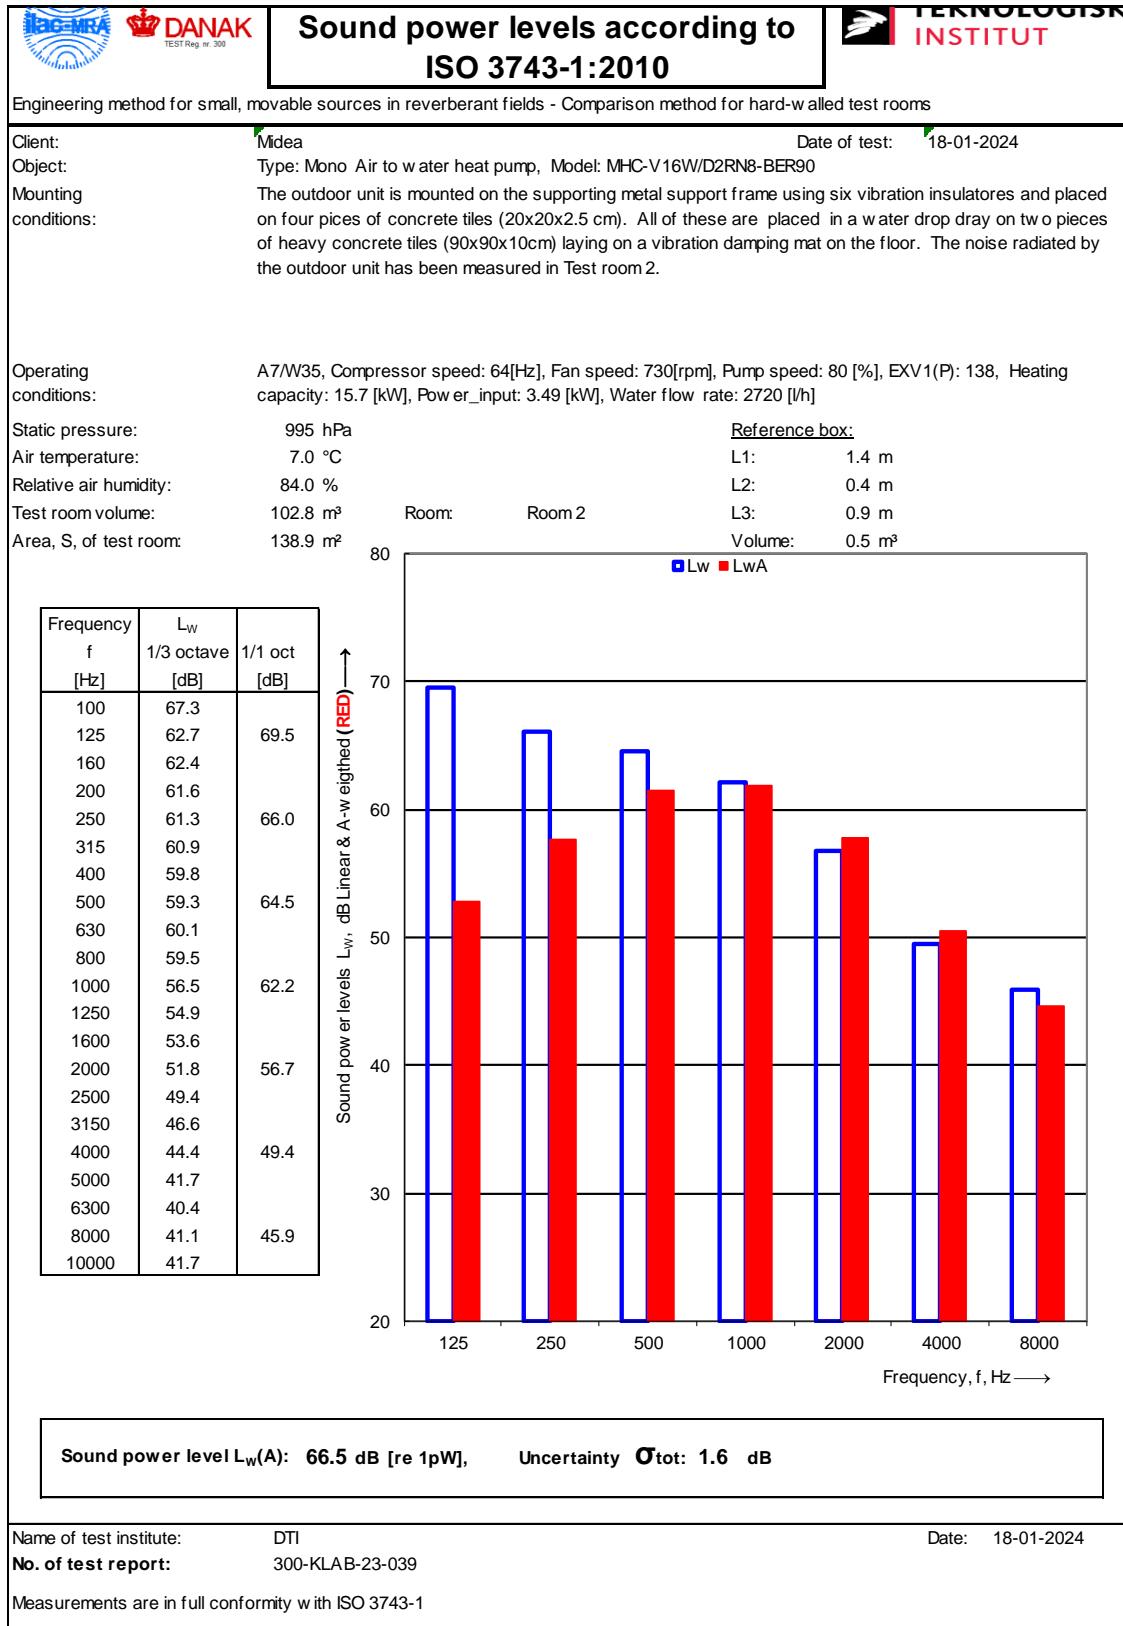



Detailed test results of sound power measurement – Test N#2

DANAK TEST Reg. nr. 300		Sound power levels according to ISO 3743-1:2010		TEST INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:	Midea	Date of test:	18-01-2024																																																																				
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																						
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																						
Operating conditions:	A7/W35, Compressor speed: 24[Hz], Fan speed: 400[rpm], Pump speed: 50 [%], EXV1(P): 94, Heating capacity: 5.67 [kW], Power_input: 1.16 [kW], Water flow rate: 980 [l/h]																																																																						
Static pressure:	995 hPa	<u>Reference box:</u>																																																																					
Air temperature:	7.0 °C	L1:	1.4 m																																																																				
Relative air humidity:	84.0 %	L2:	0.4 m																																																																				
Test room volume:	102.8 m ³	Room:	Room 2	L3:	0.9 m																																																																		
Area, S, of test room:	138.9 m ²			Volume:	0.5 m ³																																																																		
<table border="1"> <caption>Data extracted from the sound power level chart</caption> <thead> <tr> <th>Frequency f [Hz]</th> <th>Lw(A) [dB]</th> <th>Lw(A-weighted) [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>57.9</td><td>49.8</td></tr> <tr><td>125</td><td>49.8</td><td>47.2</td></tr> <tr><td>160</td><td>47.2</td><td>48.9</td></tr> <tr><td>200</td><td>48.9</td><td>47.8</td></tr> <tr><td>250</td><td>52.7</td><td>47.0</td></tr> <tr><td>315</td><td>50.9</td><td>47.4</td></tr> <tr><td>400</td><td>50.9</td><td>46.2</td></tr> <tr><td>500</td><td>50.9</td><td>44.4</td></tr> <tr><td>630</td><td>50.9</td><td>43.1</td></tr> <tr><td>800</td><td>50.9</td><td>43.1</td></tr> <tr><td>1000</td><td>45.4</td><td>39.5</td></tr> <tr><td>1250</td><td>45.4</td><td>37.1</td></tr> <tr><td>1600</td><td>38.9</td><td>36.0</td></tr> <tr><td>2000</td><td>38.9</td><td>34.2</td></tr> <tr><td>2500</td><td>38.9</td><td>30.5</td></tr> <tr><td>3150</td><td>38.9</td><td>27.2</td></tr> <tr><td>4000</td><td>30.4</td><td>25.5</td></tr> <tr><td>5000</td><td>30.4</td><td>23.5</td></tr> <tr><td>6300</td><td>30.4</td><td>31.4</td></tr> <tr><td>8000</td><td>35.0</td><td>31.4</td></tr> <tr><td>10000</td><td>35.0</td><td>26.3</td></tr> </tbody> </table>						Frequency f [Hz]	Lw(A) [dB]	Lw(A-weighted) [dB]	100	57.9	49.8	125	49.8	47.2	160	47.2	48.9	200	48.9	47.8	250	52.7	47.0	315	50.9	47.4	400	50.9	46.2	500	50.9	44.4	630	50.9	43.1	800	50.9	43.1	1000	45.4	39.5	1250	45.4	37.1	1600	38.9	36.0	2000	38.9	34.2	2500	38.9	30.5	3150	38.9	27.2	4000	30.4	25.5	5000	30.4	23.5	6300	30.4	31.4	8000	35.0	31.4	10000	35.0	26.3
Frequency f [Hz]	Lw(A) [dB]	Lw(A-weighted) [dB]																																																																					
100	57.9	49.8																																																																					
125	49.8	47.2																																																																					
160	47.2	48.9																																																																					
200	48.9	47.8																																																																					
250	52.7	47.0																																																																					
315	50.9	47.4																																																																					
400	50.9	46.2																																																																					
500	50.9	44.4																																																																					
630	50.9	43.1																																																																					
800	50.9	43.1																																																																					
1000	45.4	39.5																																																																					
1250	45.4	37.1																																																																					
1600	38.9	36.0																																																																					
2000	38.9	34.2																																																																					
2500	38.9	30.5																																																																					
3150	38.9	27.2																																																																					
4000	30.4	25.5																																																																					
5000	30.4	23.5																																																																					
6300	30.4	31.4																																																																					
8000	35.0	31.4																																																																					
10000	35.0	26.3																																																																					
Sound power level Lw(A): 51.5 dB [re 1pW], Uncertainty Δtot: 1.6 dB																																																																							
Name of test institute:	DTI	Date:	18-01-2024																																																																				
No. of test report:	300-KLAB-23-039																																																																						
Measurements are in full conformity with ISO 3743-1																																																																							






Detailed test results of sound power measurement – Test N#3

Sound power levels according to ISO 3743-1:2010		TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client:	Midea	Date of test:	18-01-2024																																																																		
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																				
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																				
Operating conditions:	A7/W55, Compressor speed: 72[Hz], Fan speed: 650[rpm], Pump speed: 50 [%], EXV1(P): 128, Heating capacity: 16.14 [kW], Power_input: 5.65 [kW], Water flow rate: 1790 [l/h]																																																																				
Static pressure:	996 hPa	Reference box:																																																																			
Air temperature:	7.0 °C	L1:	1.4 m																																																																		
Relative air humidity:	84.0 %	L2:	0.4 m																																																																		
Test room volume:	102.8 m³	Room:	Room 2																																																																		
Area, S, of test room:	138.9 m²	L3:	0.9 m																																																																		
		Volume:	0.5 m³																																																																		
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>Lw [dB]</th><th>LwA [dB]</th></tr></thead><tbody><tr><td>100</td><td>67.3</td><td>59.5</td></tr><tr><td>125</td><td>64.4</td><td>57.4</td></tr><tr><td>160</td><td>66.0</td><td>57.4</td></tr><tr><td>200</td><td>63.1</td><td>57.4</td></tr><tr><td>250</td><td>59.5</td><td>57.4</td></tr><tr><td>315</td><td>59.2</td><td>57.4</td></tr><tr><td>400</td><td>58.6</td><td>57.4</td></tr><tr><td>500</td><td>57.4</td><td>57.4</td></tr><tr><td>630</td><td>59.6</td><td>57.4</td></tr><tr><td>800</td><td>57.1</td><td>57.4</td></tr><tr><td>1000</td><td>54.4</td><td>57.4</td></tr><tr><td>1250</td><td>52.4</td><td>57.4</td></tr><tr><td>1600</td><td>51.6</td><td>57.4</td></tr><tr><td>2000</td><td>49.8</td><td>57.4</td></tr><tr><td>2500</td><td>49.1</td><td>57.4</td></tr><tr><td>3150</td><td>46.3</td><td>57.4</td></tr><tr><td>4000</td><td>44.9</td><td>57.4</td></tr><tr><td>5000</td><td>39.9</td><td>57.4</td></tr><tr><td>6300</td><td>38.9</td><td>57.4</td></tr><tr><td>8000</td><td>40.7</td><td>57.4</td></tr><tr><td>10000</td><td>41.7</td><td>57.4</td></tr></tbody></table>				Frequency f [Hz]	Lw [dB]	LwA [dB]	100	67.3	59.5	125	64.4	57.4	160	66.0	57.4	200	63.1	57.4	250	59.5	57.4	315	59.2	57.4	400	58.6	57.4	500	57.4	57.4	630	59.6	57.4	800	57.1	57.4	1000	54.4	57.4	1250	52.4	57.4	1600	51.6	57.4	2000	49.8	57.4	2500	49.1	57.4	3150	46.3	57.4	4000	44.9	57.4	5000	39.9	57.4	6300	38.9	57.4	8000	40.7	57.4	10000	41.7	57.4
Frequency f [Hz]	Lw [dB]	LwA [dB]																																																																			
100	67.3	59.5																																																																			
125	64.4	57.4																																																																			
160	66.0	57.4																																																																			
200	63.1	57.4																																																																			
250	59.5	57.4																																																																			
315	59.2	57.4																																																																			
400	58.6	57.4																																																																			
500	57.4	57.4																																																																			
630	59.6	57.4																																																																			
800	57.1	57.4																																																																			
1000	54.4	57.4																																																																			
1250	52.4	57.4																																																																			
1600	51.6	57.4																																																																			
2000	49.8	57.4																																																																			
2500	49.1	57.4																																																																			
3150	46.3	57.4																																																																			
4000	44.9	57.4																																																																			
5000	39.9	57.4																																																																			
6300	38.9	57.4																																																																			
8000	40.7	57.4																																																																			
10000	41.7	57.4																																																																			
<p>Sound power level $L_w(A)$: 65.2 dB [re 1pW], Uncertainty σ_{tot}: 1.6 dB</p>																																																																					
Name of test institute:	DTI	Date:	18-01-2024																																																																		
No. of test report:	300-KLAB-23-039																																																																				
Measurements are in full conformity with ISO 3743-1																																																																					





Detailed test results of sound power measurement – Test N#4

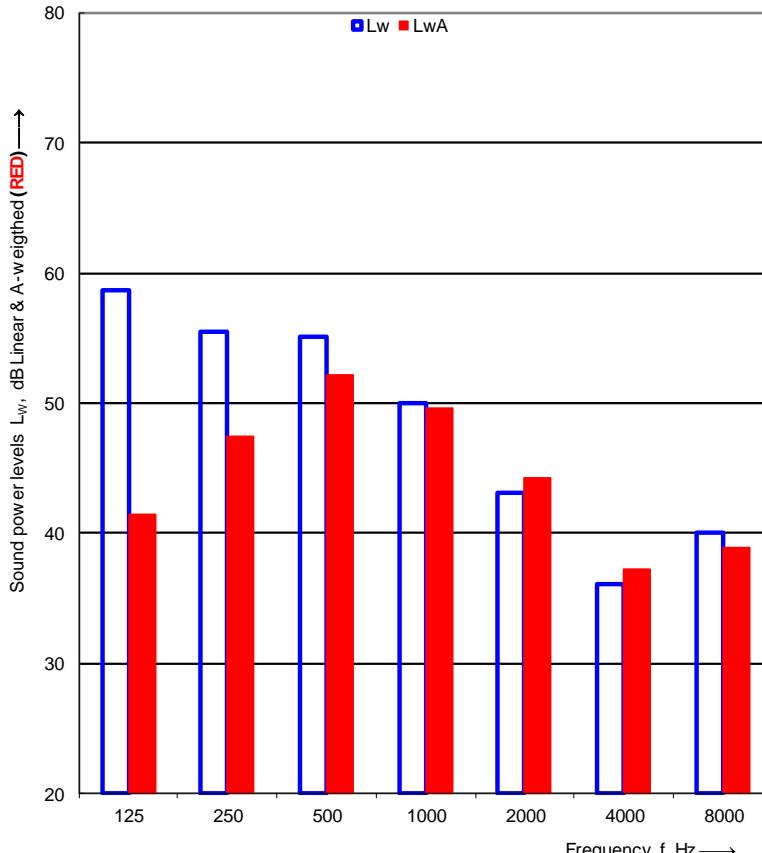  TEST Reg. nr. 300		Sound power levels according to ISO 3743-1:2010		 TEKNOLOGISK INSTITUT																																																																		
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																						
Client:	Midea	Date of test:	18-01-2024																																																																			
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																					
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																					
Operating conditions:	A7/W55, Compressor speed: 32[Hz], Fan speed: 450[rpm], Pump speed: 30 [%], EXV1(P): 92, Heating capacity: 7.1 [kW], Power_input: 2.34 [kW], Water flow rate: 765 [l/h]																																																																					
Static pressure:	996 hPa	Reference box:																																																																				
Air temperature:	7.0 °C	L1:	1.4 m																																																																			
Relative air humidity:	84.0 %	L2:	0.4 m																																																																			
Test room volume:	102.8 m³	Room:	Room 2	L3: 0.9 m																																																																		
Area, S, of test room:	138.9 m²	Volume:	0.5 m³																																																																			
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	 <p>The chart displays sound power levels L_w in dB on a logarithmic scale from 100 Hz to 10000 Hz. Blue bars represent the linear L_w values, and red bars represent the A-weighted L_wA values. The levels generally decrease as frequency increases, with a notable peak around 125 Hz and another around 500 Hz.</p> <table border="1"><caption>Data extracted from the sound power level chart</caption><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>L_wA 1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>56.7</td><td>58.6</td></tr><tr><td>125</td><td>52.6</td><td>55.5</td></tr><tr><td>160</td><td>49.0</td><td>51.1</td></tr><tr><td>200</td><td>49.5</td><td>50.1</td></tr><tr><td>250</td><td>51.4</td><td>48.9</td></tr><tr><td>315</td><td>51.1</td><td>51.5</td></tr><tr><td>400</td><td>50.1</td><td>47.8</td></tr><tr><td>500</td><td>55.1</td><td>44.0</td></tr><tr><td>630</td><td>51.5</td><td>41.7</td></tr><tr><td>800</td><td>55.1</td><td>40.2</td></tr><tr><td>1000</td><td>50.0</td><td>38.5</td></tr><tr><td>1250</td><td>44.0</td><td>34.5</td></tr><tr><td>1600</td><td>41.7</td><td>33.5</td></tr><tr><td>2000</td><td>43.1</td><td>30.9</td></tr><tr><td>2500</td><td>40.0</td><td>27.9</td></tr><tr><td>3150</td><td>36.1</td><td>35.1</td></tr><tr><td>4000</td><td>33.5</td><td>35.7</td></tr><tr><td>5000</td><td>30.9</td><td>35.0</td></tr><tr><td>6300</td><td>27.9</td><td></td></tr><tr><td>8000</td><td>36.1</td><td></td></tr><tr><td>10000</td><td>33.5</td><td></td></tr></tbody></table>		Frequency f [Hz]	L_w 1/3 octave [dB]	L_wA 1/1 oct [dB]	100	56.7	58.6	125	52.6	55.5	160	49.0	51.1	200	49.5	50.1	250	51.4	48.9	315	51.1	51.5	400	50.1	47.8	500	55.1	44.0	630	51.5	41.7	800	55.1	40.2	1000	50.0	38.5	1250	44.0	34.5	1600	41.7	33.5	2000	43.1	30.9	2500	40.0	27.9	3150	36.1	35.1	4000	33.5	35.7	5000	30.9	35.0	6300	27.9		8000	36.1		10000	33.5	
Frequency f [Hz]	L_w 1/3 octave [dB]	L_wA 1/1 oct [dB]																																																																				
100	56.7	58.6																																																																				
125	52.6	55.5																																																																				
160	49.0	51.1																																																																				
200	49.5	50.1																																																																				
250	51.4	48.9																																																																				
315	51.1	51.5																																																																				
400	50.1	47.8																																																																				
500	55.1	44.0																																																																				
630	51.5	41.7																																																																				
800	55.1	40.2																																																																				
1000	50.0	38.5																																																																				
1250	44.0	34.5																																																																				
1600	41.7	33.5																																																																				
2000	43.1	30.9																																																																				
2500	40.0	27.9																																																																				
3150	36.1	35.1																																																																				
4000	33.5	35.7																																																																				
5000	30.9	35.0																																																																				
6300	27.9																																																																					
8000	36.1																																																																					
10000	33.5																																																																					
Sound power level $L_w(A)$: 55.6 dB [re 1pW], Uncertainty σ_{tot} : 1.6 dB																																																																						
Name of test institute:	DTI	Date:	18-01-2024																																																																			
No. of test report:	300-KLAB-23-039																																																																					
Measurements are in full conformity with ISO 3743-1																																																																						





Appendix 1

Unit specification

Type of unit: Mono air to water heat pump

Manufacturer: Midea

Size of the heat pump: 0.4 x 0.9 x 1.3m (W x L x H)

Year of production: n/a.


Operating conditions and environment

The operating conditions of the unit under test fulfill the requirements for Class A.

The acoustic test chamber is a hard wall reverberant room (103 m³) and equipped with relevant sound diffusing reflector panels. The acoustical test chamber fulfills the requirements of ISO3743-1 accuracy grade 2 (engineering grade).

The measurements of the average sound pressure levels in 1/3 octave frequency bands are carried out using three microphones in the test chamber. During the measurements, the microphones are traversed up and down for one meter in the arc of a quarter circle.

The picture below shows the installation of the unit during test, position of microphones, sound diffusing reflector panels, and the reference sound source.

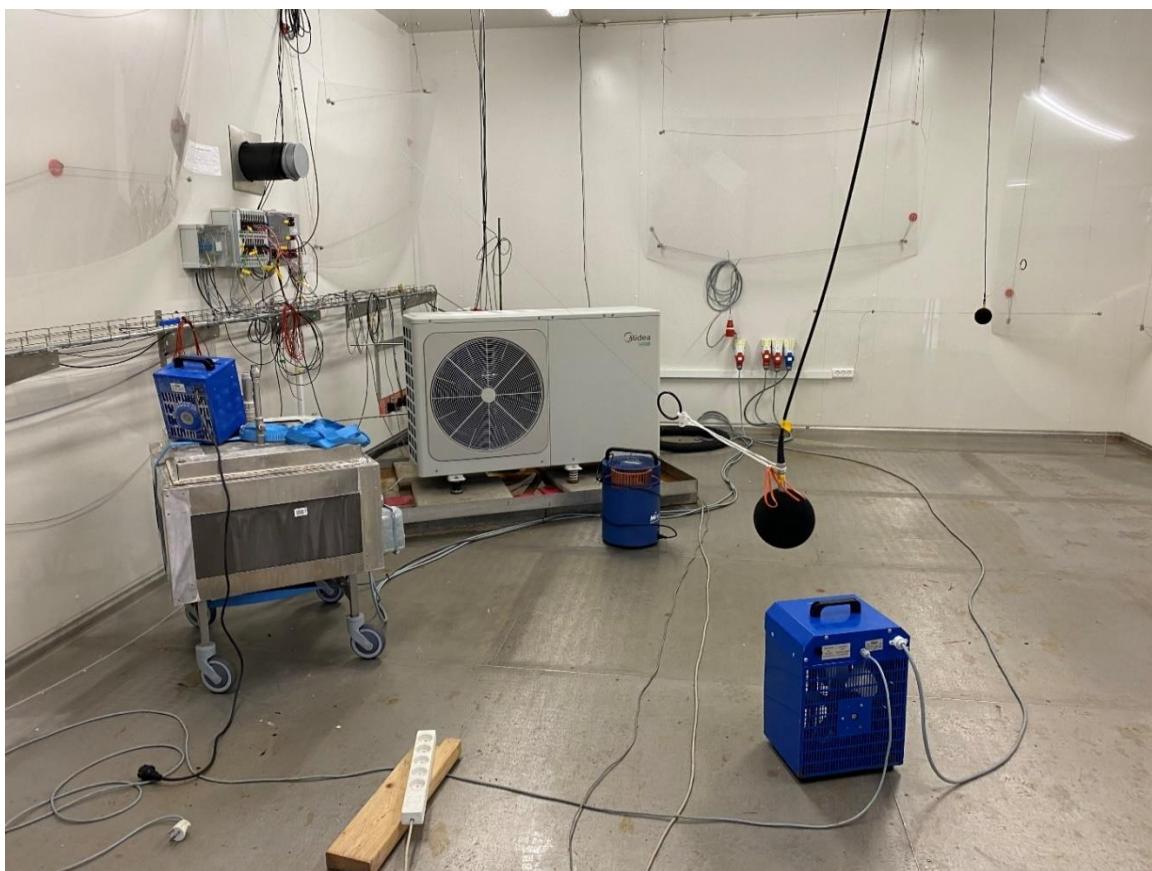



Measurement instruments

Id nr.	Manufacturer	Description	Calibration company
100864	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100865	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100866	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100867*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100868*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100869*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100870	GRAS	Gras 40AE_26CA, ½" free field microphone, Roof monitor	Norsonic A/S, Norway
100873*	Brüel & Kjær	Acoustical calibrator, Brüel & Kjær 4231	Element Metech, Denmark
100859	Norsonic	Reference sound source, Norsonic Nor278 Room 1	RISE, Sweden
100872*	Norsonic	Reference sound source, Norsonic Nor278 Room 2	RISE, Sweden
100620*	Norsonic	Multi-channel measurement system Nor850	Norsonic A/S, Norway

*Instruments are used for the actual measurements for the calculation of the test results.

The other instruments are used for control measurements.

All microphones are equipped with windshields.



Test Procedure

The measurements of the emitted sound power level from the heat pump are carried out according to the following standard:

- DS/EN 14511:2022
- EN 12102-1:2022
- ISO/EN 3743-1:2010

The basic acoustic measurement standard DS/EN 3743-1 is a comparison method using a calibrated reference sound source. Two series of sound pressure measurements are made under exactly the same acoustic conditions, e.g., the same microphone positions, temperature and air humidity. The calibrated sound power levels are known for the reference sound source at each frequency band, and they are used in the estimation of the acoustical correction factor for the calculation of the sound power emitted from the unit under test. The background noise levels are measured and used for relevant corrections.

The final total A-weighted sound power level is based on measurements and calculations in 1/3-octave levels, which then are summed into 1/1-octave levels. The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz.

The actual microphone positions and correction values are saved in data files linked to the complete project documentation according to the DANAK-accreditation.

The complete measurement system is documented and regularly calibrated according to DANAK.

The detailed description of the measurement method is given in Danish in the quality database system "QA Web" at Danish Technological Institute, which is accessible by DANAK.

Measurement uncertainty

The uncertainty of sound power level in decibel is determined in accordance with ISO 3743-1, equation 22 $\sigma_{tot} = \sqrt{\sigma_{RO}^2 + \sigma_{omc}^2}$ where:

- σ_{RO} is the standard deviation of the reproducibility of the method
- σ_{omc} is the standard deviation describing the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test.

σ_{RO} expresses the uncertainty in test results delivered by the different accredited test laboratories due to different instrumentation and implementation of measurement procedure as well different radiation characteristics of the noise source during test.

σ_{omc} expresses the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test. The mounting and installation conditions in two DTI acoustical test chambers are well defined in the test procedure. Possible instability of the operating conditions is monitored and assessed prior to each noise test.



DANISH
TECHNOLOGICAL
INSTITUTE

Page 43 of 44
300-KLAB-23-039-3 rev 2.

The test uncertainty σ_{omc} is calculated according to ISO3743-1 Annex C formula C.1 and is typically below 0.5dB. However, the uncertainty is rounded up to the nearest 0.5dB increment in the report. As pr. Table C.1 (accuracy grade 2), the uncertainty σ_{RO} is set to 1.5.

The expanded uncertainty U is calculated according to ISO 3743-1 equation 23:
 $U = k \sigma_{tot}$ where $k = 2$ for 95% confidence.

EXAMPLE: $\sigma_{tot}: \sqrt{1.5^2 + 0.5^2} = 1.6 \text{ dB}$ and $U(95\%) = 3.2 \text{ dB}$

Note: The expanded uncertainty does not include the standard deviation of production which is used in ISO4871 for the purpose of making noise declaration for batches of machines.



Appendix 2

Product declaration consistency

Dear Sir or Madam,

We as GD Midea Heating & Ventilating Equipment Co., Ltd..

We declared the below products are the same except model no., nameplate specification and address different.

Monobloc heat pump:

Midea Model	Noxa Model
MHC-V4W/D2N8-BE30	NXHPM-V4W/D2N8-BE30
MHC-V6W/D2N8-BE30	NXHPM-V6W/D2N8-BE30
MHC-V8W/D2N8-BE30	NXHPM-V8W/D2N8-BE30
MHC-V10W/D2N8-BE30	NXHPM-V10W/D2N8-BE30
MHC-V12W/D2N8-BE30	NXHPM-V12W/D2N8-BE30
MHC-V14W/D2N8-BE30	NXHPM-V14W/D2N8-BE30
MHC-V16W/D2N8-BE30	NXHPM-V16W/D2N8-BE30
MHC-V12W/D2RN8-BER90	NXHPM-V12W/D2RN8-BER90
MHC-V14W/D2RN8-BER90	NXHPM-V14W/D2RN8-BER90
MHC-V16W/D2RN8-BER90	NXHPM-V16W/D2RN8-BER90
MHC-V18W/D2RN8	NXHPM-V18W/D2RN8
MHC-V22W/D2RN8	NXHPM-V22W/D2RN8
MHC-V26W/D2RN8	NXHPM-V26W/D2RN8
MHC-V30W/D2RN8	NXHPM-V30W/D2RN8

Company name:

GD Midea Heating & Ventilating Equipment Co., Ltd.

Address:

Penglai Industry Road, Beijiao, Shunde, Foshan, Guangdong
528311, P. R. China

Contact person: Ted

Tel no.: +86 18824826247

Date: 2024. 4.10

Thank you very much for your attention.



RAPORT Z TESTU

[logo]

Nr raportu:
300-KLAB-23-039-3

Teknologiparken
Kongsvang Allé 29
DK-8000 Aarhus C
+45 72 20 20 00
Info@teknologisk.dk
www.teknologisk.dk

Strona 1 z 43
Nazwa: PRES/RTHI
Nr pliku: 226006
Załączniki: 2

Klient: Firma: GD MIDEA HEATING & VENTILATING EQUIPMENT CO., LTD.
Adres: Penglai Industry Road, Beijiao
Miasto: Shunde, Foshan, Guangdong, 528311, Chiny
Tel: +86 13902810522

Testowane urządzenie: Marka: Midea
Typ: Pompa ciepła powietrze-woda (monoblok)
Model: MHC-V16W/D2RN8-B
Nr serii: 541K814480238190100003
Rok prod.: Jednostka zewnętrzna: NIE DOTYCZY

Daty: Okres testowy: grudzień 2023 r. - styczeń 2024 r.

Nazwa marki: Marka: NOXA
Typ: Pompa ciepła powietrze-woda (monoblok)
Model: NXHPM-V16W/D2RN8-B

Procedury Patrz cel (strona 2), aby zapoznać się z listą standardów.

Uwagi: Urządzenie zostało dostarczone przez klienta. Instalacja i ustawienia testowe zostały wykonane zgodnie z instrukcjami klienta. Pomiędzy każdym testem klient zmieniał różne parametry, takie jak prędkość sprężarki, zawór rozprężny, prędkość wentylatora, prędkość pompy, czas odszczepiania, czas ogrzewania. Raport dla testowanej jednostki nosi nazwę 300-KLAB-23-039 i został wydany 2024.03.21 Proszę również zapoznać się z załącznikiem 2.

Warunki: Niniejszy test został przeprowadzony w ramach akredytacji zgodnie z międzynarodowymi wymogami (ISO/IEC 17025:2017) oraz zgodnie z Ogólnymi Warunkami Duńskiego Instytutu Technologicznego. Wyniki testu odnoszą się wyłącznie do testowanego elementu. Niniejszy raport z testów może być cytowany we fragmentach wyłącznie za pisemną Duńskiego Instytutu Technologicznego.

Klient nie może wspominać ani odnosić się do Duńskiego Instytutu Technologicznego lub pracowników Instytutu Technologicznego w celach reklamowych lub marketingowych, chyba że Duńskiego Instytutu Technologicznego udzielił pisemnej zgody w każdym przypadku.

Dział/Centrum: Duński Instytut Technologiczny
Energia i klimat
Laboratorium pomp ciepła, Aarhus **Data:** 2024.04.17

Podpis:
Preben Eskerod
B.TecMan & MarEng

Współczytelnik:
Rasmus Thisgaard
B.TecMan & MarEng



[logo]
Test nr rej. 300

Cel

Celem niniejszego raportu jest udokumentowanie następujących kwestii:

Sezonowy współczynnik wydajności (SCOP) przy zastosowaniu w niskiej i średniej temperaturze dla klimatu umiarkowanego zgodnie z normą EN 14825:2022.

W celu obliczenia SCOP przeprowadzono testy w warunkach obciążenia częściowego podanych w tabelach na stronie 5 i 6.

Test obciążenia częściowego SCOP w warunkach $scop_B$ i $scop_C$ w aplikacji niskotemperaturowej dla cieplejszego klimatu zgodnie z EN 14825:2022.

Warunki testu obciążenia częściowego SCOP dla $scop_A$ i $scop_{F/G}$ w niskiej temperaturze dla chłodniejszego klimatu zgodnie z EN 14825:2022.

Standardowe warunki znamionowe testu COP A7/W35 i A7/W55 zgodnie z normą EN 14511:2022.

Wymagania eksploatacyjne zgodnie z normą EN 14511-4:2022

- 4.2.1 Testy rozruchowe i eksploatacyjne
- 4.5 Odcięcie przepływu nośnika ciepła
- 4.6 Całkowita awaria zasilania

Pomiary mocy akustycznej zgodnie z normą EN 12102-1:2022.



Szczegółowe wyniki testów	19
Szczegółowe wyniki testu obciążenia częściowego SCOP - zastosowanie w niskiej temperaturze - umiarkowany klimat - EN 14825...19	
Szczegółowe wyniki testu obciążenia częściowego SCOP - zastosowanie w umiarkowanej temperaturze - umiarkowany klimat - EN 14825.....24	
Szczegółowe wyniki testu obciążenia częściowego SCOP - zastosowanie w niskiej temperaturze - cieplejszy klimat - EN 1482529	
Szczegółowe wyniki testu obciążenia częściowego SCOP - zastosowanie w niskich temperaturach - chłodniejszy klimat - EN 14825..31	
Szczegółowe wyniki testu COP - niska temperatura - EN 14511	33
Szczegółowe wyniki testu COP - średnia temperatura - EN 14511.....	34
Szczegółowe wyniki pomiaru mocy akustycznej – Test nr 1.....	35
Szczegółowe wyniki pomiaru mocy akustycznej - Test nr 2.....	36
Szczegółowe wyniki pomiaru mocy akustycznej - Test nr 3.....	37
Szczegółowe wyniki pomiaru mocy akustycznej - Test nr 4.....	38
Załącznik 1	39
Załącznik 2	43



Warunki testu**Warunki testowe SCOP dla niskich temperatur - EN 14825**

Warunki obciążenia częściowego dla referencyjnego SCOP i referencyjnego SCOPon do obliczeń jednostek powietrze-woda do zastosowań niskotemperaturowych dla referencyjnego sezonu grzewczego;

"A" = umiarkowany, "W" = cieplejszy, a "C" = zimniejszy klimat.

	Współczynnik obciążenia częściowego w %				Zewnętrzny wymiennik ciepła		Wewnętrzny wymiennik ciepła			
					Temperatura termometru suchego (mokrego) °C	Stałý wylot °C	Zmienny wylot °C			
	Wzór	Umiarkowany klimat	Cieplejszy klimat	Zimniejszy klimat			Wszystkie klimaty	Umiarkowany klimat	Cieplejszy klimat	Zimniejszy klimat
A	(-7-16)/ (Tdesignh – 16)	88,46	nie dotyczy	60,53	-7(-8)	20(12)	a / 35	a / 34	nie dotyczy	a / 30
B	(+2 -16) / (Tdesignh – 16)	53,85	100,00	36,84	2(1)	20(12)	a / 35	a / 30	a / 35	a /27
C	(+7-16)/ (Tdesignh – 16)	34,62	64,29	23,68	7(6)	20(12)	a / 35	a / 27	a / 31	a/25
D	(+12- 16) / (Tdesignh – 16)	15,38	28,57	10,53	12(11)	20(12)	a / 35	a / 24	a / 26	a /24
E	(TOLe- 16) / (Tdesignh – 16)				TOLe	20(12)	a / 35	a/b	a/b	a/b
F	(Tbiv- 16) / (Tdesignh – 16)				Tbiv	20(12)	a / 35	a/c	a/c	a/c
G	(-15-16) / (Tdesignh – 16)	nie dotyczy	nie dotyczy	81,58	-15	20(12)	a / 35	nie dotyczy	nie dotyczy	a/32

Dodatkowe informacje

Klimat	Tdesignh [°C]	Tbivalent [°C]	TOL [°C]	Temperatura na wylocie	Natężenie przepływu
Umiarkowany	-10	-7	-10	Zmienna	Zmienna
Zimniejszy	-22	-15	-22	Zmienna	Zmienna
Cieplejszy	2	7	2	Zmienna	Zmienna

RUD



Warunki testowe SCOP dla umiarkowanych temperatur - EN 14825

Warunki obciążenia częściowego dla referencyjnego SCOP i referencyjnego SCOPon do obliczeń jednostek powietrze-woda do zastosowań w temperaturach umiarkowanych dla referencyjnego sezonu grzewczego;

"A" = umiarkowany, "W" = cieplejszy, a "C" = zimniejszy klimat.

	Współczynnik obciążenia częściowego w %				Zewnętrzny wymiennik ciepła		Wewnętrzny wymiennik ciepła			
					Temperatura termometru suchego (mokrego) °C	Stał wylot °C	Zmienny wylot d °C			
	Wzór	Umiarkowany klimat	Cieplejszy klimat	Zimniejszy klimat			Wszystkie klimaty	Umiarkowany klimat	Cieplejszy klimat	Zimniejszy klimat
A	(-7-16)/ (Tdesignh – 16)	88,46	nie dotyczy	60,53	-7(-8)	20(12)	a / 55	a / 52	nie dotyczy	a / 44
B	(+2 -16) / (Tdesignh – 16)	53,85	100,00	36,84	2(1)	20(12)	a / 55	a / 42	a / 55	a /37
C	(+7-16)/ (Tdesignh – 16)	34,62	64,29	23,68	7(6)	20(12)	a / 55	a / 36	a / 46	a/32
D	(+12- 16) / (Tdesignh – 16)	15,38	28,57	10,53	12(11)	20(12)	a / 55	a / 30	a / 34	a /28
E	(TOLe- 16) / (Tdesignh – 16)				TOLe	20(12)	a / 55	a/b	a/b	a/b
F	(Tbiv- 16) / (Tdesignh – 16)				Tbiv	20(12)	a / 55	a/c	a/c	a/c
G	(-15-16) / (Tdesignh – 16)	nie dotyczy	nie dotyczy	81,58	-15	20(12)	a / 55	nie dotyczy	nie dotyczy	a/49

Dodatkowe informacje

Klimat	Tdesignh [°C]	Tbivalent [°C]	TOL [°C]	Temperatura na wylotie	Natężenie przepływu
Średnia	-10	-7	-10	Zmienna	Zmienna



Warunki testu COP - niska temperatura - EN 14511

Nr	Źródło ciepła		Radiator	
	Temperatura termometru suchego na wlocie (°C)	Temperatura termometru mokrego na wlocie (°C)	Temperatura na wlocie (°C)	Temperatura na wylocie (°C)
1S	7	6	30	35

S: Standardowy warunek oceny

Warunki testu COP - umiarkowana temperatura - EN 14511

Nr	Źródło ciepła		Radiator	
	Temperatura termometru suchego na wlocie (°C)	Temperatura termometru mokrego na wlocie (°C)	Temperatura na wlocie (°C)	Temperatura na wylocie (°C)
1S	7	6	47	55

S: Standardowy warunek oceny

Warunki testowe dla wymagań eksploatacyjnych - EN 14511-4

Nr	Źródło ciepła		Radiator	Natężenie przepływu wody w wewnętrznym wymienniku ciepła	Test
	Temperatura termometru suchego na wlocie (°C)	Temperatura termometru mokrego na wlocie (°C)	Temperatura na wlocie (°C)		
1	-25	-	12	800 l/h	Rozpoczęcie
2	-25	-	38	710 l/h	Działanie



Warunki testowe odcięcia nośnika ciepła - EN 14511-4

Nr	Źródło ciepła		Radiator		Wymiennik ciepła
	Temperatura termometru suchego na wlocie (°C)	Temperatura termometru mokrego na wlocie (°C)	Temperatura na wlocie (°C)	Temperatura na wylocie (°C)	
1	7	6	47	55	Wewnątrz
2	7	6	47	55	Na zewnątrz

Warunki testu dla całkowitej awarii zasilania - EN 14511-4

Nr	Źródło ciepła		Radiator	
	Temperatura termometru suchego na wlocie (°C)	Temperatura termometru mokrego na wlocie (°C)	Temperatura na wlocie (°C)	Temperatura na wylocie (°C)
1	7	6	47	55

Warunki testowe dla pomiarów mocy akustycznej - EN 12102-1

Nr	Warunki testu		Ustawienie pompy ciepła			
	Zewnętrzny wymiennik ciepła (termometr suchy/termometr mokry) (°C)	Wewnętrzny wymiennik ciepła (wlot/wylot) (°C)	Położenie wentylatora (Hz)	Prędkość wentylatora na zewnątrz (obr./min)	Moc grzewcza (kW)	Moc wejściowa (kW)
1F	7/6	30/35	64	730	15.70	3.49
2P	7/6	30/35	24	400	5.67	1.16
3F	7/6	47/55	72	650	16.14	5.65
4E	7/6	47/55	32	450	7.10	

F) Pełne obciążenie, P) Częściowe obciążenie i E) Oznaczenie ErP

[logo]
Test reg. nr 300

Wyniki testu**Wyniki testu SCOP w niskiej temperaturze - średnia sezonu grzewczego
- EN 14825**

Model (zewnętrzny)	MHC-V16W/D2RN8-B		
Monoblokowa pompa ciepła powietrze-woda	T		
Niskotemperaturowa pompa ciepła	N		
Wypożyczony w dodatkową grzałkę	T		
Kombinowany podgrzewacz z pompą ciepła	N		
Odwracalny	T		

Znamionowa moc cieplna 1)	Prated		15,2 [kW]	
Sezonowa efektywność energetyczna ogrzewania pomieszczeń	n _s		184,1 [%]	
	SCOP		4,68 [-]	
Zmierzona wydajność ogrzewania dla częściowego obciążenia przy temperaturze zewnętrznej T _j	Umiarkowany klimat Zastosowanie w niskich temperaturach	T _j = -15 °C T _j = -7 °C T _j = 2 °C T _j = 7 °C T _j = 12 °C T _j = temperatura dwuwartościowa T _j = granica działania	Pdh Pdh Pdh Pdh Pdh Pdh Pdh	- [kW] 13,27 [kW] 8,24 [kW] 6,26 [kW] 7,26 [kW] 13,27 [kW] 12,62 [kW]
Zmierzony współczynnik wydajności w temperaturze zewnętrznej T _j	Umiarkowany klimat Zastosowanie w niskich temperaturach	T _j = -15 °C T _j = -7 °C T _j = 2 °C T _j = 7 °C T _j = 12 °C T _j = temperatura dwuwartościowa T _j = granica działania	COPd COPd COPd COPd COPd COPd COPd	- [-] 2,64 [-] 4,59 [-] 6,62 [-] 8,13 [-] 2,64 [-] 2,51 [-]
Temperatura dwuwartościowa	Tbivalent		-7 [°C]	
Limit działania	TOL		-10 [°C]	
temperatury	WTOL		-[°C]	
Współczynnik degradacji	Cdh		0,97 [-]	
Pobór mocy w trybach innych niż tryb aktywny	Tryb wyłączenia Tryb wyłączenia termostatu Tryb gotowości Tryb grzałki skrzyni korbowej ²⁾	P _{OFF} P _{TO} P _{sa} P _{ck}	0,021 [kW] 0,026 [kW] 0,021 [kW] 0,021 [kW]	
Dodatkowa nagrzewnica 1)	Znamionowa moc cieplna Rodzaj pobieranej energii	P _{sup}	2,58 [kW] Elektryczny	
Inne przedmioty	Kontrola wydajności Kontrola przepływu wody Natężenie przepływu wody Rocznne zużycie energii		Zmienna Zmienna - QHE 6712 [kWh]	

1) W przypadku ogrzewaczy pomieszczeń z pompą ciepła i ogrzewaczy wielofunkcyjnych z pompą ciepła znamionowa moc cieplna. Prated, jest równa projektowemu obciążeniu grzewczemu, Pdesignh, a znamionowa moc grzewcza dodatkowego podgrzewacza, P_{sup}, jest równa dodatkowej wydajności grzewczej, sup(T_j).

1) Do obliczenia SCOP używana jest wartość PCK - PSB. Patrz strona 15

105



Test reg. nr 300

Wyniki testu SCOP w umiarkowanej temperaturze - średnia sezonu grzewczego - EN 14825

Model (zewnętrzny)	MHC-V16W/D2RN8-B	
Monoblokowa pompa ciepła powietrze-woda	T	
Niskotemperaturowa pompa ciepła	N	
Wypożyczony w dodatkową grzałkę	T	
Kombinowany podgrzewacz z pompą ciepła	N	
Odwrotny	T	

Znamionowa moc cieplna 1)	Prated		13 [kW]	
Sezonowa efektywność energetyczna ogrzewania pomieszczeń	n _s		137,3 [%]	
	SCOP		3,51 [-]	
Zmierzona wydajność ogrzewania dla częściowego obciążenia przy temperaturze zewnętrznej T _j	Umiarkowany klimat Zastosowanie w niskich temperaturach	T _j = -15 °C T _j = -7 °C T _j = 2 °C T _j = 7 °C T _j = 12 °C T _j = temperatura dwuwartościowa T _j = granica działania	Pdh Pdh Pdh Pdh Pdh Pdh Pdh	- [kW] 11,68 [kW] 7,29 [kW] 6,03 [kW] 6,89 [kW] 11,68 [kW] 10,53 [kW]
Zmierzony współczynnik wydajności w temperaturze zewnętrznej T _j	Umiarkowany klimat Zastosowanie w niskich temperaturach	T _j = -15 °C T _j = -7 °C T _j = 2 °C T _j = 7 °C T _j = 12 °C T _j = temperatura dwuwartościowa T _j = granica działania	COPd COPd COPd COPd COPd6 COPd COPd	- [-] 2,02 [-] 3,42 [-] 4,93 [-] 6,02 [-] 2,02 [-] 1,82 [-]
Temperatura dwuwartościowa	Tbivalent		-7 [°C]	
Limit działania	TOL		-10 [°C]	
temperatury	WTOL		- [°C]	
Współczynnik degradacji	Cdh		0,98 [-]	
Pobór mocy w trybach innych niż tryb aktywny	Tryb wyłączenia Tryb wyłączenia termostatu Tryb gotowości Tryb grzałki skrzyni korbowej ²⁾	P _{OFF} P _{TO} P _{sa} P _{ck}	0,021 [kW] 0,026 [kW] 0,021 [kW] 0,021 [kW]	
Dodatkowa nagrzewnica 1)	Znamionowa moc cieplna Rodzaj pobieranej energii	P _{sup}	2,47 [kW] Elektryczny	
Inne przedmioty	Kontrola wydajności Kontrola przepływu wody Natężenie przepływu wody Rocznego zużycia energii		Zmienna Zmienna -	
		QHE	7655 [kWh]	

1) W przypadku ogrzewaczy pomieszczeń z pompą ciepła i ogrzewaczy wielofunkcyjnych z pompą ciepła znamionowa moc cieplna, Prated, jest równa projektowemu obciążeniu grzewczemu, Pdesignh, a znamionowa moc grzewcza dodatkowego podgrzewacza, Psup, jest równa dodatkowej wydajności grzewczej, sup(T_j).

1) Do obliczenia SCOP używana jest wartość PCK - PSB. Patrz strona 17



Wyniki testów dla cieplejszego klimatu, niska temperatura zgodnie z EN14825

Nr	Warunki testu	Moc grzewcza [kW]	COP
1	B	13,106	3,508
2	Tbivalent F i C	8,750	5,514

Wyniki testów dla chłodniejszego klimatu, niska temperatura zgodnie z EN14825

Nr	Warunki testu	Moc grzewcza [kW]	COP
1	A	8,383	3,315
2	Tbivalent F i G	11,301	2,497

Wyniki testu COP - niska temperatura - EN 14511

Nr	Warunki testu	Moc grzewcza [kW]	COP
1	A7/W35	15,707	4,498

Wyniki testu COP - średnia temperatura - EN 14511

Nr	Warunki testu	Moc grzewcza [kW]	COP
1	A7/W55	16,139	2,854

102



Wyniki testu rozruchu i działania - EN 14511-4

Nr	Warunki testowe wlot powietrza/wody [°C]	Ocena testu
Rozruch	A-25/W18	Zaliczono
Praca	A-25/W38	Zaliczono

Wyniki testu odcięcia nośnika ciepła - EN 14511-4

Nr	Wymiennik ciepła	Ocena testu
1	Wewnętrzny	Zaliczono
2	Zewnętrzny	Zaliczono

Wyniki testu dla całkowitej awarii zasilania - EN 14511-4

Nr	Ocena testu
1	Zaliczono

Kod

Wyniki pomiarów mocy akustycznej - EN 12102-1

Nr	Warunki testu	Poziom mocy akustycznej LW(A) [dB re 1pW]	Niepewność σ_{tot} [dB]
1F	A7/W35	66,5	1,6
2P	A7/W35	51,5	1,6
3F	A7/W55	65,2	1,6
4E	A7/55	55,6	1,6

F) Pełne obciążenie, P) Częściowe obciążenie i E) Oznaczenie ErP

Całkowity poziom mocy akustycznej skorygowany charakterystyką A jest określany dla mierzonego zakresu częstotliwości od 100 Hz do 10 kHz. W celu obliczenia niepewności proszę zapoznać się z załącznikiem 1.

Pomiary mocy akustycznej są przeprowadzane przez Kamalathasana Arumugama (KAMA) i współodczytywane przez Patricka Gliberta (PGL) z Duńskiego Instytutu Technologicznego.

[logo]
Test reg. nr 300

Ja, Małgorzata Kostrowska tłumacz przysięgły języka angielskiego (wpisana na listę tłumaczy przysięgłych Ministra Sprawiedliwości pod Nr TP/313/07), zaświadczam zgodność powyższego tłumaczenia z przedłożonym dokumentem sporządzonym w języku angielskim.

Nr rep.: 1438/2024

Data: 25.04.2024



OŚWIADCZENIE

Producent Nabilaton Sp. z o.o. oświadcza, iż pompy ciepła NOXA

1) NXHPM-V8W/D2N8-BE30

Oznaczenie/typ/identyfikator modelu

2) NXHPM-V10W/D2N8-BE30

Oznaczenie/typ/identyfikator modelu

3) NXHPM-V12W/D2RN8-BER90

Oznaczenie/typ/identyfikator modelu

4) NXHPM-V14W/D2RN8-BER90

Oznaczenie/typ/identyfikator modelu

5) NXHPM-V16W/D2RN8-BER90


Oznaczenie/typ/identyfikator modelu

Należą do jednego podtypu w danym typoszeregu i spełniają łącznie następujące warunki:

- identyczna konstrukcja obiegu chłodniczego, ten sam czynnik chłodniczy/roboczy;
- ten sam producent, typ i liczba sprężarek;
- ten sam typ elementu rozprężnego;
- ten sam typ skraplacza;
- ten sam typ parownika;
- ten sam typ procesu odszraniania;
- ten sam sterownik i zasada sterowania wydajnością;
- ten sam producent, typ i liczba wentylatorów parownika (w przypadku powietrznych pomp ciepła) i zasada sterowania wydajnością (stała, zmienna lub stopniowana regulacja prędkości obrotowej);
- urządzenia z i bez zaworu czterodrogowego nie mogą być zaliczone do tego samego typoszeregu.

KRAKÓW 14.05.2024

Miejscowość, data

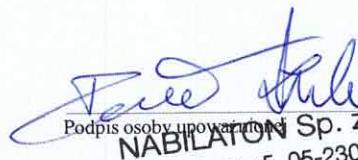
Podpis osoby upoważnionej
NABILATON Sp. z o.o.
ul. Logistyczna 5, 05-230 Kobylka
tel. 22 811 30 28
NIP 524-27-12-474, KRS 0000359324