



**DANISH
TECHNOLOGICAL
INSTITUTE**

TEST REPORT

Report no.:

300-KLAB-16-015 revision 1 (This report replaces report 300-KLAB-16-015)

Product:

Type: Air to water heat pump
Panasonic SXC12H9E8/UX12HE8

Customer:

Panasonic DE GmbH

Date:

December 2016

Consultants:

Kamalathasan Arumugam & Mads Kirk Foged



**DANISH
TECHNOLOGICAL
INSTITUTE**

Teknologiparken
Kongsvang Allé 29
DK-8000 Aarhus C
Tel.: 72 20 20 00
Fax: 72 20 10 19

TEST REPORT

Date: 2016.12.23
Report no.: 300-KLAB-16-015 EHPA
File no.: 683613

Page: 1 of 39
Init.: MDKF/JGW
Enclosures: 1

info@teknologisk.dk
www.teknologisk.dk

Customer: Contact person: Thomas Gross
Company: Panasonic DE GmbH
Address: Hagenauer Strasse 43
City: 65203 Wiesbaden
Tel.: +49 1724 141441

Component: Brand: Panasonic
Type: Air to water heat pump
Model: SXC12H9E8 & UX12HE8
Series no.: 55182 & 56181
Production year: Indoor 2016, outdoor 2016

Dates Component tested: November-December 2016

Procedure: Test procedure according to EHPA Air/Water Heat Pumps v. 2.3 and EN 14511:2013, part 1, 2 and 3.

Remarks: This report is revised due to a correction of model no. of in door until for the detailed test results of sound power measurements. The unit was delivered by the customer. Installation and setting of the unit's control system were done according to the manufacturer's instructions.

Conditions: Accredited testing was carried out in compliance with the current guidelines laid down by DANAK (Danish Laboratory Accreditation Scheme), please see www.danak.dk, and in compliance with Danish Technological Institute's General Terms and Conditions regarding Commissioned Work Accepted by Danish Technological Institute, March 2015.

The test results apply to the tested products only.

This test report may be reproduced in extract only if the Laboratory has approved the extract in writing.

Division/Centre: Danish Technological Institute
Energy and Climate
Refrigeration Laboratory, Aarhus

Date: 2016.12.23

Signature:

Co-reader:

Kamalathasan Arumugam
B.Sc. Engineer

Mads Kirk Foged
M.Sc. Engineer



DANISH
TECHNOLOGICAL
INSTITUTE

Objective

The objective of this report is to document the following:

- Nominal performance test according to EN 14511:2013 for the determination of the heating capacity and COP.
- The Seasonal Coefficient of Performance (SCOP) according to EN 14825:2016. In order to calculate the SCOP, tests were carried out at the part load conditions stated in the table below.
- The sound power level of the unit at test conditions given in the EHPA Test Regulation version 2.3 for an air to water heat pump as well as two additional measurements, i.e. one measurement with quiet mode level 3 and another measurement with an outlet water temperature of 35°C.

The measurement of the sound power level is performed according to EN 12102:2013, using the Class A method. ISO 3743-1 is the basic method of carrying out sound power measurements. The method is briefly described in appendix 1. For a more detailed description, please view the accreditation papers DANAK-300 (in Danish only). The sound power level is not measured for the indoor unit as the compressor is not part of this.

- The operating range stated by the manufacturer. The test conditions are specified in the EHPA Test Regulation version 2.3 for an air to water heat pump.
- Four safety tests according to EHPA Test Regulation version 2.3.
- Extra test points (not included in the EHPA Test Regulation) according to EN 14511:2013.



**DANISH
TECHNOLOGICAL
INSTITUTE**

Test conditions for nominal performance test

Temperature application	N°	Test condition	Heat source		Heat sink	
			Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
Low temperature	1	A7/W35	7	6	30	35
	2	A2/W35	2	1	*	35
Medium temperature	3	A7/W55	7	6	47	55

- Nominal performance test n°1 is required to determine the water flow rate for seasonal performance tests at low temperature application
- Nominal performance test n°2 is required to fulfil the minimum COP requirement of the EHPA Quality Label
- Nominal performance test n°3 is required to determine the water flow rate for seasonal performance tests at medium temperature application



**DANISH
TECHNOLOGICAL
INSTITUTE**

Test conditions for low temperature application at reference heating season average

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for low temperature application for the reference heating season "A" = average.

Condition ^a	Part Load Ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Inlet dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	A	W	C	Outdoor air	Exhaust air	All climates	A	W	C
A	$(-7 - 16) / (T_{\text{designh}} - 16)$	88	n/a	61	-7(-8)	20(12)	^a / 35	^a / 34	n/a	^a / 30
B	$(+2 - 16) / (T_{\text{designh}} - 16)$	54	100	37	2(1)	20(12)	^a / 35	^a / 30	^a / 35	^a / 27
C	$(+7 - 16) / (T_{\text{designh}} - 16)$	35	64	24	7(6)	20(12)	^a / 35	^a / 27	^a / 31	^a / 25
D	$(+12 - 16) / (T_{\text{designh}} - 16)$	15	29	11	12(11)	20(12)	^a / 35	^a / 24	^a / 26	^a / 24
E	$(TOL - 16) / (T_{\text{designh}} - 16)$				TOL	20(12)	^a / 35	^a / b	^a / b	^a / b
F	$(T_{\text{bivalent}} - 16) / (T_{\text{designh}} - 16)$				T _{bivalent}	20(12)	^a / 35	^a / c	^a / c	^a / c
G	$(-15 - 16) / (T_{\text{designh}} - 16)$	n/a	n/a	82	-15	20(12)	^a / 35	n/a	n/a	^a / 32

^a With the water flow rate as determined at the standard rating conditions given in EN 14511-2 at 30/35 conditions for units with a fixed water flow rate, and with a fixed delta T of 5 K for units with a variable flow rate. If the resulting flow rate is below the minimum flow rate then this minimum flow rate is used with the outlet temperature.

^b Variable outlet shall be calculated by interpolation from T_{designh} and the temperature which is closest to the TOL.

^c Variable outlet shall be calculated by interpolation between the upper and lower temperatures which are closest to the bivalent temperature.

^d If the variable outlet temperature is below the minimum of the operation range of the unit, this minimum should be considered.

Additional information

Climate	T _{designh} [°C]	T _{bivalent} [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-10	-10	Variable	Variable



**DANISH
TECHNOLOGICAL
INSTITUTE**

Test conditions for medium temperature application at reference heating season average

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for medium temperature application for the reference heating season "A" = average.

Condition	Part Load Ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Inlet dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet ^d °C		
	Formula	A	W	C	Outdoor air	Exhaust air	All climates	A	W	C
A	$(-7 - 16) / (T_{\text{designh}} - 16)$	88	n/a	61	-7(-8)	20(12)	^a / 55	^a / 52	n/a	^a / 44
B	$(+2 - 16) / (T_{\text{designh}} - 16)$	54	100	37	2(1)	20(12)	^a / 55	^a / 42	^a / 55	^a / 37
C	$(+7 - 16) / (T_{\text{designh}} - 16)$	35	64	24	7(6)	20(12)	^a / 55	^a / 36	^a / 46	^a / 32
D	$(+12 - 16) / (T_{\text{designh}} - 16)$	15	29	11	12(11)	20(12)	^a / 55	^a / 30	^a / 34	^a / 28
E	$(T_{\text{OL}} - 16) / (T_{\text{designh}} - 16)$				TOL	20(12)	^a / 55	^a / ^b	^a / ^b	^a / ^b
F	$(T_{\text{bivalent}} - 16) / (T_{\text{designh}} - 16)$				T _{bivalent}	20(12)	^a / 55	^a / ^c	^a / ^c	^a / ^c
G	$(-15 - 16) / (T_{\text{designh}} - 16)$	n/a	n/a	82	-15	20(12)	^a / 55	n/a	n/a	^a / 49

^a With the water flow rate as determined at the standard rating conditions given in EN 14511-2 at 47/55 conditions for units with a fixed water flow rate, and with a fixed delta T of 8 K for units with a variable flow rate. If the resulting flow rate is below the minimum flow rate then this minimum flow rate is used with the outlet temperature.

^b Variable outlet shall be calculated by interpolation T_{designh} and the temperature which is closest to the TOL.

^c Variable outlet shall be calculated by interpolation between the upper and lower temperatures which are closest to the bivalent temperature.

^d If the variable outlet temperature is below the minimum of the operation range of the unit, this minimum should be considered.

Additional information

Climate	T _{designh} [°C]	T _{bivalent} [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-10	-10	Variable	Variable



**DANISH
TECHNOLOGICAL
INSTITUTE**

Test conditions for sound power measurements

N°	Test condition		Heat pump setting	
	Outdoor heat exchanger (dry/wet bulb) (°C)	Indoor heat exchanger (inlet/outlet) (°C)	Compressor speed (Hz)	Water flow rate (l/h)
1	7/6	47/55	52-53	1281
2	7/6	30/35	47-48	2083
3*	7/6	47/55	36-37	860

*Quiet mode level 3

Test conditions for testing of the operating range

N°	Air inlet dry bulb temperature (°C)	Outlet water temperature (°C)	Water flow rate (l/h)
1	35	55	2051
2	-20	55	2051
3	-20	25	1278

Test conditions for safety tests

1	Shutting of the heat transfer medium flows (EN 14511-4 clause 4.4)
2	Complete power supply failure (EN 14511-4 clause 4.5)
3	Condensate draining and enclosure sweat test (EN 14511-4 clause 4.6)
4	Defrosting (EN 14511-4 clause 4.7)

Test conditions for extra test points

N°	Inlet dry bulb air temperature (°C)	Inlet wet bulb air temperature (°C)	Inlet water temperature (°C)	Outlet water temperature (°C)
1	-7	-8	30	35
2*	2	1	*	35
3	2	1	40	45
4	7	6	40	45
5	-25	-	*	35

*Part load with same water flow rate as Nominal performance test n°1



**DANISH
TECHNOLOGICAL
INSTITUTE**

Page 7 of 39
300-KLAB-16-015 EHPA

Test results for nominal performance test

N°	Test condition	COP	Heating capacity [kW]
1	A7/W35	4.89	12.03
2	A2/W35	3.54	12.02
3	A7/W55	3.00	11.87



DANISH
TECHNOLOGICAL
INSTITUTE

Main test results for low temperature application at reference heating season average

Type:				Air to water heat pump			
Brand:				Panasonic			
Model:				SXC12H9E8 & UX12HE8			
Serial no.:				55182 & 56181			
Production year:				2016 indoor, 2016 outdoor			
Refrigerant type:				R410A			
Refrigerant charge:				2.85 kg			
Build in water pump indoor heat exchanger				Yes			
Temperature application:				Low (reference water temperature 35°C)			
Reference heating season:				Average			
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Heating load of the building at Tdesignh	Pdesignh	12.64	kW	Seasonal Coefficient of Performance (heating only)	SCOP	4.77	-
Measured capacity for heating for part load at outdoor temperature Tj				Measured coefficient of performance at outdoor temperature Tj			
Tj = - 10 °C	Phm	12.64	kW	Tj = - 10 °C	COPm	2.77	
Tj = - 7 °C	Phm	11.75	kW	Tj = - 7 °C	COPm	3.11	-
Tj = + 2 °C	Phm	7.31	kW	Tj = + 2 °C	COPm	4.64	-
Tj = + 7 °C	Phm	5.34	kW	Tj = + 7 °C	COPm	6.65	-
Tj = + 12 °C	Phm	6.26	kW	Tj = + 12 °C	COPm	8.26	-
Design temperature	Tdesign	-10	°C	Heating water operating limit temperature	WTOL	-	°C
Bivalent temperature	Tbiv	-10	°C				
Degradation coefficient (measured)	Cdhm	0.99-1.00	-				
Power consumption in modes other than active mode				Supplementary heater			
Off mode	POFFm	9	kW	Rated heat output	Psupm	n.a.	kW
Thermostat-off mode	PTOm	11	kW	Type of energy input	Electricity		
Standby mode	PSBm	9	kW				
Crankcase heater mode	PCKm	40	kW				
Other items							
Capacity control	Variable speed compressor Variable indoor outlet temperature Variable water flow indoor			For air to water heat pumps: Rated water flow rate, indoor heat exchanger	-	n.a.	l/h
Sound power level, indoor/outdoor	LWA	n.a.	dB	For air to water heat pumps: Rated air flow rate, outdoor heat exchanger	-	923-2051	l/h
Annual energy consumption	QHE	5471	kWh				



DANISH
TECHNOLOGICAL
INSTITUTE

Main test results for medium temperature application at reference heating season average

Type:				Air to water heat pump			
Brand:				Panasonic			
Model:				SXC12H9E8 & UX12HE8			
Serial no.:				55182 & 56181			
Production year:				2016 indoor, 2016 outdoor			
Refrigerant type:				R410A			
Refrigerant charge:				2.85 kg			
Build in water pump indoor heat exchanger				Yes			
Temperature application:				Medium (reference water temperature 55°C)			
Reference heating season:				Average			
Item	Symbol	Value	Unit	Item	Symbol	Value	Unit
Heating load of the building at Tdesignh	Pdesignh	12.02	kW	Seasonal Coefficient of Performance (heating only)	SCOP	3.41	-
Measured capacity for heating for part load at outdoor temperature Tj				Measured coefficient of performance at outdoor temperature Tj			
Tj = - 10 °C	Phm	12.02	kW	Tj = - 10 °C	COPm	2.03	
Tj = - 7 °C	Phm	10.75	kW	Tj = - 7 °C	COPm	2.29	-
Tj = + 2 °C	Phm	5.93	kW	Tj = + 2 °C	COPm	3.13	-
Tj = + 7 °C	Phm	4.93	kW	Tj = + 7 °C	COPm	4.91	-
Tj = + 12 °C	Phm	5.97	kW	Tj = + 12 °C	COPm	6.45	-
Design temperature	Tdesign	-10	°C	Heating water operating limit temperature	WTOL	-	°C
Bivalent temperature	Tbiv	-10	°C				
Degradation coefficient (measured)	Cdhm	1.00	-				
Power consumption in modes other than active mode				Supplementary heater			
Off mode	POFFm	9	kW	Rated heat output	Psupm	n.a.	kW
Thermostat-off mode	PTOm	0	kW	Type of energy input	Electricity		
Standby mode	PSBm	9	kW				
Crankcase heater mode	PCKm	40	kW				
Other items							
Capacity control	Variable speed compressor			For air to water heat pumps: Rated water flow rate, indoor heat exchanger	-	n.a.	l/h
	Variable indoor outlet temperature						
	Variable water flow indoor						
Sound power level, indoor/outdoor	LWA	n.a.	dB	For air to water heat pumps: Rated air flow rate, outdoor heat exchanger	-	745-1239	l/h
Annual energy consumption	QHE	7285	kWh				

Detailed test results for low temperature application at reference heating season average

Calculation of reference SCOP (heating only)

$$SCOP = \frac{P_{designh} \times H_{he}}{\frac{P_{designh} \times H_{he}}{SCOP_{on}} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} = Heating load of the building at design temperature, kW
 H_{he} = Number of equivalent heating hours (1400), h
 $H_{TO}, H_{SB}, H_{CK}, H_{OFF}$ = Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively
 $P_{TO}, P_{SB}, P_{CK}, P_{OFF}$ = Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP calculation

	Outdoor air	Part load ratio	Part load	Measured capacity	COP at measured capacity COP _m	Degradation coefficient Cd	Capacity ratio CR	COP at part load COP _{pl}
	[°C]	[%]	[kW]	[kW]	[-]	[-]	[-]	[-]
A	-7	88	11.18	11.75	3.11	1.00	1.00	3.11
B	2	54	6.81	7.31	4.64	0.99	1.00	4.64
C	7	35	4.38	5.34	6.65	0.99	0.82	6.63
D	12	15	1.94	6.26	8.26	0.99	0.31	8.00
E(TOL)	-10	100	12.64	12.64	2.77	1.00	1.00	2.77
F(Bivalent)	-10	100	12.64	12.64	2.77	1.00	1.00	2.77

	Hours	Power input measured	Power input applied for SCOP calculation	Annual energy input
	[h]	[W]	[W]	[kWh]
Thermostat Off mode	178	11	2	0.36
Off mode	3672	9	9	33.05
Crankcase Heater	3850	40	31	119.35
Standby mode	0	9	9	0.00
			Total	152.75

Note: Prior to the SCOP calculation, the power consumption during standby mode is deducted from both the thermostat off mode and the crankcase heater mode, according to EN14825:2016.



**DANISH
TECHNOLOGICAL
INSTITUTE**

Calculation of SCOP_{on}

	Outdoor temperature (dry bulb)	Hours	Heat demand	Heat demand covered by heat pump	Electrical back up heater	COP(pl)	Annual heat demand	Annual energy input including electrical back up heater
	T _j [°C]	h _j [h]	Ph(T _j) [kW]		elbu(T _j) [kW]		h _j x Ph(T _j) [kWh]	
E(TOL) and F(bival)	-10	1	12.64	12.64	0.00	2.77	12.64	4.56
	-9	25	12.15	12.15	0.00	2.88	303.85	105.38
	-8	23	11.67	11.67	0.00	3.00	268.36	89.55
A	-7	24	11.18	11.18	0.00	3.11	268.36	86.29
	-6	27	10.70	10.70	0.00	3.28	288.78	88.04
	-5	68	10.21	10.21	0.00	3.45	694.23	201.23
	-4	91	9.72	9.72	0.00	3.62	884.80	244.42
	-3	89	9.24	9.24	0.00	3.79	822.09	216.91
	-2	165	8.75	8.75	0.00	3.96	1443.88	364.62
	-1	173	8.26	8.26	0.00	4.13	1429.78	346.19
	0	240	7.78	7.78	0.00	4.30	1866.83	434.15
	1	280	7.29	7.29	0.00	4.47	2041.85	456.79
B	2	320	6.81	6.81	0.00	4.64	2177.97	469.39
	3	357	6.32	6.32	0.00	5.04	2256.24	447.84
	4	356	5.83	5.83	0.00	5.44	2076.85	382.06
	5	303	5.35	5.35	0.00	5.83	1620.35	277.74
	6	330	4.86	4.86	0.00	6.23	1604.31	257.43
C	7	326	4.38	4.38	0.00	6.63	1426.38	215.14
	8	348	3.89	3.89	0.00	6.90	1353.45	196.03
	9	335	3.40	3.40	0.00	7.18	1140.03	158.80
	10	315	2.92	2.92	0.00	7.45	918.83	123.28
	11	215	2.43	2.43	0.00	7.73	522.62	67.63
D	12	169	1.94	1.94	0.00	8.00	328.64	41.07
	13	151	1.46	1.46	0.00	8.28	220.23	26.61
	14	105	0.97	0.97	0.00	8.55	102.09	11.94
	15	74	0.49	0.49	0.00	8.83	35.98	4.08
						Total	26109.38	5317.16
							SCOP _{on}	4.91
							SCOP _{ref}	4.77



DANISH
TECHNOLOGICAL
INSTITUTE

Detailed test results for medium temperature application at reference heating season average

Calculation of reference SCOP (heating only)

$$SCOP = \frac{P_{designh} \times H_{he}}{\frac{P_{designh} \times H_{he}}{SCOP_{on}} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

P_{design} = Heating load of the building at design temperature, kW
 H_{he} = Number of equivalent heating hours (1400), h
 $H_{TO}, H_{SB}, H_{CK}, H_{OFF}$ = Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively
 $P_{TO}, P_{SB}, P_{CK}, P_{OFF}$ = Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

Data for SCOP calculation

	Outdoor air	Part load ratio	Part load	Measured capacity	COP at measured capacity COP _m	Degradation coefficient Cd	Capacity ratio CR	COP at part load COP _{pl}
	[°C]	[%]	[kW]	[kW]	[-]	[-]	[-]	[-]
A	-7	88	10.63	10.75	2.29	1.00	1.00	2.29
B	2	54	6.47	5.93	3.13	1.00	1.00	3.13
C	7	35	4.16	4.93	4.91	1.00	0.84	4.91
D	12	15	1.85	5.97	6.45	1.00	0.31	6.45
E(TOL)	-10	100	12.02	12.02	2.03	1.00	1.00	2.03
F(Bivalent)	-10	100	12.02	12.02	2.03	1.00	1.00	2.03

	Hours	Power input measured	Power input applied for SCOP calculation	Annual energy input
	[h]	[W]	[W]	[kWh]
Thermostat Off mode	178	0	0	0.00
Off mode	3672	9	9	33.05
Crankcase Heater	3850	40	31	119.35
Standby mode	0	9	9	0.00
			Total	152.40

Note: Prior to the SCOP calculation, the power consumption during standby mode is deducted from both the thermostat off mode and the crankcase heater mode, according to EN14825:2013.



**DANISH
TECHNOLOGICAL
INSTITUTE**

Calculation of SCOP_{on}

	Outdoor temperature (dry bulb)	Hours	Heat demand	Heat demand covered by heat pump	Electrical back up heater	COP(pl)	Annual heat demand	Annual energy input including electrical back up heater
	T _j [°C]	h _j [h]	Ph(T _j) [kW]		elbu(T _j) [kW]		h _j x Ph(T _j) [kWh]	
E(TOL) and F(bival	-10	1	12.02	12.02	0.00	2.03	12.02	5.92
	-9	25	11.56	11.56	0.00	2.12	288.94	136.51
	-8	23	11.10	11.10	0.00	2.20	255.19	115.82
A	-7	24	10.63	10.63	0.00	2.29	255.19	111.44
	-6	27	10.17	10.17	0.00	2.38	274.61	115.22
	-5	68	9.71	9.68	0.00	2.48	660.18	266.56
	-4	91	9.25	9.14	0.00	2.57	841.40	327.39
	-3	89	8.78	8.61	0.00	2.66	781.76	293.53
	-2	165	8.32	8.07	0.00	2.76	1373.05	498.08
	-1	173	7.86	7.54	0.00	2.85	1359.65	477.07
	0	240	7.40	7.00	0.00	2.94	1775.26	603.15
	1	280	6.93	6.47	0.00	3.04	1941.69	639.42
B	2	320	6.47	5.93	0.00	3.13	2071.14	661.71
	3	357	6.01	5.73	0.00	3.49	2145.57	615.48
	4	356	5.55	5.53	0.00	3.84	1974.98	514.05
	5	303	5.09	5.09	0.00	4.20	1540.87	367.05
	6	330	4.62	4.62	0.00	4.55	1525.62	335.01
C	7	326	4.16	4.16	0.00	4.91	1356.41	276.25
	8	348	3.70	3.70	0.00	5.22	1287.06	246.66
	9	335	3.24	3.24	0.00	5.53	1084.11	196.18
	10	315	2.77	2.77	0.00	5.83	873.76	149.77
	11	215	2.31	2.31	0.00	6.14	496.98	80.92
D	12	169	1.85	1.85	0.00	6.45	312.52	48.45
	13	151	1.39	1.39	0.00	6.76	209.43	30.99
	14	105	0.92	0.92	0.00	7.07	97.08	13.74
	15	74	0.46	0.46	0.00	7.37	34.21	4.64
						Total	24828.70	7131.00
							SCOP _{on}	3.48
							SCOP _{ref}	3.41



DANISH
TECHNOLOGICAL
INSTITUTE

Test results of the sound power test

Test results of the sound power measurements N°	Sound power level LW(A) [dB re 1pW]	Uncertainty (dB) (weighted value)
1	66	0.8
2	62	0.4
3	64	0.5

The uncertainty value is a weighted value using the level and frequency dependant influence for each 1/1-octave level on the final A-weighted sound power level.

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz.

Test results of the operating range test

N°	Air inlet dry bulb temperature (°C)	Outlet water temperature (°C)	Result
1	35	55	Passed
2	-20	55	Passed
3	-20	25	Passed

Test results of the safety tests

N°	Safety test	Result
1	Shutting of the heat transfer medium flows (EN 14511-4 clause 4.4)	Passed
2	Complete power supply failure (EN 14511-4 clause 4.5)	Passed
3	Condensate draining and enclosure sweat test (EN 14511-4 clause 4.6)	Passed
4	Defrosting (EN 14511-4 clause 4.7)	Passed



**DANISH
TECHNOLOGICAL
INSTITUTE**

Page 15 of 39
300-KLAB-16-015 EHPA

Test results for extra test points

N°	Test condition	COP	Heating capacity – [kW]
1	A-7/W35	2.84	12.61
2	A2/W35	3.82	6.70
3	A2/W45	2.89	12.18
4	A7/W45	3.80	12.41
5	A-25/W35	1.86	10.34



DANISH
TECHNOLOGICAL
INSTITUTE

Page 16 of 39
300-KLAB-16-015 EHPA

Outdoor unit



Rating plate - outdoor unit

Panasonic

AIR-TO-WATER HEATPUMP

OUTDOOR UNIT

Model No. **WH-UX12HE8**

RATED VOLTAGE 400 V

PHASE 3N~

FREQUENCY 50Hz

MAXIMUM INPUT 7.91kW/11.9A

REFRIGERANT R410A 2.85kg

	COOLING (A35W7)	HEATING (A7W35)	HEATING (A2W35)
CAPACITY	10.00kW	12.00kW	12.00kW
CURRENT	5.4A	3.9A	5.3A
POWER INPUT	3.56kW	2.53kW	3.49kW
EER/COP	2.81	4.74	3.44

(EN 14511)

MWP H.P. 4.15MPa L.P. 2.00MPa

SERIAL NO.
56181

PRODUCTION DATE 2016.8

Panasonic Appliances
Air-Conditioning Malaysia Sdn. Bhd.
Shah Alam Malaysia

Authorized representative in EU
Panasonic Testing Centre
Panasonic Marketing Europe GmbH
Winsberggring 15, 22525 Hamburg, Germany

THIS PRODUCT
CONTAINS FLUORINATED
GREENHOUSE GASES

CE

IP24
Made in Malaysia

R410A

ACXF02-06050



DANISH
TECHNOLOGICAL
INSTITUTE

Page 17 of 39
300-KLAB-16-015 EHPA

Indoor unit



Rating plate - indoor unit

Panasonic

AIR-TO-WATER HEATPUMP

Model No. **WH-SXC12H9E8**
OUTDOOR UNIT **WH-UX12HE8**

POWER SUPPLY 1

RATED VOLTAGE	400V
PHASE	3N~
RATED FREQUENCY	50Hz

POWER SUPPLY 2

RATED VOLTAGE	400V
PHASE	3N~
RATED FREQUENCY	50Hz
MAXIMUM POWER	9.00kW
MAXIMUM CURRENT	13.0A
MWP (WATER)	0.3MPa
HEATING WATER FLOW	2.1m ³ /h
COOLING WATER FLOW	1.7m ³ /h

SERIAL NO.
55182

PRODUCTION DATE 2016.8

Panasonic Appliances
Air-Conditioning Malaysia Sdn. Bhd.
Shah Alam Malaysia
Made in Malaysia

Authorized representative in EU
Panasonic Testing Centre
Panasonic Marketing Europe GmbH
Winsbergring 15, 22525 Hamburg, Germany

R410A

CE

ACXF09-01410



DANISH
TECHNOLOGICAL
INSTITUTE

Page 18 of 39
300-KLAB-16-015 EHPA

Detailed test results - nominal performance test

Detailed result for 'EN 14511:2013' A7/W55		
Tested according to:		EN 14511:2013
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	11.87
COP	-	3.00
Power consumption	kW	3.96
Measured		
Heating capacity	kW	11.90
COP	-	2.98
Power consumption	kW	4.00
During heating		
Air temperature dry bulb	°C	7.0
Air temperature wet bulb	°C	5.9
Inlet temperature	°C	47.0
Outlet temperature	°C	55.0
Flow	l/h	1281
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	553
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.033



DANISH
TECHNOLOGICAL
INSTITUTE

Detailed result for 'EN 14511:2013' A2/W35		
Tested according to:		EN 14511:2013
Measurement type:		Transient
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12.02
COP	-	3.54
Power consumption	kW	3.39
Measured		
Heating capacity	kW	12.06
COP	-	3.51
Power consumption	kW	3.44
During heating		
Air temperature dry bulb	°C	1.9
Air temperature wet bulb	°C	0.9
Inlet temperature	°C	29.6
Outlet temperature	°C	35.2
Flow	l/h	2082
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	174
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.046



DANISH
TECHNOLOGICAL
INSTITUTE

Detailed result for 'EN 14511:2013' A7/W35		
Tested according to:		EN 14511:2013
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12.03
COP	-	4.89
Power consumption	kW	2.46
Measured		
Heating capacity	kW	12.07
COP	-	4.81
Power consumption	kW	2.51
During heating		
Air temperature dry bulb	°C	7.0
Air temperature wet bulb	°C	6.0
Inlet temperature	°C	30.1
Outlet temperature	°C	35.1
Flow	l/h	2083
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	192
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.046



**DANISH
TECHNOLOGICAL
INSTITUTE**

Page 21 of 39
300-KLAB-16-015 EHPA

Detailed test results - low temperature application

Detailed result for 'EN 14825:2016' Average Low (E) A-10/W35		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Low
Condition name:		E
Condition temperature:	°C	-10
Part load:	%	100%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.64
Heating demand:	kW	12.64
CR:	-	1.00
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12.64
COP	-	2.77
Power consumption	kW	4.56
Measured		
Heating capacity	kW	12.68
COP	-	2.75
Power consumption	kW	4.60
During heating		
Air temperature dry bulb	°C	-10.2
Air temperature wet bulb	°C	-11.2
Inlet temperature	°C	30.0
Outlet temperature	°C	35.3
Outlet temperature (Time averaged)	°C	35.3
Flow	l/h	2051
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	168
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.045



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Low (A) A-7/W34		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Low
Condition name:		A
Condition temperature:	°C	-7
Part load:	%	88%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.64
Heating demand:	kW	11.18
CR:	-	1.00
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	11.75
COP	-	3.11
Power consumption	kW	3.77
Measured		
Heating capacity	kW	11.79
COP	-	3.09
Power consumption	kW	3.81
During heating		
Air temperature dry bulb	°C	-7.0
Air temperature wet bulb	°C	-8.1
Inlet temperature	°C	28.9
Outlet temperature	°C	34.1
Outlet temperature (Time averaged)	°C	34.1
Flow	l/h	1933
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	222
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.043



DANISH
TECHNOLOGICAL
INSTITUTE

Detailed result for 'EN 14825:2016' Average Low (B) A2/W30		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Low
Condition name:		B
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.64
Heating demand:	kW	6.81
CR:	-	1.00
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	7.31
COP	-	4.64
Power consumption	kW	1.57
Measured		
Heating capacity	kW	7.34
COP	-	4.57
Power consumption	kW	1.61
During heating		
Air temperature dry bulb	°C	2.1
Air temperature wet bulb	°C	1.0
Inlet temperature	°C	25.0
Outlet temperature	°C	30.1
Outlet temperature (Time averaged)	°C	30.1
Flow	l/h	1239
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	490
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.032



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Low (C) A7/W27		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Low
Condition name:		C
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12
Heating demand:	kW	4,15
CR:	-	0,78
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	5,34
COP	-	6,65
Power consumption	kW	0,80
Measured		
Heating capacity	kW	5,36
COP	-	6,47
Power consumption	kW	0,83
During heating		
Air temperature dry bulb	°C	7,0
Air temperature wet bulb	°C	6,0
Inlet temperature	°C	23,0
Outlet temperature	°C	28,0
Outlet temperature (Time averaged)	°C	26,9
Flow	l/h	923
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	554
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0,026



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Low (D) A12/W24		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Low
Condition name:		D
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12
Heating demand:	kW	1.85
CR:	-	0.29
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	6.26
COP	-	8.26
Power consumption	kW	0.76
Measured		
Heating capacity	kW	6.29
COP	-	7.99
Power consumption	kW	0.79
During heating		
Air temperature dry bulb	°C	12.1
Air temperature wet bulb	°C	11.0
Inlet temperature	°C	22.5
Outlet temperature	°C	27.6
Outlet temperature (Time averaged)	°C	24.0
Flow	l/h	1071
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	537
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.029



**DANISH
TECHNOLOGICAL
INSTITUTE**

Page 26 of 39
300-KLAB-16-015 EHPA

Detailed test results - medium temperature application

Detailed result for 'EN 14825:2016' Average Medium (E and F) A-10/W55		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Medium
Condition name:		E and F
Condition temperature:	°C	-10
Part load:	%	100%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.02
Heating demand:	kW	12.02
CR:	-	1.00
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12.02
COP	-	2.03
Power consumption	kW	5.92
Measured		
Heating capacity	kW	12.05
COP	-	2.03
Power consumption	kW	5.95
During heating		
Air temperature dry bulb	°C	-9.9
Air temperature wet bulb	°C	-11.0
Inlet temperature	°C	47.0
Outlet temperature	°C	55.3
Outlet temperature (Time averaged)	°C	55.3
Flow	l/h	1239
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	561
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.032



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Medium (A) A-7/W52		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Medium
Condition name:		A
Condition temperature:	°C	-7
Part load:	%	88%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.02
Heating demand:	kW	10.63
CR:	-	1.00
Minimum flow reached:	-	No
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	10.75
COP	-	2.29
Power consumption	kW	4.70
Measured		
Heating capacity	kW	10.78
COP	-	2.28
Power consumption	kW	4.73
During heating		
Air temperature dry bulb	°C	-7.0
Air temperature wet bulb	°C	-8.0
Inlet temperature	°C	44.0
Outlet temperature	°C	52.0
Outlet temperature (Time averaged)	°C	52.0
Flow	l/h	1151
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	575
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.031



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Medium (B) A2/W42		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Medium
Condition name:		B
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.02
Heating demand:	kW	6.47
CR:	-	1.00
Minimum flow reached:	-	Yes
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	5.93
COP	-	3.13
Power consumption	kW	1.89
Measured		
Heating capacity	kW	5.95
COP	-	3.11
Power consumption	kW	1.92
During heating		
Air temperature dry bulb	°C	1.9
Air temperature wet bulb	°C	1.0
Inlet temperature	°C	35.3
Outlet temperature	°C	42.2
Outlet temperature (Time averaged)	°C	42.2
Flow	l/h	745
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	643
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.023



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Medium (C) A7/W36		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Medium
Condition name:		C
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.02
Heating demand:	kW	4.16
CR:	-	0.84
Minimum flow reached:	-	Yes
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	4.93
COP	-	4.91
Power consumption	kW	1.00
Measured		
Heating capacity	kW	4.95
COP	-	4.82
Power consumption	kW	1.03
During heating		
Air temperature dry bulb	°C	7.0
Air temperature wet bulb	°C	6.1
Inlet temperature	°C	31.2
Outlet temperature	°C	37.0
Outlet temperature (Time averaged)	°C	36.1
Flow	l/h	745
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	627
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.023



**DANISH
TECHNOLOGICAL
INSTITUTE**

Detailed result for 'EN 14825:2016' Average Medium (D) A12/W30		
Tested according to:		EN 14825:2016
Climate zone:		Average
Temperature application:		Medium
Condition name:		D
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-10
Tdesign	°C	-10
Pdesign	kW	12.02
Heating demand:	kW	1.85
CR:	-	0.31
Minimum flow reached:	-	Yes
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	5.97
COP	-	6.45
Power consumption	kW	0.93
Measured		
Heating capacity	kW	5.99
COP	-	6.31
Power consumption	kW	0.95
During heating		
Air temperature dry bulb	°C	11.9
Air temperature wet bulb	°C	11.0
Inlet temperature	°C	28.0
Outlet temperature	°C	34.9
Outlet temperature (Time averaged)	°C	30.1
Flow	l/h	746
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	622
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.023



DANISH
TECHNOLOGICAL
INSTITUTE

Page 31 of 39
300-KLAB-16-015 EHPA

Detailed test results - extra test points

Detailed result for 'EN 14511:2013' A-7/W35		
Tested according to:		EN 14511:2013
Measurement type:		Transient
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12,61
COP	-	2,84
Power consumption	kW	4,44
Measured		
Heating capacity	kW	12,65
COP	-	2,82
Power consumption	kW	4,49
During heating		
Air temperature dry bulb	°C	-7,0
Air temperature wet bulb	°C	-8,0
Inlet temperature	°C	29,5
Outlet temperature	°C	35,2
Flow	l/h	2081
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	181
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0,045



DANISH
TECHNOLOGICAL
INSTITUTE

Page 32 of 39
300-KLAB-16-015 EHPA

Detailed result for 'EN 14511:2013' A2/W35 Part load		
Tested according to:		EN 14511:2013
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	6,70
COP	-	3,82
Power consumption	kW	1,75
Measured		
Heating capacity	kW	6,74
COP	-	3,75
Power consumption	kW	1,80
During heating		
Air temperature dry bulb	°C	2,0
Air temperature wet bulb	°C	1,0
Inlet temperature	°C	32,3
Outlet temperature	°C	35,1
Flow	l/h	2081
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	187
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0,046



DANISH
TECHNOLOGICAL
INSTITUTE

Page 33 of 39
300-KLAB-16-015 EHPA

Detailed result for 'EN 14511:2013' A2/W45		
Tested according to:		EN 14511:2013
Measurement type:		Transient
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12,18
COP	-	2,89
Power consumption	kW	4,21
Measured		
Heating capacity	kW	12,22
COP	-	2,87
Power consumption	kW	4,26
During heating		
Air temperature dry bulb	°C	2,0
Air temperature wet bulb	°C	1,0
Inlet temperature	°C	39,4
Outlet temperature	°C	45,0
Flow	l/h	2117
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	170
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0,046



DANISH
TECHNOLOGICAL
INSTITUTE

Detailed result for 'EN 14511:2013' A7/W45

Tested according to:	EN 14511:2013	
Measurement type:	Steady state	
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:	Yes	
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	12.41
COP	-	3.80
Power consumption	kW	3.27
Measured		
Heating capacity	kW	12.46
COP	-	3.76
Power consumption	kW	3.31
During heating		
Air temperature dry bulb	°C	7.0
Air temperature wet bulb	°C	6.0
Inlet temperature	°C	40.0
Outlet temperature	°C	45.1
Flow	l/h	2113
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	174
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.046



DANISH
TECHNOLOGICAL
INSTITUTE




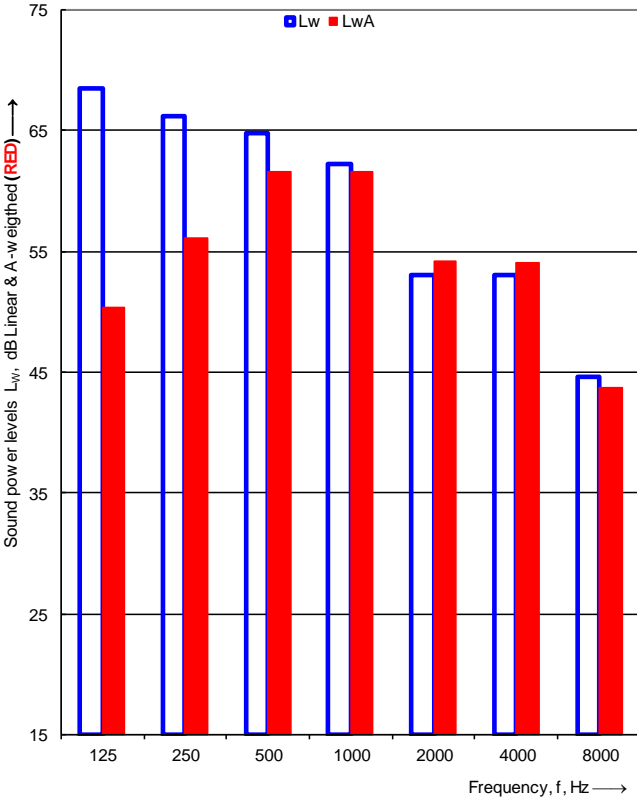
Detailed result for 'EN 14511:2013' A-25/W35		
Tested according to:		EN 14511:2013
Measurement type:		Steady state
<i>Data treatment according to EN14511-3:2013 Annex C</i>		
Integrated circulation pump:		Yes
Corrected for power input of liquid pumps (Final result)		
Heating capacity	kW	10.34
COP	-	1.86
Power consumption	kW	5.55
Measured		
Heating capacity	kW	10.39
COP	-	1.86
Power consumption	kW	5.60
During heating		
Air temperature dry bulb	°C	-25.0
Air temperature wet bulb	°C	
Inlet temperature	°C	30.8
Outlet temperature	°C	35.0
Flow	l/h	2081
Circulation pump		
Measured: Static differential pressure, liquid pump	mbar	160
Used in calculation: Static differential pressure, liquid pump	mbar	100
Correction of power input, liquid pump	kW	0.046



DANISH
TECHNOLOGICAL
INSTITUTE

Page 36 of 39
300-KLAB-16-015 EHPA

Detailed test results - sound power level - test 1




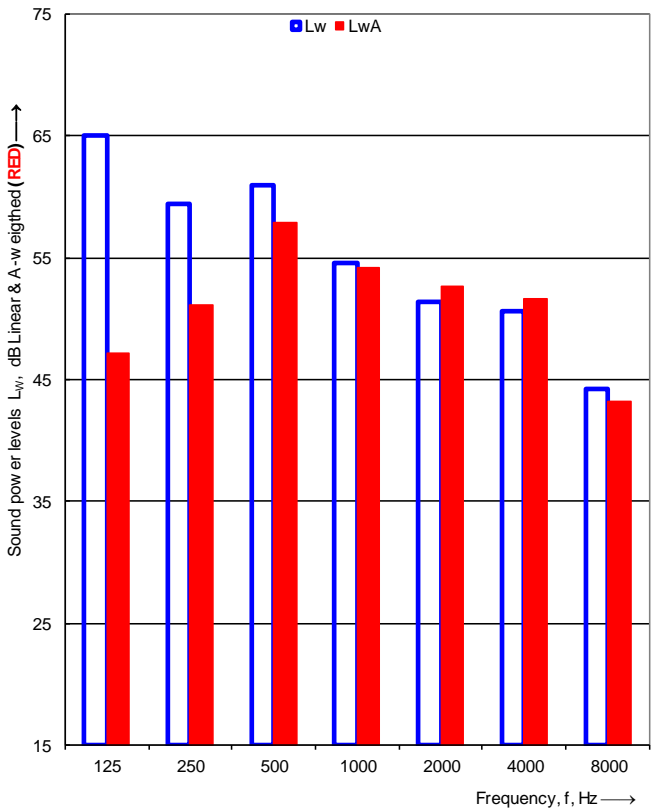
 		Sound power levels according to ISO 3743-1:2010	 TEKNOLOGISK INSTITUT																																																																		
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client:	Panasonic DE GmbH		Date of test: 16-12-2016																																																																		
Object:	Type: Split air to water heatpump Model: Panasonic UX12HE8 (Out door) - SXC12H9E8 (In door)																																																																				
Mounting conditions:	The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration insulators.																																																																				
Operating conditions:		A7/W55, Compressor speed: 52 - 53 [Hz], Heating capacity: 11.87[kW], COP: 3.00, Water flow rate: 1281 [l/h]																																																																			
Static pressure:	1013 kPa	Reference box:																																																																			
Air temperature:	7.0 °C	L1: 0.9 m																																																																			
Relative air humidity:	84.0 %	L2: 0.3 m																																																																			
Test room volume:	102.8 m³	L3: 1.3 m																																																																			
Area, S, of test room:	138.9 m²	Volume: 0.4 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>67.9</td><td></td></tr><tr><td>125</td><td>57.4</td><td>68.5</td></tr><tr><td>160</td><td>55.8</td><td></td></tr><tr><td>200</td><td>65.3</td><td></td></tr><tr><td>250</td><td>56.0</td><td>66.1</td></tr><tr><td>315</td><td>55.1</td><td></td></tr><tr><td>400</td><td>59.7</td><td></td></tr><tr><td>500</td><td>60.9</td><td>64.8</td></tr><tr><td>630</td><td>59.3</td><td></td></tr><tr><td>800</td><td>61.5</td><td></td></tr><tr><td>1000</td><td>51.3</td><td>62.2</td></tr><tr><td>1250</td><td>50.4</td><td></td></tr><tr><td>1600</td><td>46.1</td><td></td></tr><tr><td>2000</td><td>47.0</td><td>53.0</td></tr><tr><td>2500</td><td>50.3</td><td></td></tr><tr><td>3150</td><td>49.6</td><td></td></tr><tr><td>4000</td><td>48.6</td><td>53.0</td></tr><tr><td>5000</td><td>45.8</td><td></td></tr><tr><td>6300</td><td>39.9</td><td></td></tr><tr><td>8000</td><td>41.4</td><td>44.7</td></tr><tr><td>10000</td><td>37.5</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	67.9		125	57.4	68.5	160	55.8		200	65.3		250	56.0	66.1	315	55.1		400	59.7		500	60.9	64.8	630	59.3		800	61.5		1000	51.3	62.2	1250	50.4		1600	46.1		2000	47.0	53.0	2500	50.3		3150	49.6		4000	48.6	53.0	5000	45.8		6300	39.9		8000	41.4	44.7	10000	37.5			
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																			
100	67.9																																																																				
125	57.4	68.5																																																																			
160	55.8																																																																				
200	65.3																																																																				
250	56.0	66.1																																																																			
315	55.1																																																																				
400	59.7																																																																				
500	60.9	64.8																																																																			
630	59.3																																																																				
800	61.5																																																																				
1000	51.3	62.2																																																																			
1250	50.4																																																																				
1600	46.1																																																																				
2000	47.0	53.0																																																																			
2500	50.3																																																																				
3150	49.6																																																																				
4000	48.6	53.0																																																																			
5000	45.8																																																																				
6300	39.9																																																																				
8000	41.4	44.7																																																																			
10000	37.5																																																																				
Sound power level L _w (A):		66 dB [re 1pW]																																																																			
Name of test institute:		DTI																																																																			
No. of test report:		300-KLAB-16-015																																																																			
Date:		16-12-2016																																																																			



DANISH
TECHNOLOGICAL
INSTITUTE

Page 37 of 39
300-KLAB-16-015 EHPA

Detailed test results - sound power level - test 2




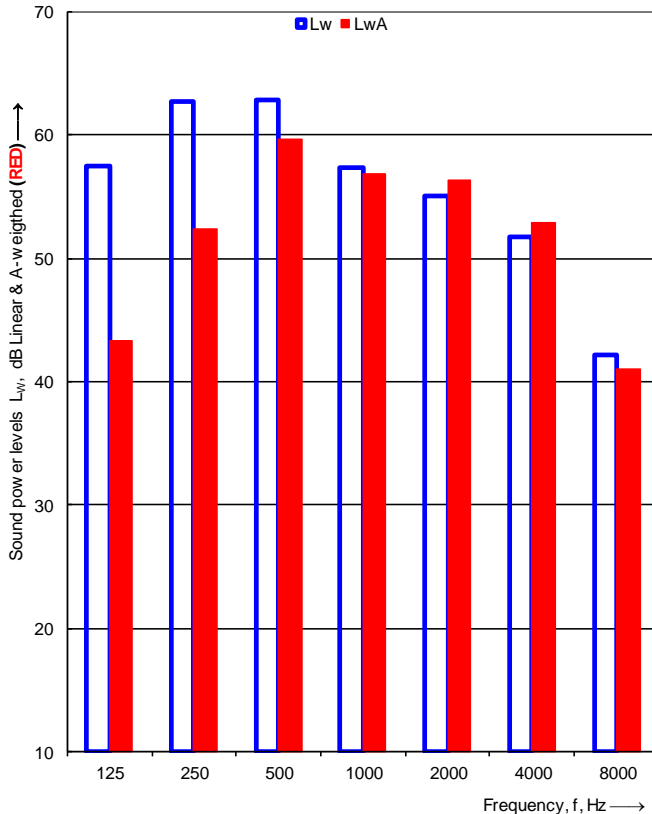
 		Sound power levels according to ISO 3743-1:2010	 TEKNOLOGISK INSTITUT																																																																		
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client:	Panasonic DE GmbH		Date of test: 16-12-2016																																																																		
Object:	Type: Split air to water heatpump Model: Panasonic UX12HE8(Out door) - SXC12H9E8(In door)																																																																				
Mounting conditions:	The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration insulators.																																																																				
Operating conditions:		A7/W35, Compressor speed: 47 - 48 [Hz], Heating capacity: 12.03[kW], COP: 4.89, Water flow rate: 2083 [l/h]																																																																			
Static pressure:	1013 kPa	Reference box:																																																																			
Air temperature:	7.0 °C	L1: 0.9 m																																																																			
Relative air humidity:	84.0 %	L2: 0.3 m																																																																			
Test room volume:	102.8 m³	L3: 1.3 m																																																																			
Area, S, of test room:	138.9 m²	Volume: 0.4 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>64.2</td><td></td></tr><tr><td>125</td><td>53.7</td><td>65.0</td></tr><tr><td>160</td><td>54.6</td><td></td></tr><tr><td>200</td><td>55.2</td><td></td></tr><tr><td>250</td><td>53.3</td><td>59.5</td></tr><tr><td>315</td><td>55.3</td><td></td></tr><tr><td>400</td><td>56.8</td><td></td></tr><tr><td>500</td><td>52.8</td><td>60.9</td></tr><tr><td>630</td><td>57.5</td><td></td></tr><tr><td>800</td><td>52.4</td><td></td></tr><tr><td>1000</td><td>47.9</td><td>54.5</td></tr><tr><td>1250</td><td>46.8</td><td></td></tr><tr><td>1600</td><td>45.4</td><td></td></tr><tr><td>2000</td><td>45.9</td><td>51.4</td></tr><tr><td>2500</td><td>48.1</td><td></td></tr><tr><td>3150</td><td>47.9</td><td></td></tr><tr><td>4000</td><td>44.8</td><td>50.6</td></tr><tr><td>5000</td><td>43.5</td><td></td></tr><tr><td>6300</td><td>38.7</td><td></td></tr><tr><td>8000</td><td>41.4</td><td>44.2</td></tr><tr><td>10000</td><td>36.9</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	64.2		125	53.7	65.0	160	54.6		200	55.2		250	53.3	59.5	315	55.3		400	56.8		500	52.8	60.9	630	57.5		800	52.4		1000	47.9	54.5	1250	46.8		1600	45.4		2000	45.9	51.4	2500	48.1		3150	47.9		4000	44.8	50.6	5000	43.5		6300	38.7		8000	41.4	44.2	10000	36.9			
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																			
100	64.2																																																																				
125	53.7	65.0																																																																			
160	54.6																																																																				
200	55.2																																																																				
250	53.3	59.5																																																																			
315	55.3																																																																				
400	56.8																																																																				
500	52.8	60.9																																																																			
630	57.5																																																																				
800	52.4																																																																				
1000	47.9	54.5																																																																			
1250	46.8																																																																				
1600	45.4																																																																				
2000	45.9	51.4																																																																			
2500	48.1																																																																				
3150	47.9																																																																				
4000	44.8	50.6																																																																			
5000	43.5																																																																				
6300	38.7																																																																				
8000	41.4	44.2																																																																			
10000	36.9																																																																				
Sound power level L _w (A):		62 dB [re 1pW]																																																																			
Name of test institute: DTI																																																																					
No. of test report: 300-KLAB-16-015																																																																					
Date: 16-12-2016																																																																					



DANISH
TECHNOLOGICAL
INSTITUTE

Page 38 of 39
300-KLAB-16-015 EHPA

Detailed test results - sound power level - test 3

 		Sound power levels according to ISO 3743-1:2010	 TEKNOLOGISK INSTITUT																																																																		
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client:	Panasonic DE GmbH		Date of test: 16-12-2016																																																																		
Object:	Type: Split air to water heatpump Model: Panasonic UX12HE8(Out door) - SXC12H9E8(In door)																																																																				
Mounting conditions:	The outdoor unit is standing free on four 5.5 cm thick heavy concrete tiles placed on a vibration damping mat, which is placed on a water drop tray. The water drop tray is located on a 2.5 cm thick wooden board laying on the floor. The outdoor unit is mounted on the supporting metal support frame using 4 vibration insulators.																																																																				
Operating conditions:	A7/W55, Compressor speed: 36 - 37 [Hz], Heating capacity: 8.00[kW], COP: 3.00, Water flow rate: 860 [l/h], Quiet mode 3																																																																				
Static pressure:	1013 kPa	<u>Reference box:</u>																																																																			
Air temperature:	7.0 °C	L1: 0.9 m																																																																			
Relative air humidity:	84.0 %	L2: 0.3 m																																																																			
Test room volume:	102.8 m³	L3: 1.3 m																																																																			
Area, S, of test room:	138.9 m²	Volume: 0.4 m³																																																																			
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L_w 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>49.5¹</td><td></td></tr><tr><td>125</td><td>46.5</td><td>57.4</td></tr><tr><td>160</td><td>56.2</td><td></td></tr><tr><td>200</td><td>62.0</td><td></td></tr><tr><td>250</td><td>52.5</td><td>62.7</td></tr><tr><td>315</td><td>49.1</td><td></td></tr><tr><td>400</td><td>57.3</td><td></td></tr><tr><td>500</td><td>59.6</td><td>62.9</td></tr><tr><td>630</td><td>56.8</td><td></td></tr><tr><td>800</td><td>56.5</td><td></td></tr><tr><td>1000</td><td>48.5</td><td>57.4</td></tr><tr><td>1250</td><td>45.1</td><td></td></tr><tr><td>1600</td><td>38.6</td><td></td></tr><tr><td>2000</td><td>47.8</td><td>55.0</td></tr><tr><td>2500</td><td>54.0</td><td></td></tr><tr><td>3150</td><td>49.4</td><td></td></tr><tr><td>4000</td><td>47.2</td><td>51.8</td></tr><tr><td>5000</td><td>40.4</td><td></td></tr><tr><td>6300</td><td>35.6</td><td></td></tr><tr><td>8000</td><td>39.9</td><td>42.1</td></tr><tr><td>10000</td><td>34.6</td><td></td></tr></tbody></table>		Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]	100	49.5 ¹		125	46.5	57.4	160	56.2		200	62.0		250	52.5	62.7	315	49.1		400	57.3		500	59.6	62.9	630	56.8		800	56.5		1000	48.5	57.4	1250	45.1		1600	38.6		2000	47.8	55.0	2500	54.0		3150	49.4		4000	47.2	51.8	5000	40.4		6300	35.6		8000	39.9	42.1	10000	34.6			
Frequency f [Hz]	L _w 1/3 octave [dB]	1/1 oct [dB]																																																																			
100	49.5 ¹																																																																				
125	46.5	57.4																																																																			
160	56.2																																																																				
200	62.0																																																																				
250	52.5	62.7																																																																			
315	49.1																																																																				
400	57.3																																																																				
500	59.6	62.9																																																																			
630	56.8																																																																				
800	56.5																																																																				
1000	48.5	57.4																																																																			
1250	45.1																																																																				
1600	38.6																																																																				
2000	47.8	55.0																																																																			
2500	54.0																																																																				
3150	49.4																																																																				
4000	47.2	51.8																																																																			
5000	40.4																																																																				
6300	35.6																																																																				
8000	39.9	42.1																																																																			
10000	34.6																																																																				
¹ Too high																																																																					
Sound power level L _w (A):		64 dB [re 1pW]																																																																			
Name of test institute:	DTI																																																																				
No. of test report:	300-KLAB-16-015																																																																				
Date:	16-12-2016																																																																				



Appendix 1: Test Procedure

The measurements of the emitted sound power level from the heat pump are carried out according to the following:

- DS/EN 14511:2013
- EN 12102
- DS/EN 3743/1

The basic acoustic measurement standard DS/EN 3743-1 is a comparison method using a calibrated reference sound source. Two series of sound pressure measurements are made under exactly the same acoustic conditions, e.g. the same microphone positions, temperature and air humidity. The calibrated sound power levels are known for the reference sound source at each frequency band, and they are used in the estimation of the acoustical correction factor for the calculation of the sound power emitted from the tested heat pump. The background noise levels are measured and used for relevant corrections.

The final total A-weighted sound power level is based on measurements and calculations in 1/3-octave levels, which then are summed into 1/1-octave levels. The uncertainty is estimated on the weighted standard deviations in 1/1-octave levels.

The actual microphone positions and correction values are saved in data files linked to the complete project documentation according to the DANAK-accreditation.

The complete measurement system is documented and regularly calibrated according to DANAK.

The detailed description of the measurement method is given in Danish in the quality database system "QA Web" at Danish Technological Institute, which is accessible by DANAK.