

# TEST REPORT

Report no.:  
300-KLAB-23-039-15



DANISH  
TECHNOLOGICAL  
INSTITUTE

Teknologiparken  
Kongsvang Allé 29  
DK-8000 Aarhus C  
+45 72 20 20 00  
Info@teknologisk.dk  
www.teknologisk.dk

Page 1 of 44  
Init: PRES/RTHI  
File no.: 226006  
Enclosures: 2

**Customer:** Company: GD MIDEA HEATING & VENTILATING EQUIPMENT CO., LTD.  
Address: Penglai Industry Road, Beijiao  
City: Shunde, Foshan, Guangdong, 528311, China  
Tel.: +86 13902810522

**Unit tested:** Brand: Midea  
Type: Air to water heat pump (mono block)  
Model: MHC-V16W/D2RN8-B  
Series no.: 541K814480238190100003  
Prod. year: Outdoor unit: N/A

**Dates:** Test period: December 2023 – January 2024

**Brand name:** Brand: Hyundai  
Type: Air to water heat pump (mono block)  
Model: HHPM-M16TH3PH

**Procedures** See objective (page 2) for list of standards.

**Remarks:** The unit was delivered by the customer. The installation and test settings were done according to the customers instructions. Between each test condition the customer changed various parameters like compressor speed, expansion valve, fan speed, pump speed, defrost time, heating time. The report for the tested unit is named 300-KLAB-23-039 issued 2024.03.21  
Also see appendix 2.

**Terms:** This test was conducted under accreditation in accordance with international requirements (ISO/IEC 17025:2017) and in accordance with the General Terms and Conditions of Danish Technological Institute. The test results solely apply to the tested item. This test report may be quoted in extract only if Danish Technological Institute has granted its written consent.

The customer may not mention or refer to Danish Technological Institute or Danish Technological Institute's employees for advertising or marketing purposes unless Danish Technological Institute has granted its written consent in each case.

**Division/Centre:** Danish Technological Institute  
Energy and Climate  
Heat Pump Laboratory, Aarhus

**Date:** 2024.05.22

**Signature:**  
Preben Eskerod  
B.TecMan & MarEng

**Co-reader:**  
Rasmus Thisgaard  
B.TecMan & MarEng



DANAK  
Test Reg. nr. 300



## Heat pumps of identical design

According to GD MIDEA HEATING & VENTILATING EQUIPMENT CO. LTD. The heat pumps listed in the table below are considered identical with the tested unit. They have identical:

- a. heating capacity
- b. refrigerant cycle (incl. refrigerant mass)
- c. heat source and sink medium
- d. main components / operating principle and control strategy
- e. same outdoor casing

<b>Brand</b>	<b>Model 380-415V 3ph/50Hz</b>
Midea	MHC-V16W/D2RN8-B
Midea	MHC-V16W/D2RN8-BE30
Midea	MHC-V16W/D2RN8-BER90
Midea	MHC-V16W/D2RN8-B1
Midea	MHC-V16W/D2RN8-B1E30
Midea	MHC-V16W/D2RN8-B1ER90
Midea	MHC-V16W/D2RN8-B2
Midea	MHC-V16W/D2RN8-B2E30
Midea	MHC-V16W/D2RN8-B2ER90

<b>Brand</b>	<b>Model 220-240 1ph/50Hz</b>
Midea	MHC-V16W/D2N8-B
Midea	MHC-V16W/D2N8-BE30
Midea	MHC-V16W/D2N8-BER90
Midea	MHC-V16W/D2N8-B1
Midea	MHC-V16W/D2N8-B1E30
Midea	MHC-V16W/D2N8-B1ER90
Midea	MHC-V16W/D2N8-B2
Midea	MHC-V16W/D2N8-B2E30
Midea	MHC-V16W/D2N8-B2ER90





## Objective

The objective of this report is to document the following:

The Seasonal Coefficient of Performance (SCOP) at low and medium temperature application for average climate according to EN 14825:2022.

In order to calculate the SCOP, tests were carried out at the part load conditions stated in the tables on page 5 and 6.

SCOP part load test in conditions SCOP<sub>B</sub> and SCOP<sub>C</sub> at low temperature application for warmer climate according to EN 14825:2022.

SCOP part load test conditions SCOP<sub>A</sub> and SCOP<sub>F/G</sub> at low temperature application for colder climate according to EN 14825:2022.

COP test standard rating conditions A7/W35 and A7/W55 according to EN 14511:2022.

Operating requirements according to EN 14511-4:2022

- 4.2.1 Starting and operating tests
- 4.5 Shutting off the heat transfer medium flows
- 4.6 Complete power supply failure

Sound power measurements according to EN 12102-1:2022.



## Contents:

<b>Test conditions .....</b>	<b>6</b>
SCOP test conditions for low temperature – EN 14825 .....	6
SCOP test conditions for medium temperature – EN 14825 .....	7
COP test conditions - low temperature – EN 14511 .....	8
COP test conditions - medium temperature – EN 14511 .....	8
Test conditions for operating requirements – EN 14511-4 .....	8
Test conditions for shutting off the heat transfer medium – EN 14511-4 .....	9
Test conditions for complete power supply failure – EN 14511-4 .....	9
Test conditions for sound power measurements – EN 12102-1 .....	9
<b>Test results.....</b>	<b>10</b>
Test results of SCOP test at low temperature - heating season average – EN 14825.....	10
Test results of SCOP test at medium temperature - heating season average – EN 14825 .....	11
Test results for warmer climate, low temperature according to EN14825.....	12
Test results for colder climate, low temperature according to EN14825 .....	12
COP test results - low temperature – EN 14511 .....	12
COP test results - medium temperature – EN 14511.....	12
Test results for starting and operating test - EN 14511-4 .....	13
Test results for shutting off the heat transfer medium – EN 14511-4 .....	13
Test results for complete power supply failure – EN 14511-4.....	13
Test results of sound power measurements – EN 12102-1 .....	14
<b>Photos .....</b>	<b>15</b>
<b>SCOP - detailed calculation .....</b>	<b>16</b>
Detailed SCOP calculation of low temperature and average climate conditions – EN 14825 .....	16
Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825 .....	18



<b>Detailed test results .....</b>	<b>20</b>
Detailed SCOP part load test results - low temperature application, average climate – EN 14825 .....	20
Detailed SCOP part load test results - medium temperature application, average climate – EN 14825	25
Detailed SCOP part load test results - low temperature application - warmer climate – EN 14825 .....	30
Detailed SCOP part load test results - low temperature application - colder climate – EN 14825.....	32
Detailed COP test results - low temperature – EN 14511.....	34
Detailed COP test results - medium temperature – EN 14511 .....	35
Detailed test results of sound power measurement – Test N#1 .....	36
Detailed test results of sound power measurement – Test N#2 .....	37
Detailed test results of sound power measurement – Test N#3 .....	38
Detailed test results of sound power measurement – Test N#4 .....	39
<b>Appendix 1 .....</b>	<b>40</b>
<b>Appendix 2.....</b>	<b>44</b>



## Test conditions

### SCOP test conditions for low temperature – EN 14825

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for low temperature application for the reference heating season;  
"A" = average, "W" = warmer, and "C" = colder.

	Part load ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet <sup>d</sup> °C		
	Formula	Average	Warmer	Colder	Outdoor air	Exhaust air	All climates	Average	Warmer	Colder
A	$(-7 - 16) / (T_{designh} - 16)$	88,46	n.a.	60,53	-7(-8)	20(12)	<sup>a</sup> / 35	<sup>a</sup> / 34	n.a.	<sup>a</sup> / 30
B	$(+2 - 16) / (T_{designh} - 16)$	53,85	100,00	36,84	2(1)	20(12)	<sup>a</sup> / 35	<sup>a</sup> / 30	<sup>a</sup> / 35	<sup>a</sup> / 27
C	$(+7 - 16) / (T_{designh} - 16)$	34,62	64,29	23,68	7(6)	20(12)	<sup>a</sup> / 35	<sup>a</sup> / 27	<sup>a</sup> / 31	<sup>a</sup> / 25
D	$(+12 - 16) / (T_{designh} - 16)$	15,38	28,57	10,53	12(11)	20(12)	<sup>a</sup> / 35	<sup>a</sup> / 24	<sup>a</sup> / 26	<sup>a</sup> / 24
E	$(TOL^e - 16) / (T_{designh} - 16)$				TOL <sup>e</sup>	20(12)	<sup>a</sup> / 35	<sup>a</sup> / b	<sup>a</sup> / b	<sup>a</sup> / b
F	$(T_{biv} - 16) / (T_{designh} - 16)$				T <sub>biv</sub>	20(12)	<sup>a</sup> / 35	<sup>a</sup> / c	<sup>a</sup> / c	<sup>a</sup> / c
G	$(-15 - 16) / (T_{designh} - 16)$	n.a.	n.a.	81,58	-15	20(12)	<sup>a</sup> / 35	n.a.	n.a.	<sup>a</sup> / 32

#### Additional information

Climate	T <sub>designh</sub> [°C]	T <sub>bivalent</sub> [°C]	TOL [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Variable
Colder	-22	-15	-22	Variable	Variable
Warmer	2	7	2	Variable	Variable





## SCOP test conditions for medium temperature – EN 14825

Part load conditions for reference SCOP and reference SCOPon calculation of air to water units for medium temperature application for the reference heating season;  
"A" = average, "W" = warmer, and "C" = colder.

	Part load ratio in %				Outdoor heat exchanger		Indoor heat exchanger			
					Dry (wet) bulb temperature °C		Fixed outlet °C	Variable outlet <sup>d</sup> °C		
	Formula	Average	Warmer	Colder	Outdoor air	Exhaust air	All climates	Average	Warmer	Colder
A	$(-7 - 16) / (T_{designh} - 16)$	88,46	n.a.	60,53	-7(-8)	20(12)	<sup>a</sup> / 55	<sup>a</sup> / 52	n.a.	<sup>a</sup> / 44
B	$(+2 - 16) / (T_{designh} - 16)$	53,85	100	36,84	2(1)	20(12)	<sup>a</sup> / 55	<sup>a</sup> / 42	<sup>a</sup> / 55	<sup>a</sup> / 37
C	$(+7 - 16) / (T_{designh} - 16)$	34,62	64,29	23,68	7(6)	20(12)	<sup>a</sup> / 55	<sup>a</sup> / 36	<sup>a</sup> / 46	<sup>a</sup> / 32
D	$(+12 - 16) / (T_{designh} - 16)$	15,38	28,57	10,53	12(11)	20(12)	<sup>a</sup> / 55	<sup>a</sup> / 30	<sup>a</sup> / 34	<sup>a</sup> / 28
E	$(TOL^e - 16) / (T_{designh} - 16)$				$TOL^e$	20(12)	<sup>a</sup> / 55	<sup>a</sup> / b	<sup>a</sup> / b	<sup>a</sup> / b
F	$(T_{biv} - 16) / (T_{designh} - 16)$				$T_{biv}$	20(12)	<sup>a</sup> / 55	<sup>a</sup> / c	<sup>a</sup> / c	<sup>a</sup> / c
G	$(-15 - 16) / (T_{designh} - 16)$	n.a.	n.a.	81,58	-15	20(12)	<sup>a</sup> / 55	n.a.	n.a.	<sup>a</sup> / 49

Additional information

Climate	$T_{designh}$ [°C]	$T_{bivalent}$ [°C]	$TOL$ [°C]	Outlet temperature	Flow rate
Average	-10	-7	-10	Variable	Variable





## COP test conditions - low temperature – EN 14511

N <sup>#</sup>	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1 <sup>S</sup>	7	6	30	35

S: Standard rating condition

## COP test conditions - medium temperature – EN 14511

N <sup>#</sup>	Heat source		Heat sink	
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)
1 <sup>S</sup>	7	6	47	55

S: Standard rating condition

## Test conditions for operating requirements – EN 14511-4

N <sup>#</sup>	Heat source		Heat sink	Water flow rate at indoor heat exchanger	Test
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)		
1	-25	-	12	800 L/h	Starting
2	-25	-	38	710 L/h	Operating





## Test conditions for shutting off the heat transfer medium – EN 14511-4

N <sup>#</sup>	Heat source		Heat sink		Heat exchanger
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)	
1	7	6	47	55	Indoor
2	7	6	47	55	Outdoor

## Test conditions for complete power supply failure – EN 14511-4

N <sup>#</sup>	Heat source		Heat sink		
	Inlet dry bulb temperature (°C)	Inlet wet bulb temperature (°C)	Inlet temperature (°C)	Outlet temperature (°C)	
1	7	6	47	55	

## Test conditions for sound power measurements – EN 12102-1

N <sup>#</sup>	Test condition		Heat pump setting			
	Outdoor heat exchanger (dry bulb/wet bulb) (°C)	Indoor heat exchanger (inlet/outlet) (°C)	Compressor speed (Hz)	Fan speed outdoor (rpm)	Heating capacity (kW)	Power input (kW)
1 <sup>F</sup>	7/6	30/35	64	730	15.70	3.49
2 <sup>P</sup>	7/6	30/35	24	400	5.67	1.16
3 <sup>F</sup>	7/6	47/55	72	650	16.14	5.65
4 <sup>E</sup>	7/6	47/55	32	450	7.10	2.34

F) Full load, P) part load and E) ErP labelling





## Test results

### Test results of SCOP test at low temperature - heating season average - EN 14825

<b>Model (Outdoor)</b>	MHC-V16W/D2RN8-B		
Air-to-water heat pump mono bloc	Y		
Low-temperature heat pump	N		
Equipped with supplementary heater	Y		
Heat pump combination heater	N		
Reversible	Y		

<b>Rated heat output<sup>1)</sup></b>	$P_{rated}$	<b>15.2 [kW]</b>
<b>Seasonal space heating energy efficiency</b>	$\eta_s$ SCOP	<b>184.1 [%]</b> <b>4.68 [-]</b>

<b>Measured capacity for heating for part load at outdoor temperature Tj</b>	Average Climate - Low temperature application	Tj=-15 °C	Pdh	- [kW]
		Tj=-7 °C	Pdh	13.27 [kW]
		Tj=2 °C	Pdh	8.24 [kW]
		Tj=7 °C	Pdh	6.26 [kW]
		Tj=12 °C	Pdh	7.26 [kW]
		Tj=bivalent temperature	Pdh	13.27 [kW]
		Tj=operation limit	Pdh	12.62 [kW]

<b>Measured coefficient of performance at outdoor temperature Tj</b>	Average Climate - Low temperature application	Tj=-15 °C	COPd	- [-]
		Tj=-7 °C	COPd	2.64 [-]
		Tj=2 °C	COPd	4.59 [-]
		Tj=7 °C	COPd	6.62 [-]
		Tj=12 °C	COPd	8.13 [-]
		Tj=bivalent temperature	COPd	2.64 [-]
		Tj=operation limit	COPd	2.51 [-]

<b>Bivalent temperature</b>	Tbivalent	-7 [°C]
<b>Operation limit</b>	TOL	-10 [°C]
<b>temperatures</b>	WTOL	- [°C]
<b>Degradation coefficient</b>	Cdh	0.97 [-]

<b>Power consumption in modes other than active mode</b>	Off mode	$P_{OFF}$	0.021 [kW]
	Thermostat-off mode	$P_{TO}$	0.026 [kW]
	Standby mode	$P_{SB}$	0.021 [kW]
	Crankcase heater mode <sup>2)</sup>	$P_{CK}$	0.021 [kW]
<b>Supplementary heater<sup>1)</sup></b>	Rated heat output	$P_{SUP}$	2.58 [kW]
	Type of energy input		Electrical

<b>Other items</b>	Capacity control	Variable
	Water flow control	Variable
	Water flow rate	-
	Annual energy consumption	$Q_{HE}$

<sup>1)</sup>For heat pump space heaters and heat pump combination heaters, the rated heat output,  $P_{rated}$ , is equal to the design load for heating,  $P_{designh}$ , and the rated heat output of a supplementary heater,  $P_{sup}$ , is equal to the supplementary capacity for heating,  $sup(T_j)$ .

<sup>2)</sup>For SCOP calculation the value PCK - PSB is used. See page 15





## Test results of SCOP test at medium temperature - heating season average – EN 14825

<b>Model (Outdoor)</b>	MHC-V16W/D2RN8-B		
Air-to-water heat pump mono bloc		P <sub>rated</sub>	Y
Low-temperature heat pump			N
Equipped with supplementary heater			Y
Heat pump combination heater			N
Reversible			Y

<b>Rated heat output<sup>1)</sup></b>	P <sub>rated</sub>	<b>13 [kW]</b>
<b>Seasonal space heating energy efficiency</b>	η <sub>s</sub> SCOP	<b>137.3 [%]</b> <b>3.51 [-]</b>

<b>Measured capacity for heating for part load at outdoor temperature T<sub>j</sub></b>	Average Climate - Medium temperature application	T <sub>j</sub> =-15 °C	P <sub>dh</sub>	- [kW]
		T <sub>j</sub> =-7 °C	P <sub>dh</sub>	11.68 [kW]
		T <sub>j</sub> =2 °C	P <sub>dh</sub>	7.29 [kW]
		T <sub>j</sub> =7 °C	P <sub>dh</sub>	6.03 [kW]
		T <sub>j</sub> =12 °C	P <sub>dh</sub>	6.89 [kW]
		T <sub>j</sub> =bivalent temperature	P <sub>dh</sub>	11.68 [kW]
		T <sub>j</sub> =operation limit	P <sub>dh</sub>	10.53 [kW]

<b>Measured coefficient of performance at outdoor temperature T<sub>j</sub></b>	Average Climate - Medium temperature application	T <sub>j</sub> =-15 °C	COP <sub>d</sub>	- [-]
		T <sub>j</sub> =-7 °C	COP <sub>d</sub>	2.02 [-]
		T <sub>j</sub> =2 °C	COP <sub>d</sub>	3.42 [-]
		T <sub>j</sub> =7 °C	COP <sub>d</sub>	4.93 [-]
		T <sub>j</sub> =12 °C	COP <sub>d</sub>	6.02 [-]
		T <sub>j</sub> =bivalent temperature	COP <sub>d</sub>	2.02 [-]
		T <sub>j</sub> =operation limit	COP <sub>d</sub>	1.82 [-]

<b>Bivalent temperature</b>	T <sub>bivalent</sub>	-7 [°C]
<b>Operation limit</b>	T <sub>OL</sub>	-10 [°C]
<b>temperatures</b>	WTOL	- [°C]
<b>Degradation coefficient</b>	C <sub>dh</sub>	0.98 [-]

<b>Power consumption in modes other than active mode</b>	Off mode	P <sub>OFF</sub>	0.021 [kW]
	Thermostat-off mode	P <sub>TO</sub>	0.026 [kW]
	Standby mode	P <sub>SB</sub>	0.021 [kW]
	Crankcase heater mode	P <sub>CK</sub>	0.021 [kW]
<b>Supplementary heater<sup>1)</sup></b>	Rated heat output	P <sub>SUP</sub>	2.47 [kW]
	Type of energy input		Electrical

<b>Other items</b>	Capacity control	Variable
	Water flow control	Variable
	Water flow rate	-
	Annual energy consumption	Q <sub>HE</sub> 7655 [kWh]

<sup>1)</sup>For heat pump space heaters and heat pump combination heaters, the rated heat output, P<sub>rated</sub>, is equal to the design load for heating, P<sub>designh</sub>, and the rated heat output of a supplementary heater, P<sub>sup</sub>, is equal to the supplementary capacity for heating, sup(T<sub>j</sub>).

<sup>2)</sup>For SCOP calculation the value PCK - PSB is used. See page 17





## Test results for warmer climate, low temperature according to EN14825

N°	Test condition	Heating capacity [kW]	COP
1	B	13.106	3.508
2	Tbivalent F and C	8.750	5.514

## Test results for colder climate, low temperature according to EN14825

N°	Test condition	Heating capacity [kW]	COP
1	A	8.383	3.315
2	Tbivalent F and G	11.301	2.497

## COP test results - low temperature – EN 14511

N*	Test conditions	Heating capacity [kW]	COP
1	A7/W35	15.707	4.498

## COP test results - medium temperature – EN 14511

N*	Test conditions	Heating capacity [kW]	COP
1	A7/W55	16.139	2.854





### Test results for starting and operating test - EN 14511-4

N#	Test conditions air/water inlet [°C]	Test validation
Starting	A-25/W18	Passed
Operating	A-25/W38	Passed

### Test results for shutting off the heat transfer medium – EN 14511-4

N#	Heat exchanger	Test validation
1	Indoor	Passed
2	Outdoor	Passed

### Test results for complete power supply failure – EN 14511-4

N#	Test validation
1	Passed





## Test results of sound power measurements – EN 12102-1

N <sup>#</sup>	Test conditions	Sound power level LW(A) [dB re 1pW]	Uncertainty $\sigma_{tot}$ [dB]
1 <sup>F</sup>	A7/W35	66.5	1.6
2 <sup>P</sup>	A7/W35	51.5	1.6
3 <sup>F</sup>	A7/W55	65.2	1.6
4 <sup>E</sup>	A7/55	55.6	1.6

F) Full load, P) part load and E) ErP labelling

The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz. For the calculation of uncertainty, see appendix 1.

The sound power measurements are carried out by Kamalathasan Arumugam (KAMA) and co-read by Patrick Glibert (PGL), Danish Technological Institute.



## Photos

### Rating plate



### Outdoor unit





## SCOP - detailed calculation

### Detailed SCOP calculation of low temperature and average climate conditions – EN 14825

#### Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{SCOP_{on} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

$P_{design}$  =

Heating load of the building at design temperature, kW

$H_{he}$  =

Number of equivalent heating hours, 2066 h

$H_{TO}, H_{SB}, H_{CK}, H_{OFF}$  =

Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

$P_{TO}, P_{SB}, P_{CK}, P_{OFF}$  =

Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

#### Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COPbin [-]
A	-7	88	13.45	13.27	2.64	0.99	1.00	2.64
B	2	54	8.18	8.24	4.59	0.99	1.00	4.59
C	7	35	5.26	6.26	6.62	0.97	0.84	6.58
D	12	15	2.34	7.26	8.13	0.97	0.32	7.66
E	-10	100	15.20	12.62	2.51	0.99	1.00	2.51
F - BIV	-7	88	13.45	13.27	2.64	0.99	1.00	2.64

#### Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.02097	0.02097	0
Thermostat off	178	0.02612	0.02612	4.64936
Standby	0	0.02097	0.02097	0
Crankcase heater	178	0.02111	0.00014	0.02492





Calculation Bin for SCOPon

	Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	Annual backup heater energy input [kWh]	COPbin [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
E	21	-10	1	15.20	12.62	2.58	2.58	2.51	15.20	7.61	12.62	5.03
	22	-9	25	14.62	12.84	1.78	44.46	2.55	365.38	170.15	320.93	125.69
	23	-8	23	14.03	13.05	0.98	22.47	2.60	322.71	138.05	300.24	115.58
A / F - BIV	24	-7	24	13.45	13.27	0.00	0.00	2.64	322.71	122.15	322.71	122.15
	25	-6	27	12.86	12.71	0.00	0.00	2.86	347.26	121.49	347.26	121.49
	26	-5	68	12.28	12.14	0.00	0.00	3.07	834.83	271.52	834.83	271.52
	27	-4	91	11.69	11.58	0.00	0.00	3.29	1064.00	323.31	1064.00	323.31
	28	-3	89	11.11	11.01	0.00	0.00	3.51	988.58	281.86	988.58	281.86
	29	-2	165	10.52	10.45	0.00	0.00	3.72	1736.31	466.29	1736.31	466.29
	30	-1	173	9.94	9.88	0.00	0.00	3.94	1719.35	436.38	1719.35	436.38
	31	0	240	9.35	9.31	0.00	0.00	4.16	2244.92	540.12	2244.92	540.12
	32	1	280	8.77	8.75	0.00	0.00	4.37	2455.38	561.53	2455.38	561.53
B	33	2	320	8.18	8.18	0.00	0.00	4.59	2619.08	570.73	2619.08	570.73
	34	3	357	7.60	7.60	0.00	0.00	4.99	2713.20	544.02	2713.20	544.02
	35	4	356	7.02	7.02	0.00	0.00	5.39	2497.48	463.73	2497.48	463.73
	36	5	303	6.43	6.43	0.00	0.00	5.78	1948.52	336.88	1948.52	336.88
C	37	6	330	5.85	5.85	0.00	0.00	6.18	1929.23	312.06	1929.23	312.06
	38	7	326	5.26	5.26	0.00	0.00	6.58	1715.26	260.66	1715.26	260.66
	39	8	348	4.68	4.68	0.00	0.00	6.80	1627.57	239.46	1627.57	239.46
	40	9	335	4.09	4.09	0.00	0.00	7.01	1370.92	195.48	1370.92	195.48
D	41	10	315	3.51	3.51	0.00	0.00	7.23	1104.92	152.84	1104.92	152.84
	42	11	215	2.92	2.92	0.00	0.00	7.45	628.46	84.41	628.46	84.41
	43	12	169	2.34	2.34	0.00	0.00	7.66	395.20	51.58	395.20	51.58
	44	13	151	1.75	1.75	0.00	0.00	7.88	264.83	33.61	264.83	33.61
	45	14	105	1.17	1.17	0.00	0.00	8.09	122.77	15.17	122.77	15.17
	46	15	74	0.58	0.58	0.00	0.00	8.31	43.26	5.21	43.26	5.21

SUM 31397.35 6706.27 31327.85 6636.77

SCOPon 4.68 SCOPnet 4.72



## Detailed SCOP calculation of medium temperature and average climate conditions – EN 14825

### Calculation of reference SCOP

$$SCOP = \frac{P_{designh} \times H_{he}}{P_{designh} \times H_{he} + H_{TO} \times P_{TO} + H_{SB} \times P_{SB} + H_{CK} \times P_{CK} + H_{OFF} \times P_{OFF}}$$

Where

$P_{design}$  =

Heating load of the building at design temperature, kW

$H_{he}$  =

Number of equivalent heating hours, 2066 h

$H_{TO}, H_{SB}, H_{CK}, H_{OFF}$  =

Number of hours for which the unit is considered to work in thermostat off mode, standby mode, crankcase heater mode and off mode, h, respectively

$P_{TO}, P_{SB}, P_{CK}, P_{OFF}$  =

Electricity consumption during thermostat off mode, standby mode, crankcase heater mode and off mode, kW, respectively

#### Data for SCOP

	Outdoor temperature [°C]	Part load ratio [%]	Part load [kW]	Declared capacity [kW]	Declared COP [-]	cdh [-]	CR [-]	COPbin [-]
A	-7	88	11.50	11.68	2.02	1.00	1.00	2.02
B	2	54	7.00	7.29	3.42	0.99	1.00	3.42
C	7	35	4.50	6.03	4.93	0.98	0.75	4.90
D	12	15	2.00	6.89	6.02	0.98	0.29	5.70
E	-10	100	13.00	10.53	1.82	1.00	1.00	1.82
F - BIV	-7	88	11.50	11.68	2.02	1.00	1.00	2.02

#### Energy consumption for thermostat off, standby, off mode, crankcase heater mode

	Hours [h]	Power input [kW]	Applied to SCOP calculation [kW]	Energy consumption [kWh]
Off mode	0	0.02097	0.02097	0
Thermostat off	178	0.02612	0.02612	4.64936
Standby	0	0.02097	0.02097	0
Crankcase heater	178	0.02111	0.00014	0.02492





Calculation Bin for SCOP<sub>on</sub>

Bin [-]	Outdoor temperature [°C]	Hours [h]	Heat load [kW]	Heat load covered by heat pump [kW]	Electrical back up heater [kW]	backup heater energy input [kWh]	COP <sub>bin</sub> [-]	Annual heating demand [kWh]	Annual energy input [kWh]	Net annual heating capacity [kWh]	Net annual power input [kWh]
<b>E</b>	21	-10	1	13.00	10.53	2.47	2.47	13.00	8.26	10.53	5.79
	22	-9	25	12.50	10.85	1.65	41.15	1.89	312.50	185.05	271.35
	23	-8	23	12.00	11.18	0.82	18.93	1.95	276.00	150.54	257.07
<b>A / F - BIV</b>	24	-7	24	11.50	11.50	0.00	0.00	2.02	276.00	136.57	276.00
	25	-6	27	11.00	11.00	0.00	0.00	2.18	297.00	136.46	297.00
	26	-5	68	10.50	10.50	0.00	0.00	2.33	714.00	306.19	714.00
	27	-4	91	10.00	10.00	0.00	0.00	2.49	910.00	365.85	910.00
	28	-3	89	9.50	9.50	0.00	0.00	2.64	845.50	319.93	845.50
	29	-2	165	9.00	9.00	0.00	0.00	2.80	1485.00	530.69	1485.00
	30	-1	173	8.50	8.50	0.00	0.00	2.95	1470.50	497.86	1470.50
	31	0	240	8.00	8.00	0.00	0.00	3.11	1920.00	617.54	1920.00
	32	1	280	7.50	7.50	0.00	0.00	3.26	2100.00	643.27	2100.00
<b>B</b>	33	2	320	7.00	7.00	0.00	0.00	3.42	2240.00	654.97	2240.00
	34	3	357	6.50	6.50	0.00	0.00	3.72	2320.50	624.49	2320.50
	35	4	356	6.00	6.00	0.00	0.00	4.01	2136.00	532.45	2136.00
	36	5	303	5.50	5.50	0.00	0.00	4.31	1666.50	386.89	1666.50
	37	6	330	5.00	5.00	0.00	0.00	4.60	1650.00	358.44	1650.00
<b>C</b>	38	7	326	4.50	4.50	0.00	0.00	4.90	1467.00	299.45	1467.00
	39	8	348	4.00	4.00	0.00	0.00	5.06	1392.00	275.13	1392.00
	40	9	335	3.50	3.50	0.00	0.00	5.22	1172.50	224.62	1172.50
	41	10	315	3.00	3.00	0.00	0.00	5.38	945.00	175.64	945.00
	42	11	215	2.50	2.50	0.00	0.00	5.54	537.50	97.01	537.50
<b>D</b>	43	12	169	2.00	2.00	0.00	0.00	5.70	338.00	59.29	338.00
	44	13	151	1.50	1.50	0.00	0.00	5.86	226.50	38.64	226.50
	45	14	105	1.00	1.00	0.00	0.00	6.02	105.00	17.44	105.00
	46	15	74	0.50	0.50	0.00	0.00	6.18	37.00	5.98	37.00

<b>SUM</b>	26853.00	7648.65	26790.45	7586.11
<b>SCOP<sub>on</sub></b>	3.51	<b>SCOP<sub>net</sub></b>	3.53	



## Detailed test results

### Detailed SCOP part load test results - low temperature application, average climate – EN 14825

Detailed result for 'EN14825:2022' Average Low (A and F) A -7/W34					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Average				
Temperature application:	Low				
Condition name:	A and F				
Condition temperature:	°C	-7			
Part load:	%	88%			
Chosen Tbivalent	°C	-7			
Tdesign	°C	-10			
Pdesign	kW	15.20			
Heating demand:	kW	13.45			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
<b>Included corrections (Final result)</b>					
Heating capacity	kW	<b>13.271</b>			
COP	-	<b>2.642</b>			
Power consumption	kW	<b>5.023</b>			
<b>Measured</b>					
Heating capacity	kW	13.299			
COP	-	2.630			
Power consumption	kW	5.057			
<b>During heating</b>					
Air temperature dry bulb	°C	-7.16			
Air temperature wet bulb	°C	-8.12			
Inlet temperature	°C	29.15			
Outlet temperature	°C	34.06			
Outlet temperature (Time averaged)	°C	<b>34.06</b>			
<b>Circulation pump</b>					
Measured: Static differential pressure, liquid pump	Pa	9410			
Calculated Hydraulic power	W	7			
Calculated global efficiency	η	0.19			
Calculated Capacity correction	W	27			
Calculated Power correction	W	34			
Water Flow	m³/s	0.000694			





<b>Detailed result for 'EN14825:2022' Average Low (B) A 2 /W30</b>			
Tested according to:	EN14511:2022 and EN14825:2022	Average	
Climate zone:		Low	
Temperature application:		B	
Condition name:			
Condition temperature:	°C	2	
Part load:	%	54%	
Chosen Tbivalent	°C	-7	
Tdesign	°C	-10	
Pdesign	kW	15.20	
Heating demand:	kW	8.18	
CR:	-	1.0	
Minimum flow reached:	-	No	
Measurement type:		Transient	
Integrated circulation pump:		Yes	
<b>Included corrections (Final result)</b>			
Heating capacity	kW	<b>8.235</b>	
COP	-	<b>4.589</b>	
Power consumption	kW	<b>1.795</b>	
<b>Measured</b>			
Heating capacity	kW	8.249	
COP	-	4.556	
Power consumption	kW	1.810	
<b>During heating</b>			
Air temperature dry bulb	°C	1.95	
Air temperature wet bulb	°C	0.92	
Inlet temperature	°C	24.97	
Outlet temperature	°C	30.08	
Outlet temperature (Time averaged)	°C	<b>30.08</b>	
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa	5256	
Calculated Hydraulic power	W	2	
Calculated global efficiency	η	0.14	
Calculated Capacity correction	W	13	
Calculated Power correction	W	16	
Water Flow	m³/s	0.000417	





<b>Detailed result for 'EN14825:2022' Average Low (C) A 7 /W27</b>		
Tested according to:	EN14511:2022 and EN14825:2022	Average
Climate zone:		Low
Temperature application:		C
Condition name:		
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	15.20
Heating demand:	kW	5.26
CR:	-	0.8
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated circulation pump:	Yes	
<b>Included corrections (Final result)</b>		
Heating capacity	kW	6.264
COP	-	6.615
Power consumption	kW	0.947
<b>Measured</b>		
Heating capacity	kW	6.266
COP	-	6.601
Power consumption	kW	0.949
<b>During heating</b>		
Air temperature dry bulb	°C	7.04
Air temperature wet bulb	°C	6.02
Inlet temperature	°C	22.80
Outlet temperature	°C	27.77
Outlet temperature (Time averaged)	°C	26.98
<b>Circulation pump</b>		
Measured: Static differential pressure, liquid pump	Pa	874
Calculated Hydraulic power	W	0
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	2
Calculated Power correction	W	2
Water Flow	m³/s	0.000303





<b>Detailed result for 'EN14825:2022' Average Low (D) A 12 /W24</b>			
Tested according to:	EN14511:2022 and EN14825:2022		Average
Climate zone:			Low
Temperature application:			D
Condition name:			
Condition temperature:	°C	12	
Part load:	%	15%	
Chosen Tbivalent	°C	-7	
Tdesign	°C	-10	
Pdesign	kW	15.20	
Heating demand:	kW	2.34	
CR:	-	0.3	
Minimum flow reached:	-	No	
Measurement type:			Steady State
Integrated circulation pump:			Yes
<b>Included corrections (Final result)</b>			
Heating capacity	kW	7.265	
COP	-	8.134	
Power consumption	kW	0.893	
<b>Measured</b>			
Heating capacity	kW	7.271	
COP	-	8.081	
Power consumption	kW	0.900	
<b>During heating</b>			
Air temperature dry bulb	°C	12.00	
Air temperature wet bulb	°C	10.92	
Inlet temperature	°C	22.38	
Outlet temperature	°C	27.40	
Outlet temperature (Time averaged)	°C	23.99	
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa	2308	
Calculated Hydraulic power	W	1	
Calculated global efficiency	η	0.12	
Calculated Capacity correction	W	6	
Calculated Power correction	W	7	
Water Flow	m³/s	0.000348	



**Detailed result for 'EN14825:2022' Average Low (E) A -10 /W35**

Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Average		
Temperature application:	Low		
Condition name:	E		
Condition temperature:	°C -10		
Part load:	% 100%		
Chosen Tbivalent	°C -7		
Tdesign	°C -10		
Pdesign	kW 15.20		
Heating demand:	kW 15.20		
CR:	- 1.0		
Minimum flow reached:	- No		
Measurement type:	Transient		
Integrated circulation pump:	Yes		
<b>Included corrections (Final result)</b>			
Heating capacity	kW 12.620		
COP	- 2.509		
Power consumption	kW 5.030		
<b>Measured</b>			
Heating capacity	kW 12.640		
COP	- 2.501		
Power consumption	kW 5.055		
<b>During heating</b>			
Air temperature dry bulb	°C -10.23		
Air temperature wet bulb	°C -11.37		
Inlet temperature	°C 29.94		
Outlet temperature	°C 35.02		
Outlet temperature (Time averaged)	°C 35.02		
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa 6527		
Calculated Hydraulic power	W 4		
Calculated global efficiency	η 0.16		
Calculated Capacity correction	W 21		
Calculated Power correction	W 25		
Water Flow	m³/s 0.000619		





## Detailed SCOP part load test results - medium temperature application, average climate – EN 14825

<b>Detailed result for 'EN14825:2022' Average Medium (A and F) A -7 /W52</b>					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Average				
Temperature application:	Medium				
Condition name:	A and F				
Condition temperature:	°C	-7			
Part load:	%	88%			
Chosen Tbivalent	°C	-7			
Tdesign	°C	-10			
Pdesign	kW	13.00			
Heating demand:	kW	11.50			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
<b>Included corrections (Final result)</b>					
Heating capacity	kW	<b>11.680</b>			
COP	-	<b>2.012</b>			
Power consumption	kW	<b>5.805</b>			
<b>Measured</b>					
Heating capacity	kW	11.694			
COP	-	2.009			
Power consumption	kW	5.821			
<b>During heating</b>					
Air temperature dry bulb	°C	-7.05			
Air temperature wet bulb	°C	-8.07			
Inlet temperature	°C	44.07			
Outlet temperature	°C	52.29			
Outlet temperature (Time averaged)	°C	<b>52.29</b>			
<b>Circulation pump</b>					
Measured: Static differential pressure, liquid pump	Pa	6527			
Calculated Hydraulic power	W	2			
Calculated global efficiency	η	0.14			
Calculated Capacity correction	W	14			
Calculated Power correction	W	17			
Water Flow	m³/s	0.000361			





**Detailed result for 'EN14825:2022' Average Medium (B) A 2 /W42**

	EN14511:2022	EN14825:2022
Tested according to:		
Climate zone:		Average
Temperature application:		Medium
Condition name:		B
Condition temperature:	°C	2
Part load:	%	54%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	7.00
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:		Transient
Integrated circulation pump:		Yes
<b>Included corrections (Final result)</b>		
Heating capacity	kW	<b>7.291</b>
COP	-	<b>3.420</b>
Power consumption	kW	<b>2.132</b>
<b>Measured</b>		
Heating capacity	kW	7.296
COP	-	3.414
Power consumption	kW	2.137
<b>During heating</b>		
Air temperature dry bulb	°C	1.91
Air temperature wet bulb	°C	0.91
Inlet temperature	°C	34.04
Outlet temperature	°C	42.18
Outlet temperature (Time averaged)	°C	<b>42.18</b>
<b>Circulation pump</b>		
Measured: Static differential pressure, liquid pump	Pa	2485
Calculated Hydraulic power	W	1
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	4
Calculated Power correction	W	5
Water Flow	m³/s	0.000231





**Detailed result for 'EN14825:2022' Average Medium (C) A 7 /W36**

Tested according to:	EN14511:2022	EN14825:2022
Climate zone:		Average
Temperature application:		Medium
Condition name:		C
Condition temperature:	°C	7
Part load:	%	35%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	4.50
CR:	-	0.7
Minimum flow reached:	-	No
Measurement type:		Steady State
Integrated circulation pump:		Yes
<b>Included corrections (Final result)</b>		
Heating capacity	kW	<b>6.028</b>
COP	-	<b>4.935</b>
Power consumption	kW	<b>1.222</b>
<b>Measured</b>		
Heating capacity	kW	6.041
COP	-	4.884
Power consumption	kW	1.237
<b>During heating</b>		
Air temperature dry bulb	°C	6.99
Air temperature wet bulb	°C	6.03
Inlet temperature	°C	29.90
Outlet temperature	°C	37.90
Outlet temperature (Time averaged)	°C	<b>35.87</b>
<b>Circulation pump</b>		
Measured: Static differential pressure, liquid pump	Pa	11703
Calculated Hydraulic power	W	2
Calculated global efficiency	η	0.14
Calculated Capacity correction	W	13
Calculated Power correction	W	15
Water Flow	m³/s	0.000182



**Detailed result for 'EN14825:2022' Average Medium (D) A 12 /W30**

Tested according to:	EN14511:2022	EN14825:2022
Climate zone:		Average Medium
Temperature application:		D
Condition name:		
Condition temperature:	°C	12
Part load:	%	15%
Chosen Tbivalent	°C	-7
Tdesign	°C	-10
Pdesign	kW	13.00
Heating demand:	kW	2.00
CR:	-	0.3
Minimum flow reached:	-	No
Measurement type:		Steady State
Integrated circulation pump:		Yes
<b>Included corrections (Final result)</b>		
Heating capacity	kW	<b>6.889</b>
COP	-	<b>6.019</b>
Power consumption	kW	<b>1.145</b>
<b>Measured</b>		
Heating capacity	kW	6.893
COP	-	6.001
Power consumption	kW	1.149
<b>During heating</b>		
Air temperature dry bulb	°C	12.01
Air temperature wet bulb	°C	11.00
Inlet temperature	°C	27.71
Outlet temperature	°C	35.68
Outlet temperature (Time averaged)	°C	<b>30.03</b>
<b>Circulation pump</b>		
Measured: Static differential pressure, liquid pump	Pa	2265
Calculated Hydraulic power	W	0
Calculated global efficiency	η	0.12
Calculated Capacity correction	W	4
Calculated Power correction	W	4
Water Flow	m³/s	0.000208



**Detailed result for 'EN14825:2022' Average Medium (E) A -10 /W55**

Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Average Medium		
Temperature application:	Medium		
Condition name:	E		
Condition temperature:	°C		-10
Part load:	%		100%
Chosen Tbivalent	°C		-7
Tdesign	°C		-10
Pdesign	kW		13.00
Heating demand:	kW		13.00
CR:	-		1.0
Minimum flow reached:	-		No
Measurement type:	Transient		
Integrated circulation pump:	Yes		
<b>Included corrections (Final result)</b>			
Heating capacity	kW	<b>10.531</b>	
COP	-	<b>1.818</b>	
Power consumption	kW	<b>5.792</b>	
<b>Measured</b>			
Heating capacity	kW	10.545	
COP	-	1.816	
Power consumption	kW	5.807	
<b>During heating</b>			
Air temperature dry bulb	°C	-10.00	
Air temperature wet bulb	°C	-11.08	
Inlet temperature	°C	47.07	
Outlet temperature	°C	55.07	
Outlet temperature (Time averaged)	°C	<b>55.07</b>	
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa	6527	
Calculated Hydraulic power	W	2	
Calculated global efficiency	η	0.14	
Calculated Capacity correction	W	13	
Calculated Power correction	W	15	
Water Flow	m³/s	0.000329	





## Detailed SCOP part load test results - low temperature application - warmer climate – EN 14825

Detailed result for 'EN14825:2022' Warmer Low (B) A 2 /W35			
Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Warmer		
Temperature application:	Low		
Condition name:	B		
Condition temperature:	°C 2		
Part load:	% 100%		
Chosen Tbivalent	°C 2		
Tdesign	°C 2		
Pdesign	kW 13.10		
Heating demand:	kW 13.10		
CR:	- 1.0		
Minimum flow reached:	- No		
Measurement type:	Transient		
Integrated circulation pump:	Yes		
<b>Included corrections (Final result)</b>			
Heating capacity	kW 13.106		
COP	- 3.508		
Power consumption	kW 3.736		
<b>Measured</b>			
Heating capacity	kW 13.134		
COP	- 3.482		
Power consumption	kW 3.772		
<b>During heating</b>			
Air temperature dry bulb	°C 2.08		
Air temperature wet bulb	°C 0.83		
Inlet temperature	°C 30.07		
Outlet temperature	°C 35.08		
Outlet temperature (Time averaged)	°C 35.08		
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa 10206		
Calculated Hydraulic power	W 7		
Calculated global efficiency	\eta 0.20		
Calculated Capacity correction	W 29		
Calculated Power correction	W 36		
Water Flow	m³/s 0.000709		





<b>Detailed result for 'EN14825:2022' Warmer Low (C) A 7 /W31</b>			
Tested according to:	EN14511:2022 and EN14825:2022		
Climate zone:	Warmer		
Temperature application:	Low		
Condition name:	C		
Condition temperature:	°C 7		
Part load:	% 64%		
Chosen Tbivalent	°C 2		
Tdesign	°C 2		
Pdesign	kW 13.10		
Heating demand:	kW 8.42		
CR:	- 1.0		
Minimum flow reached:	- No		
Measurement type:	Steady State		
Integrated circulation pump:	No		
<b>Included corrections (Final result)</b>			
Heating capacity	kW 8.750		
COP	- 5.514		
Power consumption	kW 1.587		
<b>Measured</b>			
Heating capacity	kW 8.737		
COP	- 5.557		
Power consumption	kW 1.572		
<b>During heating</b>			
Air temperature dry bulb	°C 6.99		
Air temperature wet bulb	°C 6.01		
Inlet temperature	°C 26.03		
Outlet temperature	°C 31.04		
Outlet temperature (Time averaged)	°C 31.04		
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa 4732		
Calculated Hydraulic power	W 2		
Calculated global efficiency	η 0.14		
Calculated Capacity correction	W -12		
Calculated Power correction	W -14		
Water Flow	m³/s 0.000419		



## Detailed SCOP part load test results - low temperature application - colder climate – EN 14825

Detailed result for 'EN14825:2022' Colder Low (A) A -7 /W30					
Tested according to:	EN14511:2022 and EN14825:2022				
Climate zone:	Colder				
Temperature application:	Low				
Condition name:	A				
Condition temperature:	°C	-7			
Part load:	%	61%			
Chosen Tbivalent	°C	-15			
Tdesign	°C	-22			
Pdesign	kW	13.70			
Heating demand:	kW	8.29			
CR:	-	1.0			
Minimum flow reached:	-	No			
Measurement type:	Transient				
Integrated circulation pump:	Yes				
<b>Included corrections (Final result)</b>					
Heating capacity	kW	<b>8.383</b>			
COP	-	<b>3.315</b>			
Power consumption	kW	<b>2.529</b>			
<b>Measured</b>					
Heating capacity	kW	8.386			
COP	-	3.312			
Power consumption	kW	2.532			
<b>During heating</b>					
Air temperature dry bulb	°C	-6.91			
Air temperature wet bulb	°C	-8.13			
Inlet temperature	°C	25.01			
Outlet temperature	°C	30.13			
Outlet temperature (Time averaged)	°C	<b>30.13</b>			
<b>Circulation pump</b>					
Measured: Static differential pressure, liquid pump	Pa	694			
Calculated Hydraulic power	W	0			
Calculated global efficiency	η	0.12			
Calculated Capacity correction	W	2			
Calculated Power correction	W	2			
Water Flow	m³/s	0.000411			





**Detailed result for 'EN14825:2018' Colder Low (F and G) A -15/W32**

Tested according to:	EN14825:2018	
Climate zone:	Colder	Low
Temperature application:	F and G	
Condition name:		
Condition temperature:	°C	-15
Part load:	%	82%
Chosen Tbivalent	°C	-15
Tdesign	°C	-22
Pdesign	kW	13.70
Heating demand:	kW	11.18
CR:	-	1.0
Minimum flow reached:	-	No
Measurement type:	Steady State	
Integrated circulation pump:	Yes	
<b>Included corrections (Final result)</b>		
Heating capacity	kW	11.301
COP	-	2.497
Power consumption	kW	4.526
<b>Measured</b>		
Heating capacity	kW	11.328
COP	-	2.484
Power consumption	kW	4.560
<b>During heating</b>		
Air temperature dry bulb	°C	-15.10
Air temperature wet bulb	°C	-14.89
Inlet temperature	°C	27.01
Outlet temperature	°C	32.09
Outlet temperature (Time averaged)	°C	32.09
<b>Circulation pump</b>		
Measured: Static differential pressure, liquid pump	Pa	12070
Calculated Hydraulic power	W	6
Calculated global efficiency	n	0.19
Calculated Capacity correction	W	27
Calculated Power correction	W	34
Water Flow	m³/s	0.000536





## Detailed COP test results - low temperature – EN 14511

<b>Detailed result for 'EN14511:2022' A7/W35</b>			
Tested according to:		EN14511:2022	
Minimum flow reached:		No	
Measurement type:		Steady State	
Integrated circulation pump:		Yes	
<b>Included corrections (Final result)</b>			
Heating capacity	kW	15.707	
COP	-	4.498	
Power consumption	kW	3.492	
<b>Measured</b>			
Heating capacity	kW	15.749	
COP	-	4.438	
Power consumption	kW	3.549	
<b>During heating</b>			
Air temperature dry bulb	°C	6.98	
Air temperature wet bulb	°C	5.85	
Inlet temperature	°C	29.99	
Outlet temperature	°C	34.96	
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa	20390	
Calculated Hydraulic power	W	16	
Calculated global efficiency	η	0.27	
Calculated Capacity correction	W	41	
Calculated Power correction	W	57	
Water Flow	m³/s	0.000763	





## Detailed COP test results - medium temperature – EN 14511

<b>Detailed result for 'EN14511:2022' A7/W55</b>			
Tested according to:		EN14511:2022	
Minimum flow reached:		No	
Measurement type:		Steady State	
Integrated circulation pump:		Yes	
<b>Included corrections (Final result)</b>			
Heating capacity	kW	16.139	
COP	-	2.854	
Power consumption	kW	5.654	
<b>Measured</b>			
Heating capacity	kW	16.152	
COP	-	2.849	
Power consumption	kW	5.669	
<b>During heating</b>			
Air temperature dry bulb	°C	6.92	
Air temperature wet bulb	°C	5.91	
Inlet temperature	°C	47.01	
Outlet temperature	°C	54.85	
<b>Circulation pump</b>			
Measured: Static differential pressure, liquid pump	Pa	4062	
Calculated Hydraulic power	W	2	
Calculated global efficiency	η	0.14	
Calculated Capacity correction	W	13	
Calculated Power correction	W	15	
Water Flow	m³/s	0.000500	





## Detailed test results of sound power measurement – Test N#1

TEST Reg. nr. 300		Sound power levels according to ISO 3743-1:2010		TEST Reg. nr. 300																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:	Midea		Date of test:	18-01-2024																																																																			
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																						
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																						
Operating conditions:	A7/W35, Compressor speed: 64[Hz], Fan speed: 730[rpm], Pump speed: 80 [%], EXV1(P): 138, Heating capacity: 15.7 [kW], Power_input: 3.49 [kW], Water flow rate: 2720 [l/h]																																																																						
Static pressure:	995 hPa		Reference box:																																																																				
Air temperature:	7.0 °C		L1:	1.4 m																																																																			
Relative air humidity:	84.0 %		L2:	0.4 m																																																																			
Test room volume:	102.8 m³		Room:	Room 2																																																																			
Area, S, of test room:	138.9 m²		L3:	0.9 m																																																																			
			Volume:	0.5 m³																																																																			
<table border="1"> <caption>Data extracted from the Sound power level chart</caption> <thead> <tr> <th>Frequency, f [Hz]</th> <th><math>L_w</math> [dB]</th> <th><math>L_w(A)</math> [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>67.3</td><td>53.0</td></tr> <tr><td>125</td><td>62.7</td><td>56.0</td></tr> <tr><td>160</td><td>62.4</td><td>58.0</td></tr> <tr><td>200</td><td>61.6</td><td>61.0</td></tr> <tr><td>250</td><td>61.3</td><td>59.0</td></tr> <tr><td>315</td><td>60.9</td><td>58.0</td></tr> <tr><td>400</td><td>59.8</td><td>58.0</td></tr> <tr><td>500</td><td>59.3</td><td>61.0</td></tr> <tr><td>630</td><td>60.1</td><td>51.0</td></tr> <tr><td>800</td><td>59.5</td><td>51.0</td></tr> <tr><td>1000</td><td>56.5</td><td>61.0</td></tr> <tr><td>1250</td><td>54.9</td><td>51.0</td></tr> <tr><td>1600</td><td>53.6</td><td>49.0</td></tr> <tr><td>2000</td><td>51.8</td><td>49.0</td></tr> <tr><td>2500</td><td>49.4</td><td>49.0</td></tr> <tr><td>3150</td><td>46.6</td><td>49.0</td></tr> <tr><td>4000</td><td>44.4</td><td>49.0</td></tr> <tr><td>5000</td><td>41.7</td><td>50.0</td></tr> <tr><td>6300</td><td>40.4</td><td>49.0</td></tr> <tr><td>8000</td><td>41.1</td><td>50.0</td></tr> <tr><td>10000</td><td>41.7</td><td>45.0</td></tr> </tbody> </table>						Frequency, f [Hz]	$L_w$ [dB]	$L_w(A)$ [dB]	100	67.3	53.0	125	62.7	56.0	160	62.4	58.0	200	61.6	61.0	250	61.3	59.0	315	60.9	58.0	400	59.8	58.0	500	59.3	61.0	630	60.1	51.0	800	59.5	51.0	1000	56.5	61.0	1250	54.9	51.0	1600	53.6	49.0	2000	51.8	49.0	2500	49.4	49.0	3150	46.6	49.0	4000	44.4	49.0	5000	41.7	50.0	6300	40.4	49.0	8000	41.1	50.0	10000	41.7	45.0
Frequency, f [Hz]	$L_w$ [dB]	$L_w(A)$ [dB]																																																																					
100	67.3	53.0																																																																					
125	62.7	56.0																																																																					
160	62.4	58.0																																																																					
200	61.6	61.0																																																																					
250	61.3	59.0																																																																					
315	60.9	58.0																																																																					
400	59.8	58.0																																																																					
500	59.3	61.0																																																																					
630	60.1	51.0																																																																					
800	59.5	51.0																																																																					
1000	56.5	61.0																																																																					
1250	54.9	51.0																																																																					
1600	53.6	49.0																																																																					
2000	51.8	49.0																																																																					
2500	49.4	49.0																																																																					
3150	46.6	49.0																																																																					
4000	44.4	49.0																																																																					
5000	41.7	50.0																																																																					
6300	40.4	49.0																																																																					
8000	41.1	50.0																																																																					
10000	41.7	45.0																																																																					
<b>Sound power level <math>L_w(A)</math>: 66.5 dB [re 1pW], Uncertainty <math>\sigma_{tot}</math>: 1.6 dB</b>																																																																							
Name of test institute:	DTI		Date:	18-01-2024																																																																			
No. of test report:	300-KLAB-23-039																																																																						
Measurements are in full conformity with ISO 3743-1																																																																							





## Detailed test results of sound power measurement – Test N#2

DANAK TEST Reg. nr. 300		Sound power levels according to ISO 3743-1:2010		TEST INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																							
Client:	Midea	Date of test:	18-01-2024																																																																				
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																						
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop tray on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																						
Operating conditions:	A7/W35, Compressor speed: 24[Hz], Fan speed: 400[rpm], Pump speed: 50 [%], EXV1(P): 94, Heating capacity: 5.67 [kW], Power_input: 1.16 [kW], Water flow rate: 980 [l/h]																																																																						
Static pressure:	995 hPa	<u>Reference box:</u>																																																																					
Air temperature:	7.0 °C	L1:	1.4 m																																																																				
Relative air humidity:	84.0 %	L2:	0.4 m																																																																				
Test room volume:	102.8 m³	Room:	Room 2	L3:	0.9 m																																																																		
Area, S, of test room:	138.9 m²			Volume:	0.5 m³																																																																		
<table border="1"> <caption>Data extracted from the sound power level chart</caption> <thead> <tr> <th>Frequency f [Hz]</th> <th>Lw(A) [dB]</th> <th>Lw(A-weighted) [dB]</th> </tr> </thead> <tbody> <tr><td>100</td><td>57.9</td><td>49.8</td></tr> <tr><td>125</td><td>49.8</td><td>47.2</td></tr> <tr><td>160</td><td>47.2</td><td>48.9</td></tr> <tr><td>200</td><td>48.9</td><td>47.8</td></tr> <tr><td>250</td><td>52.7</td><td>47.0</td></tr> <tr><td>315</td><td>50.9</td><td>47.4</td></tr> <tr><td>400</td><td>50.9</td><td>46.2</td></tr> <tr><td>500</td><td>50.9</td><td>44.4</td></tr> <tr><td>630</td><td>50.9</td><td>43.1</td></tr> <tr><td>800</td><td>50.9</td><td>43.1</td></tr> <tr><td>1000</td><td>45.4</td><td>39.5</td></tr> <tr><td>1250</td><td>45.4</td><td>37.1</td></tr> <tr><td>1600</td><td>38.9</td><td>36.0</td></tr> <tr><td>2000</td><td>38.9</td><td>34.2</td></tr> <tr><td>2500</td><td>38.9</td><td>30.5</td></tr> <tr><td>3150</td><td>38.9</td><td>27.2</td></tr> <tr><td>4000</td><td>30.4</td><td>25.5</td></tr> <tr><td>5000</td><td>30.4</td><td>23.5</td></tr> <tr><td>6300</td><td>30.4</td><td>31.4</td></tr> <tr><td>8000</td><td>35.0</td><td>31.4</td></tr> <tr><td>10000</td><td>35.0</td><td>26.3</td></tr> </tbody> </table>						Frequency f [Hz]	Lw(A) [dB]	Lw(A-weighted) [dB]	100	57.9	49.8	125	49.8	47.2	160	47.2	48.9	200	48.9	47.8	250	52.7	47.0	315	50.9	47.4	400	50.9	46.2	500	50.9	44.4	630	50.9	43.1	800	50.9	43.1	1000	45.4	39.5	1250	45.4	37.1	1600	38.9	36.0	2000	38.9	34.2	2500	38.9	30.5	3150	38.9	27.2	4000	30.4	25.5	5000	30.4	23.5	6300	30.4	31.4	8000	35.0	31.4	10000	35.0	26.3
Frequency f [Hz]	Lw(A) [dB]	Lw(A-weighted) [dB]																																																																					
100	57.9	49.8																																																																					
125	49.8	47.2																																																																					
160	47.2	48.9																																																																					
200	48.9	47.8																																																																					
250	52.7	47.0																																																																					
315	50.9	47.4																																																																					
400	50.9	46.2																																																																					
500	50.9	44.4																																																																					
630	50.9	43.1																																																																					
800	50.9	43.1																																																																					
1000	45.4	39.5																																																																					
1250	45.4	37.1																																																																					
1600	38.9	36.0																																																																					
2000	38.9	34.2																																																																					
2500	38.9	30.5																																																																					
3150	38.9	27.2																																																																					
4000	30.4	25.5																																																																					
5000	30.4	23.5																																																																					
6300	30.4	31.4																																																																					
8000	35.0	31.4																																																																					
10000	35.0	26.3																																																																					
<b>Sound power level <math>L_w(A)</math>: 51.5 dB [re 1pW], Uncertainty <math>\sigma_{tot}</math>: 1.6 dB</b>																																																																							
Name of test institute:	DTI	Date:	18-01-2024																																																																				
No. of test report:	300-KLAB-23-039																																																																						
Measurements are in full conformity with ISO 3743-1																																																																							





## Detailed test results of sound power measurement – Test N#3

Sound power levels according to ISO 3743-1:2010		TEKNOLOGISK INSTITUT																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																					
Client:	Midea	Date of test:	18-01-2024																																																																		
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																				
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																				
Operating conditions:	A7/W55, Compressor speed: 72[Hz], Fan speed: 650[rpm], Pump speed: 50 [%], EXV1(P): 128, Heating capacity: 16.14 [kW], Power_input: 5.65 [kW], Water flow rate: 1790 [l/h]																																																																				
Static pressure:	996 hPa	Reference box:																																																																			
Air temperature:	7.0 °C	L1:	1.4 m																																																																		
Relative air humidity:	84.0 %	L2:	0.4 m																																																																		
Test room volume:	102.8 m³	Room:	Room 2																																																																		
Area, S, of test room:	138.9 m²	L3:	0.9 m																																																																		
		Volume:	0.5 m³																																																																		
<table border="1"><thead><tr><th>Frequency, f, Hz</th><th>1/3 octave [dB] (Lw)</th><th>1/1 oct [dB] (LwA)</th></tr></thead><tbody><tr><td>100</td><td>67.3</td><td>70.8</td></tr><tr><td>125</td><td>64.4</td><td>65.8</td></tr><tr><td>160</td><td>66.0</td><td>63.4</td></tr><tr><td>200</td><td>63.1</td><td></td></tr><tr><td>250</td><td>59.5</td><td></td></tr><tr><td>315</td><td>59.2</td><td></td></tr><tr><td>400</td><td>58.6</td><td></td></tr><tr><td>500</td><td>57.4</td><td></td></tr><tr><td>630</td><td>59.6</td><td></td></tr><tr><td>800</td><td>57.1</td><td></td></tr><tr><td>1000</td><td>54.4</td><td></td></tr><tr><td>1250</td><td>52.4</td><td></td></tr><tr><td>1600</td><td>51.6</td><td></td></tr><tr><td>2000</td><td>49.8</td><td></td></tr><tr><td>2500</td><td>49.1</td><td></td></tr><tr><td>3150</td><td>46.3</td><td></td></tr><tr><td>4000</td><td>44.9</td><td></td></tr><tr><td>5000</td><td>39.9</td><td></td></tr><tr><td>6300</td><td>38.9</td><td></td></tr><tr><td>8000</td><td>40.7</td><td></td></tr><tr><td>10000</td><td>41.7</td><td></td></tr></tbody></table>				Frequency, f, Hz	1/3 octave [dB] (Lw)	1/1 oct [dB] (LwA)	100	67.3	70.8	125	64.4	65.8	160	66.0	63.4	200	63.1		250	59.5		315	59.2		400	58.6		500	57.4		630	59.6		800	57.1		1000	54.4		1250	52.4		1600	51.6		2000	49.8		2500	49.1		3150	46.3		4000	44.9		5000	39.9		6300	38.9		8000	40.7		10000	41.7	
Frequency, f, Hz	1/3 octave [dB] (Lw)	1/1 oct [dB] (LwA)																																																																			
100	67.3	70.8																																																																			
125	64.4	65.8																																																																			
160	66.0	63.4																																																																			
200	63.1																																																																				
250	59.5																																																																				
315	59.2																																																																				
400	58.6																																																																				
500	57.4																																																																				
630	59.6																																																																				
800	57.1																																																																				
1000	54.4																																																																				
1250	52.4																																																																				
1600	51.6																																																																				
2000	49.8																																																																				
2500	49.1																																																																				
3150	46.3																																																																				
4000	44.9																																																																				
5000	39.9																																																																				
6300	38.9																																																																				
8000	40.7																																																																				
10000	41.7																																																																				
<p>Sound power level <math>L_w(A)</math>: 65.2 dB [re 1pW], Uncertainty <math>\sigma_{tot}</math>: 1.6 dB</p>																																																																					
Name of test institute:	DTI	Date:	18-01-2024																																																																		
No. of test report:	300-KLAB-23-039																																																																				
Measurements are in full conformity with ISO 3743-1																																																																					





## Detailed test results of sound power measurement – Test N#4

Sound power levels according to ISO 3743-1:2010																																																																			
Engineering method for small, movable sources in reverberant fields - Comparison method for hard-walled test rooms																																																																			
Client:	Midea	Date of test: 18-01-2024																																																																	
Object:	Type: Mono Air to water heat pump, Model: MHC-V16W/D2RN8-BER90																																																																		
Mounting conditions:	The outdoor unit is mounted on the supporting metal support frame using six vibration insulators and placed on four pieces of concrete tiles (20x20x2.5 cm). All of these are placed in a water drop dry on two pieces of heavy concrete tiles (90x90x10cm) laying on a vibration damping mat on the floor. The noise radiated by the outdoor unit has been measured in Test room 2.																																																																		
Operating conditions:	A7/W55, Compressor speed: 32[Hz], Fan speed: 450[rpm], Pump speed: 30 [%], EXV1(P): 92, Heating capacity: 7.1 [kW], Power_input: 2.34 [kW], Water flow rate: 765 [l/h]																																																																		
Static pressure:	996 hPa	Reference box:																																																																	
Air temperature:	7.0 °C	L1: 1.4 m																																																																	
Relative air humidity:	84.0 %	L2: 0.4 m																																																																	
Test room volume:	102.8 m <sup>3</sup>	L3: 0.9 m																																																																	
Area, S, of test room:	138.9 m <sup>2</sup>	Volume: 0.5 m <sup>3</sup>																																																																	
<table border="1"><thead><tr><th>Frequency f [Hz]</th><th>L<sub>w</sub> 1/3 octave [dB]</th><th>1/1 oct [dB]</th></tr></thead><tbody><tr><td>100</td><td>56.7</td><td></td></tr><tr><td>125</td><td>52.6</td><td>58.6</td></tr><tr><td>160</td><td>49.0</td><td></td></tr><tr><td>200</td><td>49.5</td><td></td></tr><tr><td>250</td><td>51.4</td><td>55.5</td></tr><tr><td>315</td><td>51.1</td><td></td></tr><tr><td>400</td><td>50.1</td><td></td></tr><tr><td>500</td><td>48.9</td><td>55.1</td></tr><tr><td>630</td><td>51.5</td><td></td></tr><tr><td>800</td><td>47.8</td><td></td></tr><tr><td>1000</td><td>44.0</td><td>50.0</td></tr><tr><td>1250</td><td>41.7</td><td></td></tr><tr><td>1600</td><td>40.2</td><td></td></tr><tr><td>2000</td><td>38.5</td><td></td></tr><tr><td>2500</td><td>34.5</td><td></td></tr><tr><td>3150</td><td>33.5</td><td></td></tr><tr><td>4000</td><td>30.9</td><td>36.1</td></tr><tr><td>5000</td><td>27.9</td><td></td></tr><tr><td>6300</td><td>35.1</td><td></td></tr><tr><td>8000</td><td>35.7</td><td></td></tr><tr><td>10000</td><td>35.0</td><td>40.0</td></tr></tbody></table>	Frequency f [Hz]	L <sub>w</sub> 1/3 octave [dB]	1/1 oct [dB]	100	56.7		125	52.6	58.6	160	49.0		200	49.5		250	51.4	55.5	315	51.1		400	50.1		500	48.9	55.1	630	51.5		800	47.8		1000	44.0	50.0	1250	41.7		1600	40.2		2000	38.5		2500	34.5		3150	33.5		4000	30.9	36.1	5000	27.9		6300	35.1		8000	35.7		10000	35.0	40.0	
Frequency f [Hz]	L <sub>w</sub> 1/3 octave [dB]	1/1 oct [dB]																																																																	
100	56.7																																																																		
125	52.6	58.6																																																																	
160	49.0																																																																		
200	49.5																																																																		
250	51.4	55.5																																																																	
315	51.1																																																																		
400	50.1																																																																		
500	48.9	55.1																																																																	
630	51.5																																																																		
800	47.8																																																																		
1000	44.0	50.0																																																																	
1250	41.7																																																																		
1600	40.2																																																																		
2000	38.5																																																																		
2500	34.5																																																																		
3150	33.5																																																																		
4000	30.9	36.1																																																																	
5000	27.9																																																																		
6300	35.1																																																																		
8000	35.7																																																																		
10000	35.0	40.0																																																																	
Sound power level L <sub>w</sub> (A): 55.6 dB [re 1pW], Uncertainty $\sigma_{tot}$ : 1.6 dB																																																																			
Name of test institute: <b>No. of test report:</b>	DTI 300-KLAB-23-039	Date: 18-01-2024																																																																	
Measurements are in full conformity with ISO 3743-1																																																																			





## Appendix 1

### Unit specification

Type of unit: Mono air to water heat pump

Manufacturer: Midea

Size of the heat pump: 0.4 x 0.9 x 1.3m (W x L x H)

Year of production: n/a.


### Operating conditions and environment

The operating conditions of the unit under test fulfill the requirements for Class A.

The acoustic test chamber is a hard wall reverberant room (103 m<sup>3</sup>) and equipped with relevant sound diffusing reflector panels. The acoustical test chamber fulfills the requirements of ISO3743-1 accuracy grade 2 (engineering grade).

The measurements of the average sound pressure levels in 1/3 octave frequency bands are carried out using three microphones in the test chamber. During the measurements, the microphones are traversed up and down for one meter in the arc of a quarter circle.

The picture below shows the installation of the unit during test, position of microphones, sound diffusing reflector panels, and the reference sound source.

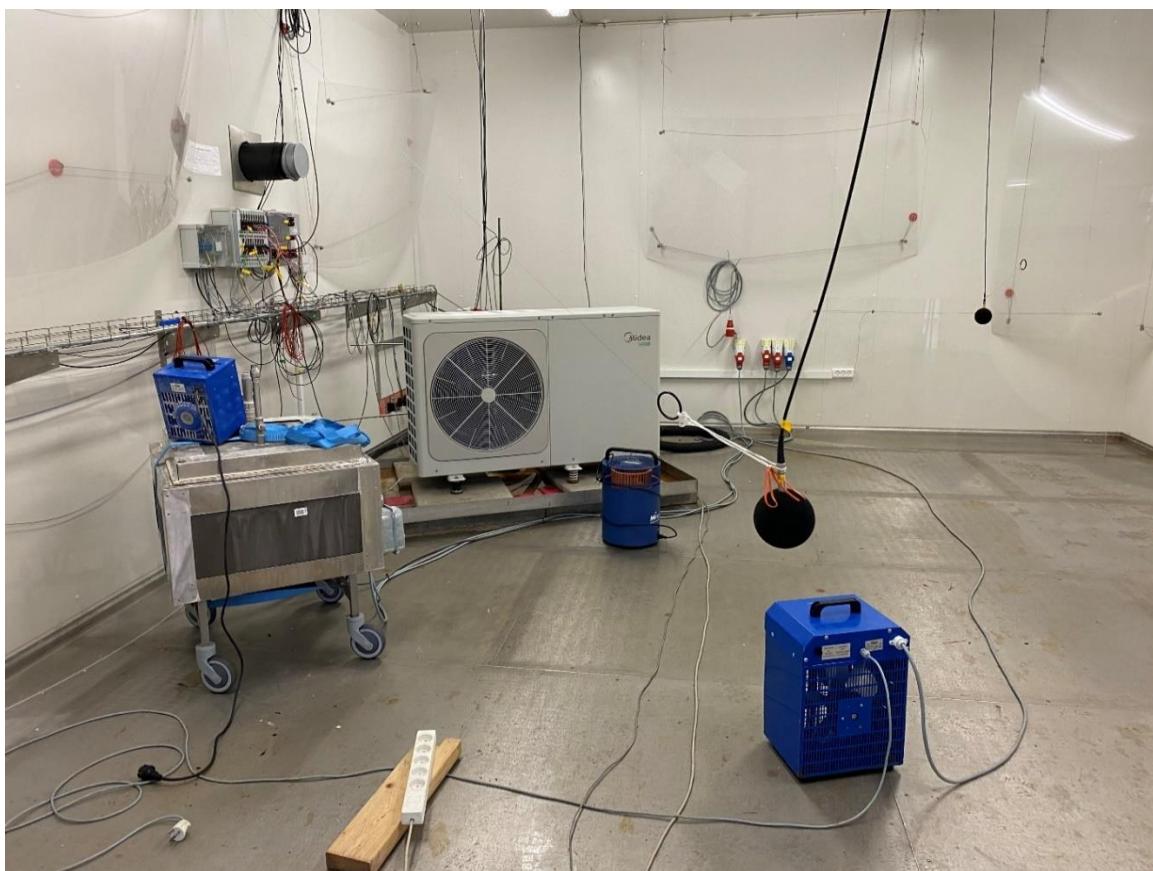



## Measurement instruments

<b>Id nr.</b>	<b>Manufacturer</b>	<b>Description</b>	<b>Calibration company</b>
100864	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100865	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100866	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 1	Norsonic A/S, Norway
100867*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100868*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100869*	GRAS	Gras 40AE_26CA, ½" free field microphone, Room 2	Norsonic A/S, Norway
100870	GRAS	Gras 40AE_26CA, ½" free field microphone, Roof monitor	Norsonic A/S, Norway
100873*	Brüel & Kjær	Acoustical calibrator, Brüel & Kjær 4231	Element Metech, Denmark
100859	Norsonic	Reference sound source, Norsonic Nor278 Room 1	RISE, Sweden
100872*	Norsonic	Reference sound source, Norsonic Nor278 Room 2	RISE, Sweden
100620*	Norsonic	Multi-channel measurement system Nor850	Norsonic A/S, Norway

\*Instruments are used for the actual measurements for the calculation of the test results.

The other instruments are used for control measurements.

All microphones are equipped with windshields.



## Test Procedure

The measurements of the emitted sound power level from the heat pump are carried out according to the following standard:

- DS/EN 14511:2022
- EN 12102-1:2022
- ISO/EN 3743-1:2010

The basic acoustic measurement standard DS/EN 3743-1 is a comparison method using a calibrated reference sound source. Two series of sound pressure measurements are made under exactly the same acoustic conditions, e.g., the same microphone positions, temperature and air humidity. The calibrated sound power levels are known for the reference sound source at each frequency band, and they are used in the estimation of the acoustical correction factor for the calculation of the sound power emitted from the unit under test. The background noise levels are measured and used for relevant corrections.

The final total A-weighted sound power level is based on measurements and calculations in 1/3-octave levels, which then are summed into 1/1-octave levels. The A-weighted total sound power level is determined for the measured frequency range from 100 Hz to 10 kHz.

The actual microphone positions and correction values are saved in data files linked to the complete project documentation according to the DANAK-accreditation.

The complete measurement system is documented and regularly calibrated according to DANAK.

The detailed description of the measurement method is given in Danish in the quality database system "QA Web" at Danish Technological Institute, which is accessible by DANAK.

## Measurement uncertainty

The uncertainty of sound power level in decibel is determined in accordance with ISO 3743-1, equation 22  $\sigma_{tot} = \sqrt{\sigma_{RO}^2 + \sigma_{omc}^2}$  where:

- $\sigma_{RO}$  is the standard deviation of the reproducibility of the method
- $\sigma_{omc}$  is the standard deviation describing the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test.

$\sigma_{RO}$  expresses the uncertainty in test results delivered by the different accredited test laboratories due to different instrumentation and implementation of measurement procedure as well different radiation characteristics of the noise source during test.

$\sigma_{omc}$  expresses the uncertainty associated with the instability of the operating and mounting conditions for the particular noise source during test. The mounting and installation conditions in two DTI acoustical test chambers are well defined in the test procedure. Possible instability of the operating conditions is monitored and assessed prior to each noise test.



The test uncertainty  $\sigma_{omc}$  is calculated according to ISO3743-1 Annex C formula C.1 and is typically below 0.5dB. However, the uncertainty is rounded up to the nearest 0.5dB increment in the report. As pr. Table C.1 (accuracy grade 2), the uncertainty  $\sigma_{RO}$  is set to 1.5.

The expanded uncertainty U is calculated according to ISO 3743-1 equation 23:  
 $U = k \sigma_{tot}$  where  $k = 2$  for 95% confidence.

EXAMPLE:  $\sigma_{tot}: \sqrt{1.5^2 + 0.5^2} = 1.6 \text{ dB}$  and  $U(95\%) = 3.2 \text{ dB}$

Note: The expanded uncertainty does not include the standard deviation of production which is used in ISO4871 for the purpose of making noise declaration for batches of machines.



DANISH  
TECHNOLOGICAL  
INSTITUTE

Page 44 of 44  
300-KLAB-23-039-15

## Appendix 2

### Authorization Letter

This declaration of conformity is issued under the sole responsibility of

**Manufacturer's Name:** GD Midea HEATING&VENTILATING Equipment Co.,Ltd.

**Manufacturer's Address:** Midea Industrial City, Shunde, Foshan, Guangdong, P.R. China

We declare that the following Heat Pump product we produced for AB KLIMA are identical to our following models

Master company(Midea) model	ABK Model
MHC-V6W/D2N8-BE30	HHPM-M6TH1PH
MHC-V8W/D2N8-BE30	HHPM-M8TH1PH
MHC-V10W/D2N8-BE30	HHPM-M10TH1PH
MHC-V12W/D2RN8-BER90	HHPM-M12TH3PH
MHC-V14W/D2RN8-BER90	HHPM-M14TH3PH
MHC-V16W/D2RN8-BER90	HHPM-M16TH3PH

Company name: AB KLIMA

Tradename /-mark: Hyundai

Address: 36-007 Krasne 25 C, k/ Rzeszowa, Poland.

**Note: This declaration becomes invalid if technical or operational modifications are introduced without the manufacturer' s consent.**

Production year: 2021~2023

Date : 20/03/2024  
Authorization



DANAK

Test Reg. nr. 300



## RAPORT Z TESTU

Nr raportu:  
300-KLAB-23-039-15



DUŃSKI  
INSTYTUT  
TECHNOLOGICZNY

Teknologiparken  
Kongsvang Allé 29  
DK-8000 Aarhus C  
+45 72 20 20 00  
Info@teknologisk.dk  
www.teknologisk.dk

Strona 1 z44  
Ozn: PRES/RTHI  
Nr rej.: 226006  
Załączniki: 2

<b>Klient:</b>	Firma: GD MIDEA HEATING & VENTILATING EQUIPMENT CO., LTD. Adres: Penglai Industry Road, Beijiao Miasto: Shunde, Foshan, Guangdong, 528311, Chiny Tel.: +86 13902810522
<b>Testowana jednostka:</b>	Marka: Midea Typ: Pompa ciepła powietrze-woda (monoblok) Model: MHC-V16W/D2RN8-B Nr seryjny: 541K814480238190100003
<b>Daty:</b>	Rok produkcji: Jednostka zewnętrzna: NIE DOTYCZY Okres testowy: Grudzień 2023 – Styczeń 2024
<b>Nazwa marki:</b>	Marka: Hyundai Typ: Pompa ciepła powietrze-woda (monoblok) Model: HHPM-M16TH3PH
<b>Procedury:</b>	Patrz cel (strona 2), aby zapoznać się z listą standardów.

**Uwagi:** Urządzenie zostało dostarczone przez klienta. Instalacja i ustawienia testowe zostały wykonane zgodnie z instrukcjami klienta. Pomiędzy każdym testem klient zmieniał różne parametry, takie jak prędkość sprężarki, zawór rozprężny, prędkość wentylatora, prędkość pompy, czas odszraniania, czas ogrzewania. Raport dla testowanej jednostki nosi nazwę 300-KLAB-23-039 wydany 2024.03.21 Patrz również załącznik 2.

**Warunki:** Test ten został przeprowadzony w ramach akredytacji zgodnie z międzynarodowymi wymaganiami (ISO/IEC 17025:2017) i zgodnie z ogólnymi warunkami Duńskiego Instytutu Technologicznego. Wyniki testu odnoszą się wyłącznie do testowanego elementu. Niniejszy raport z testu może być cytowany we fragmencie wyłącznie za pisemną zgodą Duńskiego Instytutu Technologicznego.

Klient nie może wspominać ani powoływać się na Duński Instytut Technologiczny lub pracowników Duńskiego Instytutu Technologicznego w celach reklamowych lub marketingowych, chyba że Duński Instytut Technologiczny udzieli pisemnej zgody w każdym przypadku.

**Oddział/Centrum:** Duński Instytut Technologiczny  
Energy and Climate  
Heat Pump Laboratory, Aarhus

**Data:** 2024.05.22

**Podpis:**  
Preben Eskerod  
B.TecMan & MarEng

**Współpracownik:**  
Rasmus Thisgaard  
B.TecMan & MarEng



DANAK

Nr rej. testu 300

# POŚWIADCZONE TŁUMACZENIE Z JĘZYKA ANGIELSKIEGO



DUŃSKI  
INSTYTUT  
TECHNOLOGICZNY

Strona 3 z 44  
300-KLAB-23-039-15

## **Cel**

Celem niniejszego raportu jest udokumentowanie następujących kwestii:

Sezonowy współczynnik wydajności (SCOP) przy zastosowaniu w niskiej i średniej temperaturze dla klimatu umiarkowanego zgodnie z normą EN 14825:2022.

W celu obliczenia SCOP przeprowadzono testy w warunkach obciążenia częściowego podanych w tabelach na stronie 5 i 6.

Test częściowego obciążenia SCOP<sub>B</sub> oraz SCOP<sub>C</sub> w zastosowaniach niskotemperaturowych w cieplejszym klimacie zgodnie z normą EN 14825:2022.

Warunki testu częściowego obciążenia SCOP<sub>A</sub> oraz SCOP<sub>F/G</sub> w zastosowaniach niskotemperaturowych w chłodniejszym klimacie zgodnie z normą EN 14825:2022.

Standardowe warunki znamionowe testu COP A7/W35 i A7/W55 zgodnie z EN 14511:2022.

Wymagania operacyjne zgodnie z EN 14511-4:2022

- 4.2.1 Testy rozruchu i działania
- 4.5 Odcięcie przepływu nośnika ciepła
- 4.6 Całkowita awaria zasilania

Pomiary mocy dźwięku zgodnie z normą EN 12102-1:2022.



DANAK

Nr rej. testu 300



## Wyniki testu

## **Wyniki testu SCOP w niskiej temperaturze - średnia sezonu grzewczego - EN 14825**

Model (Zewnętrzny)	MHC-V16W/D2RN8-B
Pompa ciepła powietrze-woda typu monoblok	T
Niskotemperaturowa pompa ciepła	N
Wyposażona w dodatkową nagrzewnicę	T
Grzałka z pompą ciepła	N
Odwrotnalna	T

Znamionowa moc cieplna <sup>1)</sup>	Prsted	15.2 [kW]
Sezonowa efektywność energetyczna ogrzewania pomieszczeń	Os	184.1 [%]
	SCOP	4.63 [-]

<b>Zmierzona wydajność ogrzewania dla częściowego obciążenia przy temperaturze zewnętrznej <math>T_j</math></b>	Średni klimat Zastosowanie w niskiej temperaturze	<b><math>T_j = -15 \text{ }^{\circ}\text{C}</math></b>	Pdh	<b>- [kW]</b>
		$T_j = -7 \text{ }^{\circ}\text{C}$	Pdh	<b>13.27 [kW]</b>
		$T_j = 2 \text{ }^{\circ}\text{C}$	Pdh	8.24 [kW]
		$T_j = 7 \text{ }^{\circ}\text{C}$	Pdh	<b>6.26 [kW]</b>
		$T_j = 12 \text{ }^{\circ}\text{C}$	Pdh	7.26 [kW]
		$T_j = \text{dwuwartościowa temperatura}$	Pdh	<b>13.27 [kW]</b>
		$T_j = \text{limit działania}$	Pdh	12.62 [kW]

<b>Zmierzony współczynnik wydajności przy temperaturze zewnętrznej <math>T_j</math></b>	Średni klimat Zastosowanie w niskiej temperaturze	$T_j = -15^\circ\text{C}$	COPd	- [-]
		$T_j = -7^\circ\text{C}$	COPd	2.64 [-]
		$T_j = -2^\circ\text{C}$	COPd	4.59 [-]
		$T_j = 7^\circ\text{C}$	COPd	6.62 [-]
		$T_j = 12^\circ\text{C}$	COPd	8.13 [-]
		$T_j = \text{dwuwartościowa temperatura}$	COPd	2.64 [-]
		$T_j = \text{limit działania}$	COPd	2.51 [-]

Temperatura dwuwartościowa	Tbivalent	-7 [°C]
Limit działania temperatury	TOL	-10 [°C]
Współczynnik degradacji	WTOL	- [°C]
	Cdh	0.97 [-]

<b>Zużycie energii w trybach innych niż aktywny</b>	Tryb wyłączenia	P <sub>OFF</sub>	0.021 [kW]
	Tryb wyłączenia termostatu	P <sub>TO</sub>	0.026 [kW]
	Tryb gotowości	P <sub>SB</sub>	0.021 [kW]
	Tryb nagrzewnicy skrzyni korbowej <sup>2)</sup>	P <sub>CK</sub>	0.021 [kW]
<b>Nagrzewnica dodatkowa<sup>1)</sup></b>	Znamionowa moc cieplna	P <sub>sup</sub>	2.58 [kW]
	Rodzaj pobieranej energii		Elektryczna

<b>Inne pozycje</b>	Kontrola wydajności	Zmienna
	Kontrola przepływu wody	Zmienna
	Wskaźnik przepływu wody	-
	Rocznego zużycie energii	QHE 6712 [kWh]

W przypadku ogrzewaczy pomieszczeń z pompą ciepła i ogrzewaczy wielofunkcyjnych z pompą ciepła znamionowa moc cieplna. Prated, jest równa projektowemu obciążeniu grzewczemu, Pdesignh, a znamionowa moc cieplna dodatkowego podgrzewacza, Psup, jest równa dodatkowej wydajności grzewczej, supT).

Do obliczenia SCOP używany jest wartość PCK - PSB. Patrz strona 15.



DANAK

Nr rei-testu 300



## Wyniki testu SCOP w średniej temperaturze - średnia sezonu grzewczego - EN 14825

<b>Model (Zewnętrzny)</b>	MHC-V16W/D2RN8-B		
<b>Pompa ciepła powietrze-woda typu monoblok</b>	Y		
<b>Niskotemperaturowa pompa ciepła</b>	N		
<b>Wyposażona w dodatkową nagrzewnicę</b>	Y		
<b>Grzałka z pompą ciepła</b>	N		
<b>Odwracalna</b>	Y		

<b>Znamionowa moc cieplna <sup>1)</sup></b>	Prated	<b>13 [kW]</b>
<b>Sezonowa efektywność energetyczna ogrzewania pomieszczeń</b>	SCOP	<b>137.3 [%]</b> <b>3.51 [-]</b>

<b>Zmierzona wydajność ogrzewania dla częściowego obciążenia przy temperaturze zewnętrznej <math>T_j</math></b>	Średni klimat Zastosowanie w średniej temperaturze	$T_j = -15^{\circ}\text{C}$	Pdh	- [RW]
		$T_j = -7^{\circ}\text{C}$	Pdh	11.68 WJ
		$T_j = 2^{\circ}\text{C}$	Pdh	7.29 [kW]
		$T_j = 7^{\circ}\text{C}$	Pdh	6.03 [kW]
		$T_j = 12^{\circ}\text{C}$	Pdh	6.89 [kW]
		$T_j$ = dwuwartościowa temperatura	Pdh	11.68 lkW
		$T_j$ = limit działania	Pdh	10.53 [kW]

<b>Zmierzony współczynnik wydajności przy temperaturze zewnętrznej <math>T_j</math></b>	Średni klimat Zastosowanie w średniej temperaturze	$T_j = -15^{\circ}\text{C}$	COPd	- [-]
		$T_j = -7^{\circ}\text{C}$	COPd	2.02 [-]
		$T_j = 2^{\circ}\text{C}$	COPd	3.42 [-]
		$T_j = 7^{\circ}\text{C}$	COPd	4.93 [-]
		$T_j = 12^{\circ}\text{C}$	COPd	6.02 [-]
		$T_j$ = dwuwartościowa temperatura	COPd	2.02 [-]
		$T_j$ = limit działania	COPd	1.82 [-]

<b>Temperatura dwuwartościowa</b>	Tbivalent	-7 [ $^{\circ}\text{C}$ ]
<b>Limit działania</b>	TOL	-10 $^{\circ}\text{C}$
<b>temperatury</b>	WTOL	- [ $^{\circ}\text{C}$ ]
<b>Współczynnik degradacji</b>	Cdh	0.98 [-]

<b>Zużycie energii w trybach innych niż aktywny</b>	Tryb wyłączenia	PoFF	0.021 [kW]
	Tryb wyłączenia termostatu	P <sub>TO</sub>	0.026 [kW]
	Tryb gotowości	P <sub>SB</sub>	0.021 [kW]
	Tryb nagrzewnicy skrzyni korbowej	P <sub>IK</sub>	0.021 [kW]
<b>Nagrzewnica dodatkowa<sup>1)</sup></b>	Znamionowa moc cieplna	P <sub>sup</sub>	2.47 [kW]
	Rodzaj pobieranej energii		Elektryczna

<b>Inne pozycje</b>	Kontrola wydajności	Zmienna
	Kontrola przepływu wody	Zmienna
	Wskaźnik przepływu wody	-
	Rocznego zużycia energii	Q <sub>HE</sub>

<sup>1)</sup> W przypadku ogrzewaczy pomieszczeń z pompą ciepła i wielofunkcyjnych ogrzewaczy z pompą ciepła znamionowa moc cieplna, Prated, jest równa obciążeniu obliczeniowemu dla ogrzewania. Pdesignh, a znamionowa moc cieplna dodatkowego ogrzewacza, Psup, jest równa dodatkowej wydajności grzewczej, sup(Tj).

<sup>2)</sup> Do obliczenia SCOP używana jest wartość PCK - PSB. Patrz strona 17



DANAK

Nr rej. testu 300

**Wyniki testów dla cieplejszego klimatu, niska temperatura zgodnie z EN14825**

Nr	Warunki testowe	Moc grzewcza [kW]	COP
1	B	13.106	3.508
2	Tbivalent F i C	8.750	5.514

**Wyniki testów dla chłodniejszego klimatu, niska temperatura zgodnie z EN14825**

Nr	Warunki testowe	Moc grzewcza [kW]	COP
1	A	8.383	3.315
2	Tbivalent F i G	11.301	2.497

**Wyniki testu COP - niska temperatura – EN 14511**

Nº	Warunki testowe	Moc grzewcza [kW]	COP
1	A7/W35	15.707	4.498

**Wyniki testu COP - średnia temperatura – EN 14511**

Nr	Warunki testowe	Moc grzewcza [kW]	COP
1	A7/W55	16.139	2.854





## Wyniki pomiarów mocy dźwięku – EN 12102-1

Nr	Warunki testowe	Poziom mocy dźwięku LW(A) [dB re 1pW]	Niepewność $\Delta_{tot}$ [dB]
1 <sup>F</sup>	A7/W35	66.5	1.6
2 <sup>P</sup>	A7/W35	51.5	1.6
3 <sup>F</sup>	A7/W55	65.2	1.6
4 <sup>E</sup>	A7/55	55.6	1.6

F) Pełne obciążenie, P) Częściowe obciążenie i E) Oznaczenie ErP

Całkowity poziom mocy dźwięku skorygowany charakterystyką A jest określany dla mierzonego zakresu częstotliwości od 100 Hz do 10 kHz. Obliczenia niepewności znajdują się w załączniku 1.

Pomiary mocy dźwięku są przeprowadzane przez Kamalathasana Arumugama (KAMA) i współodczytywane przez Patricka Gliberta (PGL) z Duńskiego Instytutu Technologicznego.

*Ja, Katarzyna Beściak-Kocur, tłumacz przysięgły języka angielskiego, wpisany na listę tłumaczy przysięgłych, prowadzoną przez Ministerstwo Sprawiedliwości, pod numerem TP/3963/05, zaświadczam, że niniejsze tłumaczenie w pełni i prawdziwie odzwierciedla zawartość przedstawionego mi oryginału dokumentu w języku angielskim.  
Rzeszów, 09.06.2024 Numer w repetytorium A Nr: 2421/2024*



DANAK

Nr rej. testu 300

## OŚWIADCZENIE

Producent Midea oświadcza, iż pompy ciepła

1) HHPM-M12TH3PH

Oznaczenie/typ/identyfikator modelu

2) HHPM-M14TH3PH

Oznaczenie/typ/identyfikator modelu

3) HHPM-M16TH3PH

Oznaczenie/typ/identyfikator modelu

4)

Oznaczenie/typ/identyfikator modelu

5)

Oznaczenie/typ/identyfikator modelu

Należą do jednego podtypu w danym typoszeregu i spełniają łącznie następujące warunki:

- identyczna konstrukcja obiegu chłodniczego, ten sam czynnik chłodniczy/roboczy;
- ten sam producent, typ i liczba sprężarek;
- ten sam typ elementu rozprężnego;
- ten sam typ skraplacza;
- ten sam typ parownika;
- ten sam typ procesu odszraniania;
- ten sam sterownik i zasada sterowania wydajnością;
- ten sam producent, typ i liczba wentylatorów parownika (w przypadku powietrznych pomp ciepła) i zasada sterowania wydajnością (stała, zmienna lub stopniowana regulacja prędkości obrotowej);
- urządzenia z i bez zaworu czterodrogowego nie mogą być zaliczone do tego samego typoszeregu.

Shunde Foshan . 2024.4.9

Miejscowość, data

